


# **CITY OF NORCO**

# **STANDARD DRAWINGS**

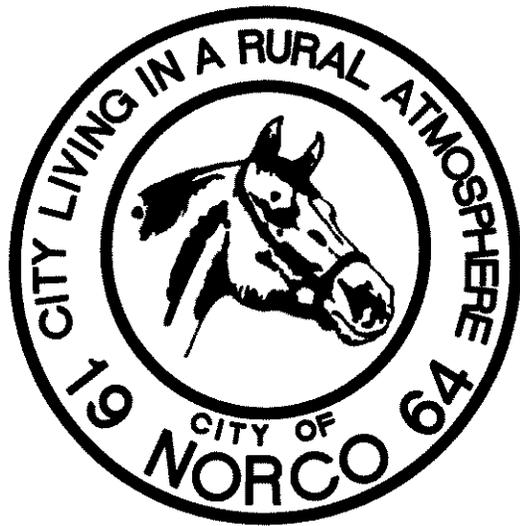

**JANUARY 2005**

**JOSEPH S. SCHENK  
CITY ENGINEER**



# INDEX TO STANDARD DRAWINGS

## 00 - General Notes

GRADING GENERAL NOTES  
SANITARY SEWER GENERAL NOTES  
STORM DRAIN GENERAL NOTES  
STREET GENERAL NOTES  
WATER GENERAL NOTES

## 50 - Drafting Standards

50A - DRAFTING STANDARDS AND TOPO SYMBOLS  
50B - DRAFTING STANDARDS AND TOPO SYMBOLS

## 100 - Street Standards

100 - TYPICAL STREET SECTION W = 60'  
110 - TYPICAL STREET SECTION, W = 88'  
115 - TYPICAL STREET SECTION, W = 88' WITH EQUESTRIAN TRAIL  
120A - TYPICAL STREET SECTION, W = 110'  
120B - TYPICAL STREET SECTION, W = 110' WITH RAISED MEDIAN  
125 - TYPICAL STREET SECTION, W = 64' WITH EQUESTRIAN TRAIL  
140A - CUL-DE-SAC (SYMMETRICAL)  
140B - CUL-DE-SAC (OFF-SET)  
140C - CUL-DE-SAC WITH EQUESTRIAN TRAIL ON ONE SIDE  
145A - INTERSECTION KNUCKLE  
155 - STREET PAVEMENT REPAIR

## 200 - Curbs, Gutters, Driveway Standards

200 - STANDARD CURB DETAILS  
205 - STANDARD ROLLED CURB  
215 - CURB TRANSITION  
225 - CROSS GUTTER AND SPANDREL  
235 - RAMP FOR THE PHYSICALLY DISABLED  
240 - RESIDENTIAL DRIVEWAY APPROACH  
245 - RESIDENTIAL DRIVEWAY APPROACH WITH EQUESTRIAN TRAIL  
250 - COMMERCIAL AND INDUSTRIAL DRIVEWAY APPROACH  
255 - COMMERCIAL DRIVEWAY APPROACH (ALTERNATIVE)

## 300 - Drainage Standards

300A - PARKWAY DRAIN  
300B - PARKWAY DRAIN  
301 - CURB OUTLET FOR RESIDENTIAL ROLLED CURB



# INDEX TO STANDARD DRAWINGS

## 400 - Water Standards

- 400A - SEPARATION OF SEWER AND WATER
- 400B - SEPARATION OF SEWER AND WATER, CONCRETE ENCASEMENT
- 405 - WATER SERVICE CONNECTION
- 406 - WATER SERVICE ABANDONMENT
- 410 - 2" WATER SERVICE CONNECTION
- 415 - STANDARD WATER SERVICE, 3" AND LARGER
- 420 - DETECTOR CHECK DOUBLE CHECK VALVE
- 425 - STEEL PIPE JOINTS
- 430A - INSTALLATION OF LANDSCAPING BACKFLOW PREVENTION ASSEMBLY
- 430B - INSTALLATION OF LANDSCAPING BACKFLOW PREVENTION ASSEMBLY
- 435 - UNIVERSAL AIR VALVE ASSEMBLY
- 440A - TRANSMISSION MAIN BLOW OFF ASSEMBLY
- 440B - BLOW OFF (FOR FUTURE EXTENSION)
- 440C - 2" BLOW OFF ASSEMBLY
- 445 - FIRE HYDRANT ASSEMBLY
- 446 - TYPICAL HYDRANT MARKER LOCATION
- 450 - GATE VALVE EXTENSION
- 451 - BUTTERFLY VALVE EXTENSION
- 455 - GATE VALVE AND BOX
- 456 - BUTTERFLY VALVE AND BOX
- 460 - THRUST BLOCKS
- 465 - WELD COLLAR
- 470 - SAMPLING STATION

## 500 - Sewer Standards

- 500A - SEWER SADDLE AND LATERAL
- 500B - SEWER SADDLE DETAILS
- 505 - SEWER LATERAL ABANDONMENT
- 510 - SEWER TERMINAL CLEAN-OUT
- 515 - PRECAST CONCRETE MANHOLE FOR LINES 15" IN DIA. AND SMALLER
- 520 - SEWER MANHOLE DROP INLET
- 535 - MANHOLE COVER ADJUSTMENT
- 540 - SEWER MANHOLE FRAME AND COVER

## 600 - Miscellaneous Standards

- 620 - PARKING LOT DESIGN
- 630 - REFUSE BIN ENCLOSURE
- 635 - STEPS FOR MANHOLES



# INDEX TO STANDARD DRAWINGS

## **700 - Trail Standards**

- 700 - EQUESTRIAN TRAIL STANDARD
- 705 - TRAIL FENCING DETAIL
- 710 - EQUESTRIAN TRAIL AT CORNER
- 720 - HORSE TRAIL SIGN

## **800 - Sign and Marking Standards**

- 800A - STREET NAME SIGN
- 800B - TYPICAL STREET NAME SIGN LOCATIONS
- 815 - STOP BAR AND LEGEND PLACEMENT
- 820 - BARRICADE
- 830 - TRAFFIC INDEXES FOR DESIGN USE
- 840 - CROSSWALK PLACEMENT AND SIGNAL POLE LOCATION

## **900 - Survey Standards**

- 900 - CENTERLINE TIE REQUIREMENTS
- 905A - STREET TIE LOCATIONS
- 905B - STREET TIE LOCATIONS
- 905C - STREET TIE LOCATIONS
- 915 - STANDARD SUBDIVISION MONUMENTATION
- 916 - SUBDIVISION MONUMENTATION NOTES

**00**  
**GENERAL**  
**NOTES**



# CITY of NORCO STANDARD DRAWING

## General Notes: (Grading)

1. ALL WORK SHALL BE DONE IN ACCORDANCE WITH THE CITY OF NORCO ORDINANCE, THE CITY ENGINEER AND ANY SPECIAL REQUIREMENTS OF THE PERMIT.
2. NO GRADING SHALL BE STARTED WITHOUT FIRST NOTIFYING THE CITY ENGINEER.
3. A PRE-GRADING MEETING AT THE SITE IS REQUIRED BEFORE START OF GRADING WITH THE FOLLOWING PEOPLE PRESENT: OWNER, GRADING CONTRACTOR, DESIGN CIVIL ENGINEER, SOILS ENGINEER, GEOLOGIST.
4. FILLS SHALL BE COMPACTED THROUGHOUT TO 90% DENSITY AS DETERMINED BY U.B.C. STANDARD NO. 70-1-10, AND CERTIFIED BY THE SOILS ENGINEER.
5. AREAS TO RECEIVE FILL SHALL BE PROPERLY PREPARED AND APPROVED BY THE SOILS ENGINEER PRIOR TO PLACING OF FILL.
6. FILL AREAS SHALL BE CLEANED OF ALL VEGETATION AND DEBRIS, SCARIFIED TO A DEPTH OF 12 INCHES AND INSPECTED BY THE SOIL TESTING AGENCY PRIOR TO THE PLACING OF FILL.
7. THE FACE OF ALL CUT AND FILL SLOPES SHALL BE PLANTED AND MAINTAINED WITH A GROUND COVER APPROVED BY THE PLANNING DIRECTOR. AN APPROVED IRRIGATION SYSTEM OR WATERING FACILITIES MAY BE REQUIRED BY THE CITY ENGINEER OR PLANNING DIRECTOR PRIOR TO ROUGH GRADE APPROVAL.
8. ALL TRENCH BACKFILLS SHALL BE TESTED AND CERTIFIED BY THE SITE SOILS ENGINEER PER THE GRADING CODE. THE SOIL CERTIFICATION SHALL INCLUDE THE STABILITY OF THE BACKFILL AND THAT THE COMPACTION IS 90% OF THE OPTIMUM DENSITY USING THE AASHTO TEST T 180-57 MODIFIED TO USE 3 LAYERS IN LIEU OF 5 LAYERS.
9. THE FINAL COMPACTION REPORT AND CERTIFICATION FROM THE SOILS ENGINEER SHALL CONTAIN THE TYPE OF FIELD TESTING PERFORMED. EACH TEST SHALL BE IDENTIFIED WITH THE METHOD OF OBTAINING THE IN-PLACE DENSITY, WHETHER SAND CONE OR DRIVE RING AND SHALL BE SO NOTED FOR EACH TEST. SUFFICIENT MAXIMUM DENSITY DETERMINATIONS SHALL BE PERFORMED TO VERIFY THE ACCURACY OF THE MAXIMUM DENSITY CURVES USED BY THE FIELD TECHNICIAN.
10. THE DESIGN CIVIL ENGINEER SHALL EXERCISE SUFFICIENT SUPERVISORY CONTROL DURING GRADING AND CONSTRUCTION TO INSURE COMPLIANCE WITH THE PLANS, SPECIFICATIONS, AND CODE WITHIN HIS PURVIEW.
11. STRICT ADHERENCE TO DUST CONTROL REQUIREMENTS SHALL BE ENFORCED AND ALL DUST SHALL BE CONTROLLED BY WATERING.
12. PRIOR TO TRENCHING FOR THE FOUNDATION, THE ROUGH GRADING SHALL BE APPROVED BY THE CITY ENGINEER AND THE ROUGH GRADE CERTIFICATION, ALONG WITH THE FINAL COMPACTION TESTING REPORT, SHALL BE SUBMITTED AND APPROVED BY THE CITY ENGINEER. FINISH GRADE CERTIFICATION SHALL BE SUBMITTED TO AND APPROVED BY THE CITY ENGINEER PRIOR TO CERTIFICATE OF OCCUPANCY.

<b>REVISION</b>	NO:	BY:	DATE:	NO:	BY:	DATE:	APPROVED:  24039 CITY ENGINEER RCE
Drawn By: LJA			Date: 03/19/04				
<b>GENERAL NOTES (GRADING)</b>							Std. Dwg. No. <b>010</b> Sheet 1 of 3

# CITY of NORCO STANDARD DRAWING

13. STATE LAW (SB3019) REQUIRES THE CONTRACTOR TO CONTACT UNDERGROUND SERVICE ALERT (USA) AND OBTAIN AN IDENTIFICATION NUMBER PRIOR TO THE ISSUANCE OF THE CITY'S ENCROACHMENT PERMIT. THE CONTRACTOR SHALL NOTIFY USA TWO FULL WORKING DAYS (48 HOURS MINIMUM) IN ADVANCE OF ANY CONSTRUCTION ACTIVITIES.
14. ALL SURVEY MOMUMENTS SHALL BE PROTECTED AND PERPETUATED IN PLACE. ANY DISTURBED OR COVERED MONUMENTS SHALL BE RESET BY A REGISTERED CIVIL ENGINEER OR A LICENSED LAND SURVEYOR.
15. REPAIR OR REPLACE ALL EXISTING DAMAGED OR ALTERED PUBLIC IMPROVEMENTS AS REQUIRED BY THE ENGINEER IN THE FIELD.
16. ANY MATERIAL INCORPORATED AS PART OF THE COMPACTED FILL MUST BE APPROVED BY THE SOILS ENGINEER. INSPECTION AND CERTIFICATION OF FILL PLACEMENT SHALL BE PROVIDED BY THE SOILS ENGINEER DURING THE PROCESS OF GRADING. NO ROCK OR SIMILAR MATERIAL GREATER THAN EIGHT INCHES IN DIAMETER WILL BE PLACED IN THE FILL UNLESS RECOMMENDATIONS FOR SUCH PLACEMENT HAVE BEEN SUBMITTED BY THE SOILS ENGINEER IN ADVANCE AND APPROVED BY THE CITY ENGINEER.
17. IF ANY UNKNOWN SUB-SURFACE STRUCTURES ARE ENCOUNTERED DURING CONSTRUCTION, THEY SHALL BE IMMEDIATELY BROUGHT TO THE ATTENTION OF THE SOILS ENGINEER AND THE CITY ENGINEER PRIOR TO PROCEEDING WITH GRADING OPERATIONS.
18. IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO VERIFY THE LOCATION OF ALL UTILITIES OR STRUCTURES ABOVE OR BELOW GROUND, SHOWN OR NOT SHOWN ON THESE PLANS. HE WILL BE HELD RESPONSIBLE FOR ALL DAMAGE TO ANY UTILITIES OR STRUCTURES CAUSED BY HIS OPERATION. THE ENGINEER OF RECORD MUST BE NOTIFIED OF ANY CONFLICTS AND CONSTRUCTION MUST BE TERMINATED AND STREETS RESTORED UNTIL CORRECTIVE MEASURES HAVE BEEN APPROVED BY THE CITY ENGINEER.
19. CUT SLOPES SHALL NOT EXCEED 1-1/2:1 AND FILL SLOPES SHALL NOT EXCEED 2:1 UNLESS OTHER SLOPE IS JUSTIFIED BY THE SOILS ENGINEER. FILL SLOPES SHALL HAVE NOT LESS THAN 90% RELATIVE COMPACTION AS DETERMINED BY ASTM D 1557-70 AND CERTIFIED BY THE SOILS ENGINEER. TOE OF SLOPES WILL BE LOCATED PER CHAPTER 70 OF THE UNIFORM BUILDING CODE, LATEST EDITION.
20. SEPARATE PERMITS SHALL BE REQUIRED FOR ANY IMPROVEMENT WORK IN THE PUBLIC RIGHT-OF-WAY.
21. ADJACENT STREETS ARE TO BE CLEANED DAILY OF ALL DIRT AND DEBRIS THAT IS THE RESULT OF THIS OPERATION.
22. ALL BACKFILL OF TRENCHES TO BE CERTIFIED BY A SOILS ENGINEER (90% MINIMUM COMPACTION) PER CITY STANDARDS AND SPECIFICATIONS. ALL EXCAVATIONS, CONSTRUCTION AND INSTALLATIONS IN THE PUBLIC RIGHT-OF-WAY REQUIRE INSPECTION BY CITY INSPECTOR. FAILURE TO HAVE INSPECTION MAY RESULT IN REOPENING OF THE EXCAVATION AND POSSIBLE RECONSTRUCTION.

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:	APPROVED:  24039 CITY ENGINEER RCE

Drawn By: LJA

Date: 03/19/04

## GENERAL NOTES (GRADING)

Std. Dwg. No.  
**010**  
Sheet 2 of 3

# CITY of NORCO STANDARD DRAWING

23. EARTHWORK QUANTITIES FOR STREET AND SITE GRADING ARE ESTIMATED TO BE:

CUT: \_\_\_\_\_ FILL: \_\_\_\_\_ IMPORT: \_\_\_\_\_

THESE QUANTITIES ARE BASED ON THE ASSUMPTION THAT A \_\_\_\_\_, SUBSIDENCE WILL OCCUR OVER THE ENTIRE SITE.

24. THE UNDERSIGNED CIVIL ENGINEER CERTIFIES THAT THIS GRADING WORK WILL BE SUPERVISED IN ACCORDANCE WITH SECTION 7014 OF THE UNIFORM BUILDING CODE.

SIGNATURE \_\_\_\_\_ R.C.E. NO. \_\_\_\_\_ DATE \_\_\_\_\_

25. AN AS-BUILT GRADING PLAN SHALL BE SUBMITTED BY THE ENGINEER ALONG WITH THE FINAL GRADE CERTIFICATION PRIOR TO ISSUANCE OF OCCUPANCY.

26. NO WATER SHALL BE TAKEN FROM CITY FIRE HYDRANTS WITHOUT AN AUTHORIZED HYDRANT METER.

27. APPROVED PROTECTIVE MEASURES AND TEMPORARY DRAINAGE PROVISIONS MUST BE USED TO PROTECT ADJOINING PROPERTIES DURING ANY GRADING OPERATIONS. THE CITY ENGINEER MAY REQUIRE AND SHALL APPROVE ANY TEMPORARY DRAINAGE MEASURES USED TO PROTECT ADJOINING PROPERTY DURING GRADING OPERATIONS, I.E., EROSION CONTROL, FROM OCTOBER 15 TO APRIL 15 AND SHALL BE ON FILE WITH THE CITY ENGINEER.

28. APPROVAL OF THESE PLANS BY THE CITY OR ITS AGENTS DOES NOT RELIEVE THE ENGINEER AND THE APPLICANT FROM THE RESPONSIBILITY FOR THE CORRECTION OF ERRORS OR OMISSIONS DISCOVERED DURING CONSTRUCTION. UPON REQUEST, THE APPROPRIATE PLAN REVISIONS SHALL BE PROMPTLY SUBMITTED TO THE CITY ENGINEER FOR REVIEW AND APPROVAL.

29. ALL GRADING OPERATIONS SHALL CEASE IF WIND VELOCITIES EXCEED 25 MPH. THE PROJECT SITE SHALL BE REGULARLY WATERED TO MITIGATE BLOWING DUST DURING THE DURATION OF HIGH WIND CONDITIONS.

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:	APPROVED: <i>Joseph Schenk</i> 24039 CITY ENGINEER RCE
Drawn By: LJA			Date: 03/19/04				
<b>GENERAL NOTES (GRADING)</b>							Std. Dwg. No. <b>010</b> Sheet 3 of 3

# CITY of NORCO STANDARD DRAWING

## General Notes: (Sewer)

1. ALL WORK SHALL BE DONE IN ACCORDANCE WITH CITY OF NORCO STANDARD DRAWINGS, STANDARD SPECIAL PROVISIONS, AND THE LATEST EDITION OF STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION, WITH SUPPLEMENTS. ANY VARIATION FROM OR EXCEPTION TO THE STANDARDS OR FOLLOWING GENERAL NOTES MUST BE APPROVED BY THE CITY ENGINEER.
2. ALL MAINLINE SEWER SHALL BE VCP BELL AND SPIGOT. RESIDENTIAL LATERALS SHALL BE 4" VCP BELL AND SPIGOT. COMMERCIAL LATERALS SHALL BE 6" MINIMUM VCP BELL AND SPIGOT.
3. THE CONTRACTOR SHALL NOTIFY THE CITY OF NORCO ENGINEERING DEPARTMENT AT 951-270-5680, AT LEAST 48 HOURS PRIOR TO THE START OF ANY PHASE OF CONSTRUCTION AND 24 HOURS PRIOR TO THE NEED OF INSPECTION.
4. MANHOLE COVERS SHALL BE LEFT AT LEAST 6" BELOW SUBGRADE AND BROUGHT TO FINAL GRADE UPON COMPLETION OF PAVING. FINAL MANHOLE FRAME AND COVER SHALL BE ADJUSTED TO GRADE PER CITY OF NORCO STANDARD DRAWING NO. 535.
5. FOUR-INCH (4") V.C.P. SEWER LATERAL CONNECTIONS SHALL BE LAID TO GRADE AS ESTABLISHED BY THE ENGINEER SO THAT THE 4" V.C.P. WILL HAVE A MINIMUM COVER OF FIVE (5') TO THE TOP OF PIPE AT PROPERTY LINE AND SHALL HAVE A MINIMUM GRADE OF 2%. ALL SEWER LATERALS SHALL BE LAID 90 DEGREES TO THE MAIN LINE.
6. FINAL TESTING FOR PIPELINE LEAKAGE SHALL BE MADE IN THE PRESENCE OF THE CITY INSPECTOR AFTER BACKFILL AND COMPACTION HAVE BEEN COMPLETED BY THE CONTRACTOR AND INSPECTED, APPROVED AND ACCEPTED BY THE CITY ENGINEER.
7. ALL SEWER LINES TO BE BALLED IN THE PRESENCE OF THE CITY INSPECTOR AFTER FINAL TESTING AND MANHOLE COVERS HAVE BEEN BROUGHT TO GRADE UPON COMPLETION OF PAVING. BALLING MUST BE COMPLETED TO THE SATISFACTION OF THE CITY ENGINEER PRIOR TO OCCUPANCY RELEASES BEING ISSUED.
8. ALL TRENCH BACKFILL SHALL BE COMPACTED TO A MINIMUM OF 90% RELATIVE DENSITY IN THE PIPE ZONE AND TO WITHIN 6" OF THE SUBGRADE. A MINIMUM OF 95% RELATIVE DENSITY SHALL BE REQUIRED IN THE TOP 12" BELOW THE PAVEMENT.
9. THE DEVELOPER'S ENGINEER SHALL FURNISH A COMPLETE SET OF "AS-BUILT" PLANS ON ORIGINAL MYLARS TO THE CITY ENGINEER AT THE COMPLETION OF THE SEWER WORK AND PRIOR TO PAVING OF STREETS, SHOWING LOCATION OF WYES AND END OF HOUSE LATERALS AT THE PROPERTY LINE.
10. SAND BEDDING SHALL BE S.E. MIN. 30, 4" UNDER THE PIPE, AND 12" OF COLORED SAND OVER THE TOP OF PIPE UNLESS OTHERWISE NOTED ON PLANS. COLOR TO BE APPROVED BY FIELD INSPECTOR PRIOR TO LAYING.
11. THE CURB AND GUTTER SHALL BE "ETCHED" SHOWING LATERAL LOCATIONS: "S" FOR SEWER; "G" FOR GAS; "E" FOR ELECTRICAL; AND "W" FOR WATER.

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:

Drawn By: LJA

Date: 03/19/04

12/15/04

APPROVED: *Joseph B. Schenk* 24039  
CITY ENGINEER RCE

## GENERAL NOTES (SEWER)

Std. Dwg. No.  
**011**  
Sheet 1 of 2

# CITY of NORCO STANDARD DRAWING

12. STATE LAW (SB3019) REQUIRES THE CONTRACTOR TO CONTACT UNDERGROUND SERVICE ALERT (USA) AND OBTAIN AN IDENTIFICATION NUMBER PRIOR TO THE ISSUANCE OF THE CITY'S ENCROACHMENT PERMIT. THE CONTRACTOR SHALL NOTIFY USA TWO FULL WORKING DAYS (48 HOURS MINIMUM) IN ADVANCE OF ANY CONSTRUCTION ACTIVITIES.
13. PRIOR TO CONSTRUCTION, THE CONTRACTOR SHALL OBTAIN AN ENCROACHMENT PERMIT TO WORK WITHIN THE PUBLIC RIGHT OF WAY, FROM THE CITY OF NORCO ENGINEERING DEPARTMENT.
14. NO SEWER LATERALS SHALL PASS UNDER A DRIVE APPROACH OR DRIVEWAY.
15. DRIVE APPROACH CENTERLINES SHALL BE STAKED WHEN SEWER LINES ARE STAKED.
16. NO TRENCH BACKFILL SHALL TAKE PLACE WITHOUT PRIOR APPROVAL OF THE CITY'S INSPECTOR.
17. STREET TRENCHING, BACKFILLING AND PAVEMENT REPAIRS SHALL BE IN ACCORDANCE WITH CITY OF NORCO STANDARD DRAWING NO. 155.
18. APPROVAL OF THESE PLANS BY THE CITY OR ITS AGENTS DOES NOT RELIEVE THE ENGINEER AND THE APPLICANT FROM THE RESPONSIBILITY FOR THE CORRECTION OF ERRORS OR OMISSIONS DISCOVERED DURING CONSTRUCTION. UPON REQUEST, THE APPROPRIATE PLAN REVISIONS SHALL BE PROMPTLY SUBMITTED TO THE CITY ENGINEER FOR REVIEW AND APPROVAL.
19. ALL NEW SANITARY SEWERS SHALL BE VIDEOTAPED, WITH TAPE SUPPLIED TO CITY ENGINEER, PRIOR TO CITY'S ACCEPTANCE OF ANY NEW SEWER.
20. ALL SANITARY SEWER APPURTENANCES SHALL BE ABANDONED, RELOCATED AND/OR UPGRADED PER THE DIRECTION OF THE PUBLIC WORKS INSPECTOR, PER CITY OF NORCO STANDARDS, REGARDLESS IF SHOWN ON PLANS OR NOT.

DESIGN NOTE:

FOR ALL NEW STREET CONSTRUCTION, THE LOCATION OF SEWER MAINS SHALL BE SIX (6) FEET EAST OR SOUTH OF STREET CENTERLINE AND MUST BE MINIMUM TEN (10) FEET HORIZONTALLY FROM WATER LINE.

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:		
							12/15/04	
							<i>Joseph B. Schenk</i> 24039 APPROVED: CITY ENGINEER RCE	
Drawn By: LJA			Date: 03/19/04					
<b>GENERAL NOTES (SEWER)</b>							Std. Dwg. No. <b>011</b> Sheet 2 of 2	

# CITY of NORCO STANDARD DRAWING

## General Notes: (Storm Drain)

1. THE CONTRACTOR SHALL CONSTRUCT THE STORM DRAIN IMPROVEMENTS SHOWN ON THE DRAWINGS IN CONFORMANCE WITH THE REQUIREMENTS OF THE CITY OF NORCO SPECIAL PROVISIONS AND DETAILED SPECIFICATIONS. THESE DRAWINGS AND THE DATA HEREIN ARE MADE PART OF THE SPECIFICATIONS.
2. PRIOR TO CONSTRUCTION THE CONTRACTOR SHALL OBTAIN AN ENCROACHMENT PERMIT TO WORK WITHIN THE PUBLIC RIGHT OF WAY, FROM THE CITY OF NORCO ENGINEERING DEPARTMENT.
3. ALL WORK SHALL CONFORM TO THE STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION, RIVERSIDE COUNTY FLOOD CONTROL AND WATER CONSERVATION DISTRICT STANDARD DRAWINGS AND TO THE STANDARD DRAWINGS OF THE CITY OF NORCO, LATEST EDITIONS, UNLESS NOTED OTHERWISE.
4. CONSTRUCTION INSPECTION WILL BE PERFORMED BY THE CITY OF NORCO. THE CONTRACTOR SHALL OBTAIN ALL NECESSARY PERMITS AND SHALL NOTIFY THE CITY INSPECTORS (951) 270-5680 - 24 HOURS PRIOR TO STARTING EACH PHASE OF CONSTRUCTIONS AND PRIOR TO REQUIRING INSPECTION.
5. ALL MATERIALS AND METHODS TO BE SUBJECT TO THE APPROVAL OF THE CITY ENGINEER AND SUPERINTENDENT OF PUBLIC WORKS.
6. ALL STATIONING REFERS TO CENTERLINE OF CONSTRUCTION UNLESS OTHERWISE NOTED.
7. STATIONING FOR LATERALS AND CONNECTOR PIPE REFER TO THE CENTERLINE - CENTERLINE INTERSECTION STATION.
8. STATE LAW (SB 3019) REQUIRES THE CONTRACTOR TO CONTACT UNDERGROUND SERVICE ALERT AND OBTAIN AN IDENTIFICATION NUMBER PRIOR TO THE ISSUANCE OF THE CITY'S ENCROACHMENT PERMIT. THE CONTRACTOR SHALL NOTIFY UNDERGROUND SERVICE ALERT TWO FULL WORKING DAYS (48 HOURS MINIMUM) IN ADVANCE OF ANY CONSTRUCTION ACTIVITIES, INCLUDING PAVEMENT REMOVAL, EXCAVATION AND AC OVERLAY, WHICH COULD AFFECT ANY UNDERGROUND UTILITY.
9. ALL ELEVATIONS SHOWN ARE IN FEET AND DECIMALS THEREOF BASED ON U.S.C. & G.S. DATUM.
10. ELEVATIONS OF UTILITIES ARE APPROXIMATE UNLESS OTHERWISE NOTED.
11. IF ANY EXISTING UTILITIES OR ANY OTHER FACILITIES CONFLICT WITH THE PROPOSED IMPROVEMENTS, WORK SHALL STOP AND THE ENGINEER OF RECORD NOTIFIED IMMEDIATELY.
12. CONTRACTOR SHALL POT HOLE AT TIE-IN STATIONS AND AT ANY OTHER POINTS OF POTENTIAL CONFLICTS WITH UNDERGROUND FACILITIES BEFORE STARTING CONSTRUCTION.
13. BACKFILL MATERIAL TO HAVE A SAND EQUIVALENT (S.E.) OF 30 (MIN.) AND MINIMUM COMPACTION OF 90% . ALL TRENCH BACKFILL SHALL BE DONE IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS OF THE CITY OF NORCO.
14. BACKFILL TO BE IN 8" LIFTS IF TRENCH BOTTOM AND SIDES HAVE A S.E. LESS THAN 20.
15. NO TRENCH MAY LEFT OPEN OVERNIGHT UNLESS AUTHORIZED IN WRITING BY THE CITY ENGINEER.
16. TRENCHES SHALL HAVE SHAPED BEDDING WITH THE TOP 12" OVER PIPE BEING COLORED SAND, UNLESS OTHERWISE NOTED ON PLANS. COLOR TO BE APPROVED BY THE FIELD INSPECTOR.
17. BEDDING PIPE WITH LESS THAN TWO FEET OF COVER SHALL CONFORM TO LOS ANGELES COUNTY FLOOD CONTROL DISTRICT STANDARD DRAWINGS 2-D213.3 AND 2-D177 FOR CONCRETE BACKFILL IN TRENCHES. ALL OTHER PIPE SHALL CONFORM TO RCFC & WCD STANDARD DRAWING M815.
18. "V" IS THE DEPTH OF INLET OF CATCH BASINS MEASURED FROM THE TOP OF CURB TO INVERT OUTLET OF CONNECTOR PIPE.

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:	
						12/15/04	
Drawn By: LJA						Date: 03/19/04	
						APPROVED: <i>Joseph L. Schenk</i> 24039 CITY ENGINEER RCE	
<b>GENERAL NOTES (STORM DRAIN)</b>							Std. Dwg. No. <b>012</b> Sheet 1 of 2

# CITY of NORCO STANDARD DRAWING

18. "V" IS THE DEPTH OF INLET OF CATCH BASINS MEASURED FROM THE TOP OF CURB TO INVERT OUTLET OF CONNECTOR PIPE.
19. ALL CURBS, GUTTERS, SIDEWALKS, DRIVEWAYS, TRAILS AND OTHER EXISTING IMPROVEMENTS TO BE RECONSTRUCTED IN KIND AND AT THE SAME ELEVATION AND LOCATION AS THE EXISTING IMPROVEMENTS, UNLESS OTHERWISE NOTED.
20. THE CONTRACTOR SHALL DETERMINE THE TRUE LOCATION OF ANY UNDERGROUND UTILITY PRIOR TO LAYING ANY LINES WHICH ARE TO CONNECT TO THE EXISTING SEWER OR STORM DRAINS. THESE LINES SHALL BE EXPOSED AND JOIN ELEVATIONS VERIFIED. ANY CHANGE IN GRADE OR DEVIATION FROM THE PLANS MUST BE APPROVED BY THE CITY ENGINEER.
21. IF CAST IN PLACE PIPE (CIPP) WERE USED IN LIEU OF R.C.P. A SOILS REPORT MUST BE SUBMITTED TO THE CITY OF NORCO.
22. CATCH BASINS SHALL BE LOCATED SO THAT LOCAL DEPRESSIONS SHALL BEGIN AT EXISTING CURB RETURN JOINT, UNLESS OTHERWISE SPECIFIED.
23. NOTICE TO CONTRACTOR: THE EXISTENCE AND LOCATION OF ANY UNDERGROUND UTILITY PIPES OF STRUCTURES SHOWN ON THESE PLANS ARE OBTAINED BY A SEARCH OF THE AVAILABLE RECORDS. APPROVAL OF THESE PLANS BY THE CITY OF NORCO DOES NOT CONSTITUTE A REPRESENTATION AS TO THE ACCURACY OR COMPLETENESS OF THE LOCATION OR EXISTENCE OR NON-EXISTENCE OF ANY UNDERGROUND UTILITY PIPES OR STRUCTURES WITHIN THE LIMITS OF THIS PROJECT. THE CONTRACTOR IS REQUIRED TO TAKE ALL DUE PRECAUTIONARY MEANS TO PROTECT THE UTILITY LINES NOT OF RECORD OR NOT SHOWN ON THESE PLANS.

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:	APPROVED: <i>Joseph S. Schenk</i> 24039 CITY ENGINEER RCE
Drawn By: LJA			Date: 03/19/04				
<b>GENERAL NOTES (STORM DRAIN)</b>							Std. Dwg. No. <b>012</b> Sheet 2 of 2

# CITY of NORCO STANDARD DRAWING

## General Notes: (Street)

1. ALL WORK SHALL BE DONE IN ACCORDANCE WITH CITY OF NORCO STANDARD DRAWINGS, STANDARD SPECIAL PROVISIONS, AND THE LATEST EDITION OF THE STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION, WITH SUPPLEMENTS. ANY VARIATION FROM OR EXCEPTION TO THE STANDARDS OR FOLLOWING GENERAL NOTES MUST BE APPROVED BY THE CITY ENGINEER.
2. ALL EXISTING IMPROVEMENTS INCLUDING CURB AND GUTTERS, SIDEWALKS, ASPHALT/CONCRETE OR P.C.C. PAVING, WHICH ARE BEING JOINED OR MATCHED SHALL BE DONE TO THE SATISFACTION OF THE CITY ENGINEER, INCLUDING NECESSARY SAWCUTTING, REMOVAL, REPLACEMENT AND CAPPING.
3. ANY EXISTING TRAVELWAYS IN WHICH AN EXCAVATION IS MADE IN CONJUNCTION WITH THIS PROJECT SHALL BE COVERED BY AN ENCROACHMENT PERMIT. THIS AREA SHALL BE PROPERLY POSTED AND LIGHTED IN CONFORMANCE WITH THE STATE MANUAL OF WARNING SIGNS, LIGHTS, AND DEVICES FOR USE IN PERFORMANCE OF WORK UPON HIGHWAYS IN ORDER TO ELIMINATE ANY HAZARDS. STREET SHALL BE SURFACED WITH A MINIMUM OF 2" OF ASPHALT AT THE END OF EACH WORKING DAY.
4. THE CONTRACTOR SHALL OBTAIN ALL NECESSARY PERMITS AND SHALL NOTIFY THE CITY FIELD INSPECTORS (951-270-5680) AT LEAST 48 HOURS PRIOR TO STARTING EACH PHASE OF CONSTRUCTION AND PRIOR TO REQUIRING INSPECTION.
5. ALL UTILITIES SHALL BE INSTALLED PRIOR TO PAVING OF THE STREETS. ALL TRENCHES SHALL BE FULLY COMPACTED TO THE SATISFACTION OF THE CITY ENGINEER. ALL MANHOLES AND VALVE BOX FRAMES SHALL BE ADJUSTED TO FINISHED GRADES AFTER COMPLETION OF CONSTRUCTION.
6. THE CONTRACTOR SHALL DETERMINE THE TRUE LOCATION OF ANY UNDERGROUND UTILITY PRIOR TO LAYING ANY LINES WHICH ARE TO CONNECT THE EXISTING SEWER, WATER, OR STORM DRAINS. THESE LINES SHALL BE EXPOSED AND JOIN ELEVATIONS VERIFIED. ANY CHANGE IN GRADE OR DEVIATION FROM THE PLANS MUST BE APPROVED BY THE CITY ENGINEER.
7. ADVERTISING SIGNS WILL NOT BE PERMITTED WITHIN THE STREET RIGHT-OF-WAY.
8. TREES SHALL BE PLANTED WITHIN THE STREET RIGHT-OF-WAY IN ACCORDANCE WITH THE CITY OF NORCO REQUIREMENTS.
9. STRUCTURAL SECTION OF PAVEMENT SHALL BE DETERMINED BY THE PRIVATE SOILS ENGINEER. THE PRIVATE SOILS ENGINEER SHALL FURNISH THE RESULTS OF R-VALUE TESTS AND STRUCTURAL SECTION CALCULATIONS TO THE CITY ENGINEER FOR APPROVAL.
10. COMPACTION TESTING SHALL BE PERFORMED BY THE SOILS ENGINEER TO THE SATISFACTION OF THE CITY ENGINEER. THE SUBGRADE SHALL BE COMPACTED TO 90% WITH THE TOP ONE FOOT BELOW THE ASPHALT PAVING COMPACTED TO 95%. IF THE AGGREGATE BASE IS THICKER THAN ONE FOOT, THE ENTIRE THICKNESS OF THE BASE MATERIAL SHALL BE COMPACTED TO 95%.
11. SEWER MAIN AND LATERALS SHALL BE CONSTRUCTED, BACKFILL COMPACTED, AND TESTED PRIOR TO CONSTRUCTION OF CURB AND GUTTER.
12. THE CURB AND GUTTER SHALL BE "ETCHED" SHOWING LATERAL LOCATIONS "S" FOR SEWER, "G" FOR GAS, "E" FOR ELECTRICAL AND "W" FOR WATER.
13. TRAFFIC CONTROL AND SAFETY DEVICES SHALL BE PLACED AND MAINTAINED PER THE STATE OF CALIFORNIA DEPARTMENT OF TRANSPORTATION, MANUAL OF WARNING SIGNS LIGHTS, AND DEVICES FOR USE IN PERFORMANCE OF WORK UPON HIGHWAYS AND TO THE SATISFACTION OF THE CITY ENGINEER.

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:
						12/15/04
						APPROVED: <i>Joseph S. Schenk</i> 24039 CITY ENGINEER RCE
Drawn By: LJA			Date: 03/19/04			
<b>GENERAL NOTES (STREET)</b>						Std. Dwg. No. <b>013</b> Sheet 1 of 3

# CITY of NORCO STANDARD DRAWING

14. NOTICE TO CONTRACTORS: THE EXISTENCE AND LOCATION OF ANY UNDERGROUND UTILITY PIPES OR STRUCTURES SHOWN ON THESE PLANS ARE OBTAINED BY A SEARCH OF THE AVAILABLE RECORDS. APPROVAL OF THESE PLANS BY THE CITY OF NORCO DOES NOT CONSTITUTE A REPRESENTATION AS TO THE ACCURACY OR COMPLETENESS OF THE LOCATION OR EXISTENCE OR NON-EXISTENCE OF ANY UNDERGROUND UTILITY PIPE OR STRUCTURE WITHIN THE LIMITS OF THIS PROJECT. THE CONTRACTOR IS REQUIRED TO TAKE ALL DUE PRECAUTIONARY MEANS TO PROTECT THE UTILITY LINES NOT OF RECORD OR NOT SHOWN ON THESE PLANS.
15. PRIVATE ENGINEER'S NOTICE: PRIOR TO CONSTRUCTION, SEWER AND WATER CONTRACTORS SHALL ASCERTAIN THE CORRECTNESS OF WATER SERVICES AND SEWER LATERAL LOCATIONS WITH THE DEVELOPER. ANY DEVIATION FROM LOCATIONS SHOWN ON THESE PLANS SHALL BE REPORTED TO THE ENGINEER FOR ADJUSTMENT PRIOR TO CALLING FOR ANY CONSTRUCTION STAKING REQUIRED.
16. PRIOR TO THE CITY RELEASING THE BOND FOR THE PUBLIC IMPROVEMENTS, THE ENGINEER OF RECORD SHALL SUBMIT A COMPLETE SET OF "AS BUILT" PLANS ON MYLAR TO THE CITY ENGINEER. THE TIE SHEETS FOR NECESSARY MONUMENTATION SHALL BE SUBMITTED TO THE CITY.
17. STATE LAW (SB 3019) REQUIRES THE CONTRACTOR TO CONTACT UNDERGROUND SERVICE ALERT AND OBTAIN AN IDENTIFICATION NUMBER PRIOR TO THE ISSUANCE OF THE CITY'S ENCROACHMENT PERMIT. THE CONTRACTOR SHALL NOTIFY UNDERGROUND SERVICE ALERT TWO FULL WORKING DAYS (48 HOURS MINIMUM) IN ADVANCE OF ANY CONSTRUCTION ACTIVITIES, INCLUDING PAVEMENT REMOVAL, EXCAVATION AND A.C. OVERLAY, WHICH COULD AFFECT ANY UNDERGROUND UTILITY.
18. PRIOR TO ANY CONSTRUCTION WORK, THE CONTRACTOR SHALL OBTAIN A CITY BUSINESS LICENSE AND AN ENCROACHMENT PERMIT.
19. PRIOR TO TAKING ANY WATER FROM A FIRE HYDRANT, THE CONTRACTOR SHALL MAKE ARRANGEMENTS TO OBTAIN A FIRE HYDRANT WATER METER.
20. ALL STREET TRENCHING, BACKFILLING AND PAVEMENT REPAIRS SHALL BE DONE IN ACCORDANCE WITH CITY STANDARD DRAWING NO. 155.
21. ALL IRRIGATION LINES TO BE REMOVED, RELOCATED OR RECONSTRUCTED AS SHOWN AND/OR AS DIRECTED BY THE PUBLIC WORKS INSPECTOR IN THE FIELD.
22. CONTRACTOR SHALL REMOVE AND/OR INSTALL PAVEMENT MARKINGS AND STRIPING. PLACEMENT AND SCHEDULING TO BE DETERMINED BY INSPECTOR IN THE FIELD.
23. THE CONTRACTOR SHALL NOT ORDER OR PLACE ANY PORTLAND CEMENT CONCRETE OR ASPHALT CONCRETE PAVING UNTIL THE FORMS AND SUBGRADE AND/OR AGGREGATE BASE HAVE BEEN INSPECTED AND APPROVED BY THE PUBLIC WORKS INSPECTOR IN THE FIELD.
24. STRICT ADHERENCE TO DUST CONTROL REQUIREMENTS SHALL BE ENFORCED, AND ALL DUST SHALL BE CONTROLLED BY WATERING, UNLESS OTHERWISE APPROVED BY THE CITY ENGINEER.
25. IF ANY EXISTING UTILITIES OR ANY OTHER FACILITIES CONFLICT WITH THE PROPOSED IMPROVEMENTS, WORK SHALL STOP AND THE ENGINEER SHALL BE NOTIFIED IMMEDIATELY.
26. THE FINAL OR SURFACE LAYER OF ASPHALT CONCRETE SHALL NOT BE PLACED UNTIL ALL ON-SITE IMPROVEMENTS HAVE BEEN COMPLETED, INCLUDING ALL GRADING AND UNTIL ALL UNACCEPTABLE CONCRETE AND/OR ASPHALT WORK HAS BEEN REMOVED AND REPLACED, UNLESS OTHERWISE APPROVED BY THE ENGINEER.
27. ALL PERMANENT TRAFFIC CONTROL SIGNS AND DEVICES SHALL BE LOCATED AS SPECIFIED IN THE FIELD BY THE CITY ENGINEER PRIOR TO FINAL APPROVAL OF IMPROVEMENTS.
28. REPAIR OR REPLACE ANY DAMAGED OR ALTERED EXISTING IMPROVEMENTS WITHIN PUBLIC RIGHT-OF-WAY AS DIRECTED BY THE ENGINEER IN THE FIELD.

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:

Drawn By: LJA

Date: 03/19/04

12/15/04

APPROVED: *Joseph S. Schenk* 24039  
CITY ENGINEER RCE

## GENERAL NOTES (STREET)

Std. Dwg. No.  
**013**  
Sheet 2 of 3

# CITY of NORCO STANDARD DRAWING

- 29. ALL SURVEY MONUMENTS SHALL BE PROTECTED AND PERPETUATED IN PLACE. ANY DISTURBED OR COVERED MONUMENTS SHALL BE RESET BY A QUALIFIED REGISTERED CIVIL ENGINEER OR A LICENSED LAND SURVEYOR.
  
- 30. ANY CONTRACTOR PERFORMING WORK ON THIS PROJECT SHALL FAMILIARIZE THEMSELVES WITH THE WORK SITE AND SHALL BE SOLELY RESPONSIBLE FOR ANY DAMAGE TO EXISTING FACILITIES RESULTING DIRECTLY OR INDIRECTLY FROM THEIR OPERATIONS, WHETHER OR NOT SUCH FACILITIES ARE SHOWN ON THESE PLANS.
  
- 31. CARE SHOULD BE TAKEN TO PREVENT GRADED DITCHES AND SWALES FROM UNDERMINING STREET IMPROVEMENTS. UPON INSPECTION OF THE SITES, THE CITY ENGINEER MAY REQUIRE TEMPORARY GUNITE SWALES, ENTERING OR LEAVING IMPROVEMENTS.
  
- 32. APPROVAL OF THESE PLANS BY THE CITY OR ITS AGENTS DOES NOT RELIEVE THE ENGINEER AND THE APPLICANT FROM THE RESPONSIBILITY FOR THE CORRECTION OF ERRORS OR OMISSIONS DISCOVERED DURING CONSTRUCTION. UPON REQUEST, THE APPROPRIATE PLAN REVISIONS SHALL BE PROMPTLY SUBMITTED TO THE CITY ENGINEER FOR REVIEW AND APPROVAL.

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:
						12/15/04

Drawn By: LJA	Date: 03/19/04	APPROVED: <i>Joseph J. Schenk</i> 24039 CITY ENGINEER RCE
---------------	----------------	--

<h2 style="margin: 0;">GENERAL NOTES (STREET)</h2>	Std. Dwg. No. <b>013</b> Sheet 3 of 3
--	---

# CITY of NORCO STANDARD DRAWING

## General Notes: (Water)

1. ALL WORK SHALL BE IN ACCORDANCE WITH THESE PLANS, THE CITY OF NORCO STANDARD DRAWINGS, STANDARD SPECIAL PROVISIONS, AND THE LATEST EDITION OF STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION, WITH SUPPLEMENTS. ANY VARIATION FROM OR EXCEPTING TO THE STANDARDS OR FOLLOWING GENERAL NOTES MUST BE APPROVED BY THE CITY ENGINEER.
2. THIS DRAWING AND DATA HEREIN ARE MADE PART OF THE SPECIFICATIONS.
3. BEFORE WORK MAY BE STARTED, THE CONTRACTOR MUST OBTAIN AN ENCROACHMENT PERMIT FROM THE PUBLIC WORKS DEPARTMENT TO EXCAVATE IN THE CITY OF NORCO.
4. INSPECTION SHALL BE CALLED FOR THROUGH THE CITY OF NORCO ENGINEERING DEPARTMENT (951) 270-5680, 48 HOURS PRIOR TO START OF CONSTRUCTION AND 24 HOURS PRIOR TO ANY REQUIRED INSPECTION.
5. ALL CONNECTIONS TO THE WATER MAINS SHALL BE MADE BY THE CONTRACTOR UNDER THE SUPERVISION OF THE DIRECTOR OF PUBLIC WORKS OR PUBLIC WORKS CONSTRUCTION INSPECTOR OF THE CITY OF NORCO.
6. THE CONTRACTOR SHALL MAKE ARRANGEMENTS WITH THE DIRECTOR OF PUBLIC WORKS FOR WATER SHUT-OFF AND SHALL NOT OPERATE ANY MAINLINE WATER VALVES.
7. WATER SERVICES TO BE A MINIMUM OF 10' HORIZONTAL DISTANCE FROM SEWER LATERALS.
8. ALL VALVE BOXES SHALL BE RAISED AND LEVELED BY CONTRACTOR. 8" VALVES AND BELOW REQUIRE 6" VALVE CANS, 10" VALVES & ABOVE REQUIRE 8" VALVE CANS AND CAPS.
9. FIRE HYDRANT STANDARDS: COMMERCIAL: JAMES JONES MODEL J- 3765 TO BE INSTALLED PER CITY OF NORCO STANDARD NO. 445; RESIDENTIAL: JAMES JONES MODEL J-3710.
10. WATER METER BOXES SHALL BE BROUGHT TO GRADE AND LEVELED. BEFORE THE CITY WILL INSTALL ANY WATER METERS, ALL BOXES SHALL BE LOCATED DIRECTLY BEHIND CURB FACE. 1" SERVICES REQUIRE A H&C #438 METER BOX. 2" SERVICES REQUIRE A H&C 666B METER BOX.
11. 4" AND SMALLER WATER VALVES SHALL BE RESILIENT SEAT WEDGE VALVES EPOXY COATED AND AWWA APPROVED. 6" AND LARGER SHALL BE RESILIENT TYPE BUTTERFLY VALVES EPOXY COATED AND AWWA APPROVED.
12. ALL MUNICIPAL WATER MAIN PIPE SHALL BE 10 GAGE STEEL CEMENT MORTAR LINED AND COATED (CML&C).

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:

Drawn By: LJA

Date: 03/19/04

12/15/04

APPROVED: *Joseph S. Schenk* 24039

CITY ENGINEER RCE

## GENERAL NOTES (WATER)

Std. Dwg. No.

014

Sheet 1 of 2

# CITY of NORCO STANDARD DRAWING

13. FITTINGS SHALL BE STEEL FLANGED MORTAR LINED (NO CAST IRON).
14. ALL PIPE TO BE LAID ON 4" BED OF CLEAN SAND. ALL PIPE TO BE SHADED WITH CLEAN COLORED SAND TO A DEPTH OF 12" OVER PIPE. SAND BEDDING SHALL BE PER CITY OF NORCO STANDARD PLANS AND SPECIFICATIONS, COLOR TO BE APPROVED BY THE FIELD INSPECTOR.
15. WATER MAINS IN PUBLIC RIGHT-OF-WAY SHALL BE CONSTRUCTED WITH A MINIMUM COVER OF 36 INCHES BELOW FINISHED STREET SURFACE; AND GRADE SHALL BE STRAIGHT, UNLESS OTHERWISE INDICATED IN PLAN OR PROFILE VIEW.
16. PRESSURE TESTING AND CHLORINATION SHALL BE PERFORMED IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION (LATEST EDITION). PRESSURE TESTS SHALL BE PERFORMED AFTER COMPACTION IS ACHIEVED AND ACCEPTED.
17. A "W" SHALL BE STAMPED ON THE CURB FACE AT ALL LATERAL LOCATIONS.
18. STATE LAW (SB3019) REQUIRES THE CONTRACTOR TO CONTACT UNDERGROUND SERVICE ALERT (USA) AND OBTAIN AN IDENTIFICATION NUMBER PRIOR TO THE ISSUANCE OF THE CITY'S ENCROACHMENT PERMIT. THE CONTRACTOR SHALL NOTIFY USA TWO FULL WORKING DAYS (48 HOURS MINIMUM) IN ADVANCE OF ANY CONSTRUCTION ACTIVITIES.
19. CONTRACTOR IS RESPONSIBLE FOR LOCATING AND IDENTIFYING ALL UNDERGROUND LINES AND SUBSTRUCTURES, OF EVERY NATURE, AND TO PROTECT THEM FROM DAMAGE.
20. THE ENGINEER OF RECORD SHALL FURNISH A COMPLETE SET OF "AS BUILT" PLANS ON MYLAR TO THE CITY ENGINEER AT THE COMPLETION OF THE WATER WORK AND PRIOR TO PAVING OF STREETS, SHOWING LOCATION OF SERVICES.
21. ALL FIRE HYDRANTS WHICH HAVE NOT BEEN ACCEPTED FOR SERVICE SHALL BE COVERED WITH A SACK INDICATING THAT THE HYDRANTS ARE NOT IN SERVICE.
22. APPROVAL OF THESE PLANS BY THE CITY OR ITS AGENTS DOES NOT RELIEVE THE ENGINEER AND THE APPLICANT FROM THE RESPONSIBILITY FOR THE CORRECTION OF ERRORS OR OMISSIONS DISCOVERED DURING CONSTRUCTION. UPON REQUEST, THE APPROPRIATE PLAN REVISIONS SHALL BE PROMPTLY SUBMITTED TO THE CITY ENGINEER FOR REVIEW AND APPROVAL.
23. ALL WATER APPURTENANCES WITHIN THE LIMITS OF THE PROJECT SHALL BE ABANDONED, RELOCATED, AND/OR UPGRADED PER THE DIRECTION OF THE PUBLIC WORKS INSPECTOR, PER CITY OF NORCO STANDARDS, REGARDLESS IF SHOWN ON PLANS OR NOT.
24. ALL NEW WATERLINES SHALL BE VIDEOTAPED, WITH TAPE SUPPLIED TO THE CITY ENGINEER, PRIOR TO CITY'S ACCEPTANCE OF ANY NEW WATERLINE.

DESIGN NOTE:

FOR ALL NEW STREET CONSTRUCTION, THE LOCATION OF WATER MAINS SHALL BE 6' NORTH OR WEST OF STREET CENTERLINE AND MUST BE A MINIMUM OF TEN (10) FEET APART FROM SEWER.

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:	12/15/04  APPROVED: <i>Joseph S. Schenk</i> 24039 CITY ENGINEER RCE
Drawn By: LJA			Date: 03/19/04				

## GENERAL NOTES (WATER)


Std. Dwg. No.  
**014**  
Sheet 2 of 2


**50**

**DRAFTING  
STANDARDS**



# CITY of NORCO STANDARD DRAWING

-  DIMENSION LINE OR EXTENSION LINE
-  CENTER LINE
-  CURB AND GUTTER
-  RAILROAD TRACK
- R/W, P  RIGHT-OF-WAY, PROPERTY LINE
-  BOUNDARY LINE (IMPROVEMENT JOIN LIMIT)
-  FLOW LINE
-  FENCE (LABEL TYPE)
-  UTILITY LINE (\*=LISTED BELOW)
  - E = ELECTRICAL      SD = STORM DRAIN
  - G = GAS                T = TELEPHONE
  - I = IRRIGATION      TV = TELEVISION CABLE
  - O = OIL                W = WATER
  - S = SEWER            X = INDUSTRIAL WASTE
-  HIDDEN LINE (EXISTING IMPROVEMENTS)
-  OBJECT LINE (PROJECT IMPROVEMENTS)
-  EDGE OF PAVEMENT (HATCH MARKS ON PAVEMENT SIDE)
-  CONCRETE
-  PAVEMENT TO BE OVERLAID
-  REMOVE IMPROVEMENTS (GHOSTED)
-  A.C. PAVEMENT (GHOSTED)
-  BUILDING
-  SHRUB
-  TREE (SHOW TRUNK DIAMETER)
-  PALM TREE

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:	APPROVED:  24039 CITY ENGINEER RCE
Drawn By: LJA			Date: 3/19/04				

## DRAFTING STANDARDS AND TOPOGRAPHIC SYMBOLS

Std. Dwg. No.  
**50A**  
Sheet 1 of 1

# CITY of NORCO STANDARD DRAWING

	MONUMENT
	BENCH MARK
	TEST BORING
	MANHOLES
	TERMINAL CLEANOUTS; PROPOSED, EXISTING
	TOPOGRAPHIC VALVE SYMBOLS; GENERAL (LABEL TYPE), BLOW-OFF
	DRAFTING VALVE SYMBOLS; GENERAL (LABEL TYPE), GATE, BALL, CHECK, 3-WAY DIVERTER
	REDUCERS (LABEL SIZE); EXISTING CONCENTRIC, PROPOSED ECCENTRIC (SHOW C OFFSET)
	FLANGE CONNECTION
	REMOVABLE SPOOL OR FILTER
	THRUST BLOCKS; PROPOSED, EXISTING
	CITY ELECTROLIER - 75-150 WATTS
	UTILITY POLE & GUY ANCHOR (LABEL POLE NUMBER)
	WATER METER, GAS METER
	PULL BOXES; PROPOSED, EXISTING
	TRAFFIC SIGNAL DETECTOR
	TRAFFIC SIGN
	TRAFFIC SIGNAL
	TRAFFIC SIGNAL CONTROLLER
	FIRE HYDRANTS; PROPOSED, EXISTING
	FIXTURES; SPRINKLER HEAD, HOSE BIB

<b>REVISION</b>	NO:	BY:	DATE:	NO:	BY:	DATE:	APPROVED:  24039 CITY ENGINEER RCE
Drawn By: LJA			Date: 03/19/04				


## DRAFTING STANDARDS AND TOPOGRAPHIC SYMBOLS

Std. Dwg. No.  
**50B**  
Sheet 1 of 1

**100**  
**STREET**  
**STANDARDS**



# CITY of NORCO STANDARD DRAWING

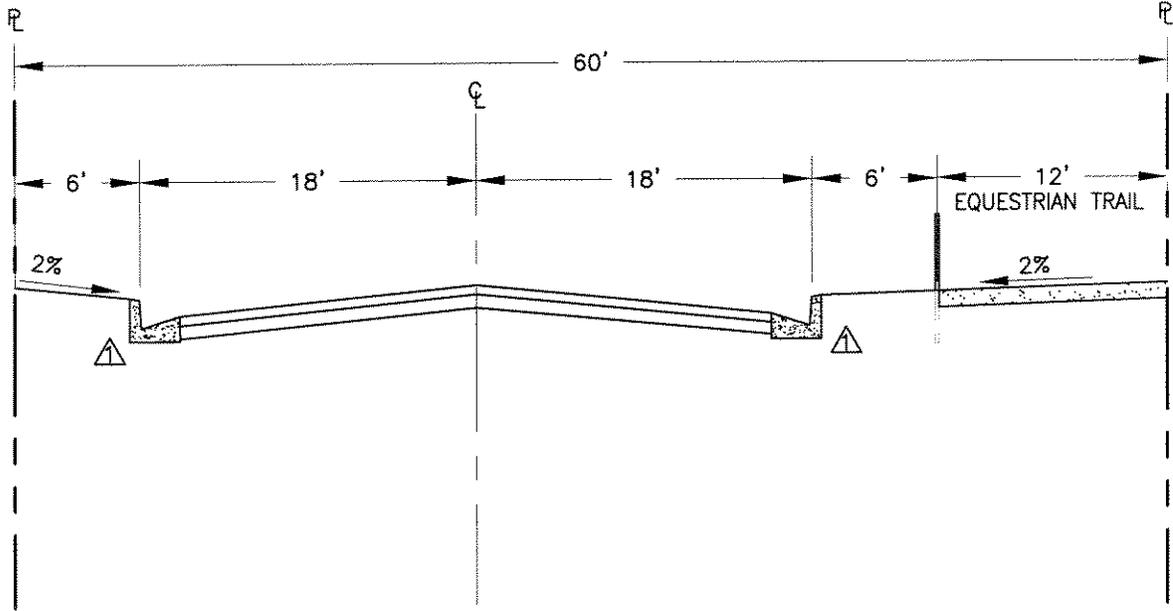

**NOTES:**


1. STRUCTURAL SECTION OF ROADWAY SHALL BE DETERMINED FROM SOILS TESTS AND SO INDICATED ON CONSTRUCTION PLANS, BUT IN NO CASE LESS THAN WHAT IS DESIGNATED ON STD. DWG. 830.
2. TYPICAL SLOPE STANDARDS MAY REQUIRE SLOPE EASEMENTS.
3. CENTERLINE GRADES ARE 0.40% MIN. FOR EAST-WEST AND 0.60% OR GREATER FOR NORTH-SOUTH.
4. CURB RETURN RADIUS SHALL BE 25 FEET.

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:
▲		LJA	02/07/06			
Drawn By: LJA <span style="margin-left: 200px;">Date: 03/19/04</span>						
						APPROVED: <i>[Signature]</i> CITY ENGINEER 27172 RCE

## TYPICAL STREET SECTION (W=60')

Std. Dwg. No.  
**100**  
Sheet 1 of 1

# CITY of NORCO STANDARD DRAWING

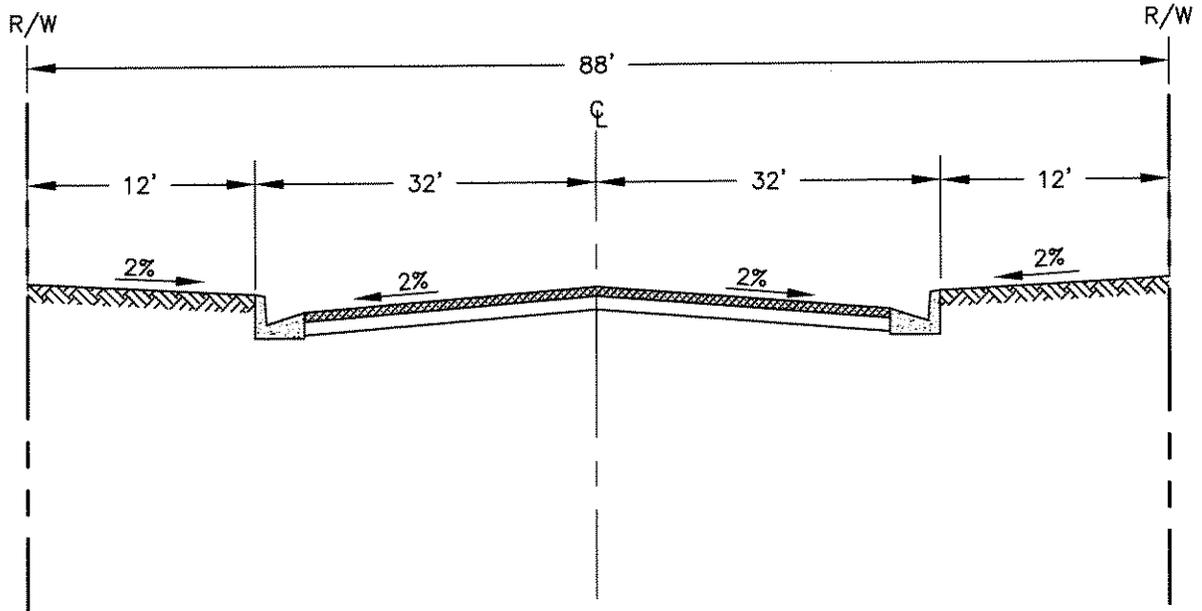

**NOTES:**

1. STRUCTURAL SECTION OF ROADWAY SHALL BE DETERMINED FROM SOILS TESTS AND SO INDICATED ON CONSTRUCTION PLANS, BUT IN NO CASE LESS THAN WHAT IS DESIGNATED ON STD. DWG. 830.
2. TYPICAL SLOPE STANDARDS MAY REQUIRE SLOPE EASEMENTS.
3. CENTERLINE GRADES ARE 0.40% MIN. FOR EAST-WEST AND 0.60% OR GREATER FOR NORTH-SOUTH.
4. CURB RETURN RADIUS SHALL BE 35 FEET.

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:


Drawn By: LJA
Date: 03/19/04

APPROVED: *Joseph Schenk* 24039  
CITY ENGINEER RCE

## TYPICAL STREET SECTION (W=88')

Std. Dwg. No.  
**110**  
Sheet 1 of 1

# CITY of NORCO STANDARD DRAWING

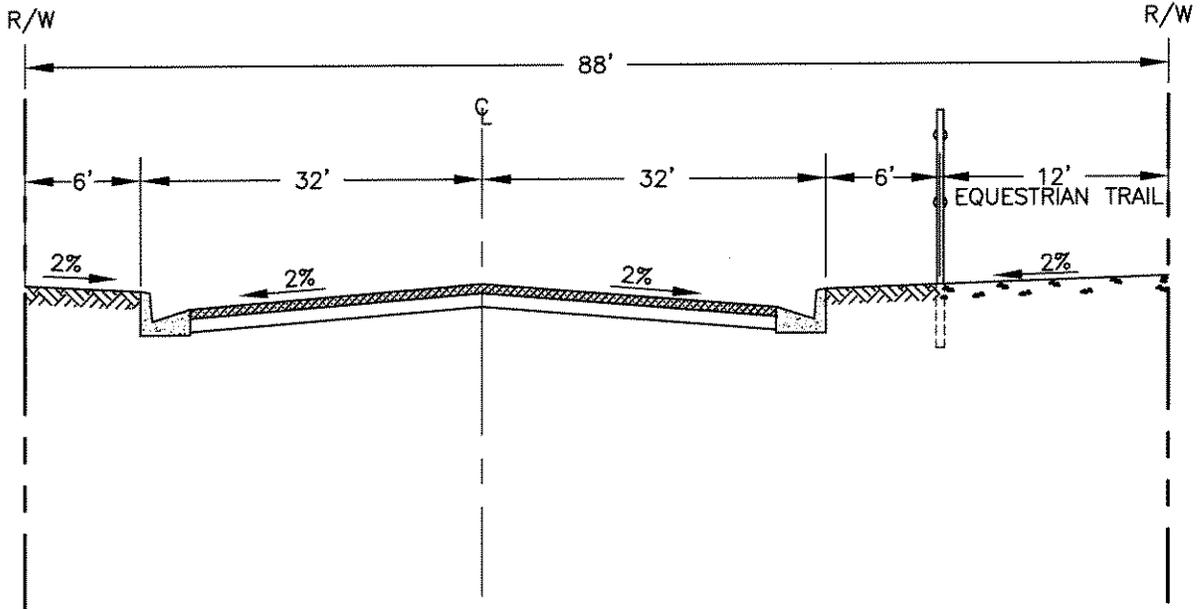

**NOTES:**

1. STRUCTURAL SECTION OF ROADWAY SHALL BE DETERMINED FROM SOILS TESTS AND SO INDICATED ON CONSTRUCTION PLANS, BUT IN NO CASE LESS THAN WHAT IS DESIGNATED ON STD. DWG. 830.
2. TYPICAL SLOPE STANDARDS MAY REQUIRE SLOPE EASEMENTS.
3. CENTERLINE GRADES ARE 0.40% MIN. FOR EAST-WEST AND 0.60% OR GREATER FOR NORTH-SOUTH.
4. CURB RETURN RADIUS SHALL BE 35 FEET.

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:


Drawn By: LJA

Date: 03/19/04

APPROVED: *Joseph Schenk* 24039  
CITY ENGINEER RCE

TYPICAL STREET SECTION (W=88') W/EQUESTRIAN TRAIL	Std. Dwg. No. <b>115</b> Sheet 1 of 1
---	---

# CITY of NORCO STANDARD DRAWING

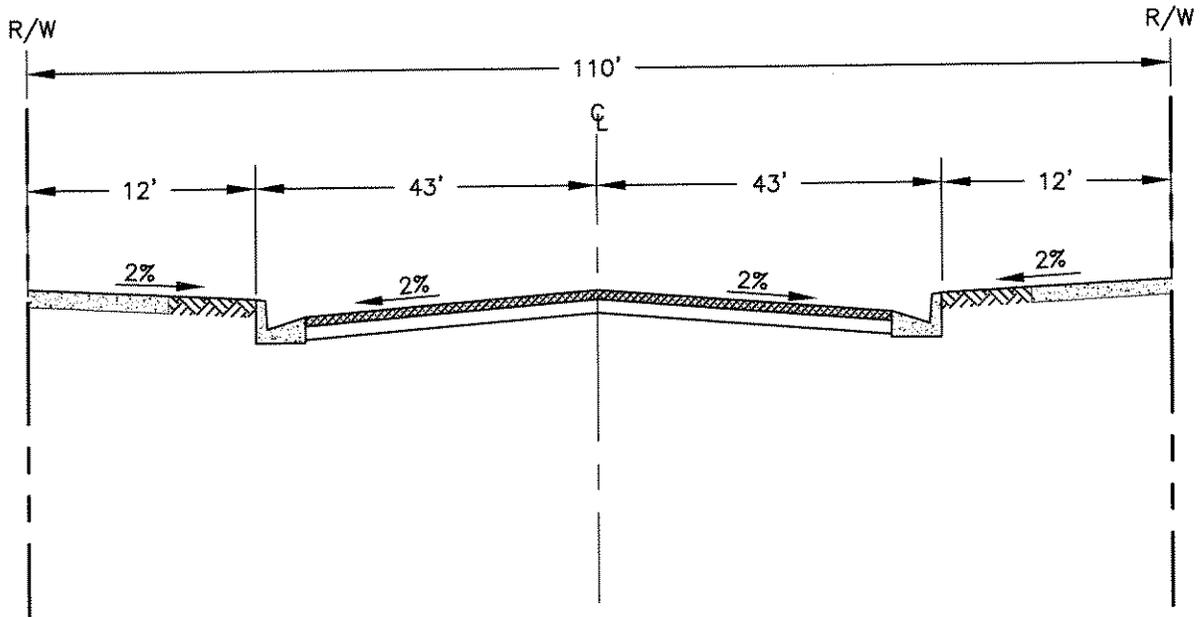

**NOTES:**

1. STRUCTURAL SECTION OF ROADWAY SHALL BE DETERMINED FROM SOILS TESTS AND SO INDICATED ON CONSTRUCTION PLANS, BUT IN NO CASE LESS THAN WHAT IS DESIGNATED ON STD. DWG. 830.
2. TYPICAL SLOPE STANDARDS MAY REQUIRE SLOPE EASEMENTS.
3. CENTERLINE GRADES ARE 0.40% MIN. FOR EAST-WEST AND 0.60% OR GREATER FOR NORTH-SOUTH.
4. CURB RETURN RADIUS SHALL BE 35 FEET.

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:

Drawn By: LJA


Date: 03/19/04

APPROVED: *Joseph Schenk* 24039  
CITY ENGINEER RCE

**TYPICAL STREET SECTION (W=110')**

Std. Dwg. No.  
**120A**  
Sheet 1 of 1

# CITY of NORCO STANDARD DRAWING

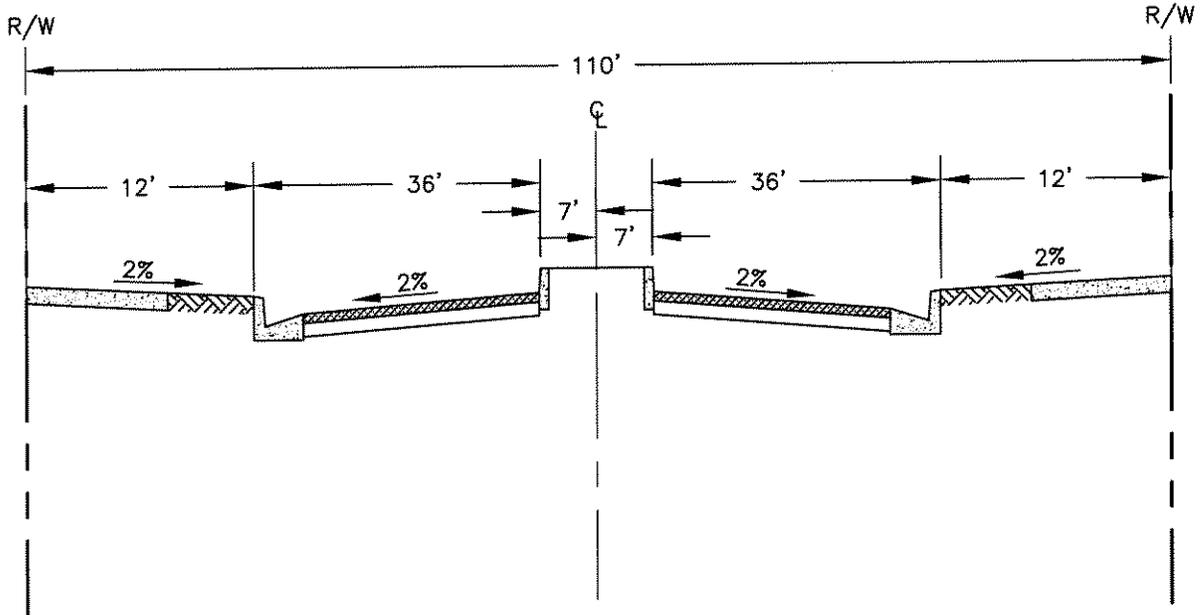

**NOTES:**


1. STRUCTURAL SECTION OF ROADWAY SHALL BE DETERMINED FROM SOILS TESTS AND SO INDICATED ON CONSTRUCTION PLANS, BUT IN NO CASE LESS THAN WHAT IS DESIGNATED ON STD. DWG. 830.
2. TYPICAL SLOPE STANDARDS MAY REQUIRE SLOPE EASEMENTS.
3. CENTERLINE GRADES ARE 0.40% MIN. FOR EAST-WEST AND 0.60% OR GREATER FOR NORTH-SOUTH.
4. CURB RETURN RADIUS SHALL BE 35 FEET.

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:	APPROVED: <i>Joseph Schenk</i> 2/03/05 CITY ENGINEER RCE
Drawn By: LJA				Date: 03/19/04			

**TYPICAL STREET SECTION (W=110') W/RAISED MEDIAN**

Std. Dwg. No.  
**120B**  
Sheet 1 of 1

# CITY of NORCO STANDARD DRAWING

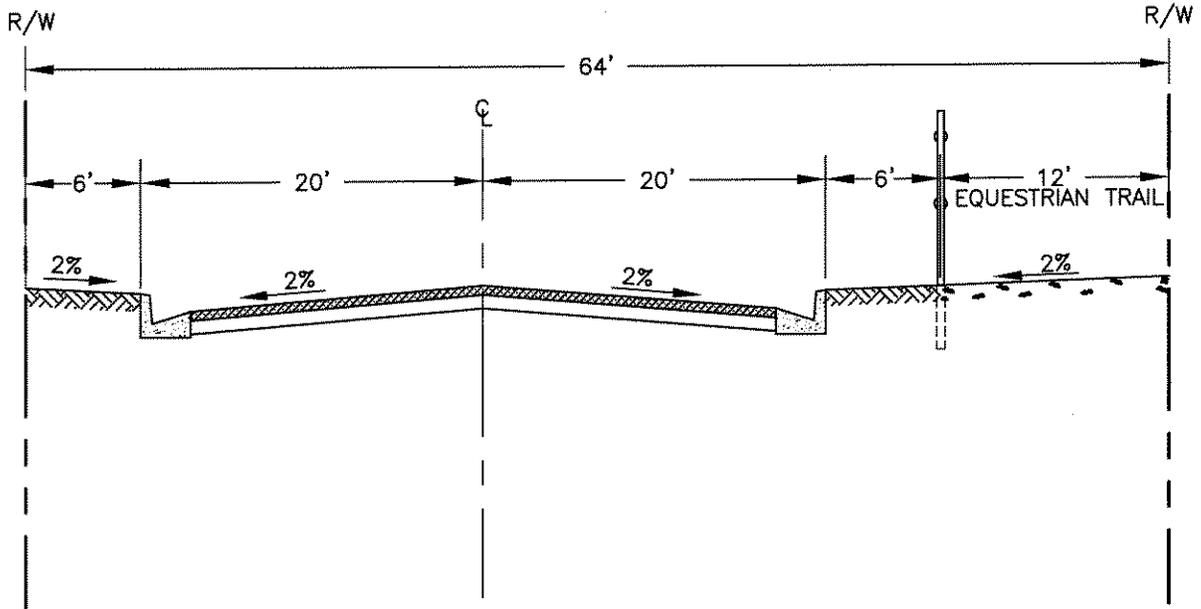

**NOTES:**

1. STRUCTURAL SECTION OF ROADWAY SHALL BE DETERMINED FROM SOILS TESTS AND SO INDICATED ON CONSTRUCTION PLANS BUT IN NO CASE LESS THAN WHAT IS DESIGNATED ON STD. DWG. 830.
2. TYPICAL SLOPE STANDARDS MAY REQUIRE SLOPE EASEMENTS.
3. CENTERLINE GRADES ARE 0.40% MIN. FOR EAST-WEST AND 0.60% OR GREATER FOR NORTH-SOUTH.
4. CURB RETURN RADIUS SHALL BE 25 FEET.

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:


Drawn By: LJA

Date: 03/19/04

APPROVED: *Joseph Schenk* 24039  
CITY ENGINEER RCE

TYPICAL STREET SECTION (W=64') W/EQUESTRIAN TRAIL	Std. Dwg. No. 125 Sheet 1 of 1
---	--------------------------------------

# CITY of NORCO STANDARD DRAWING

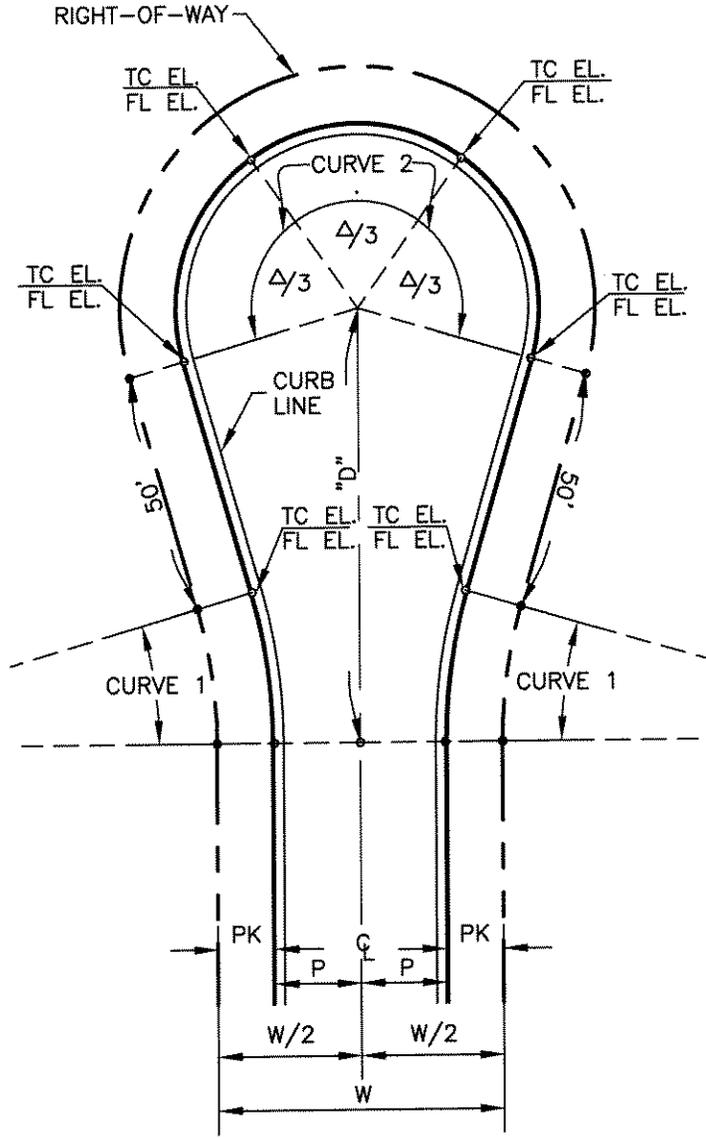

						CURVE 1						CURVE 2						
						CURB			PROPERTY			CURB			PROPERTY			
W	W/2	P	PK	D	△	R	L	T	R	L	T	R	L	T	R	L	T	
60'	30'	18'	12'	90.00'	16'15'37"	112'	31.79'	16.00'	100'	28.38'	14.29'	212'31'13"	38'	140.95'	130.27'	50'	185.46'	171.43'

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:

APPROVED: *Joseph Schenk* 24039  
 CITY ENGINEER RCE

Drawn By: LJA


Date: 03/19/04

## CUL-DE-SAC (SYMMETRICAL)

Std. Dwg. No.  
**140A**  
 Sheet 1 of 1



# CITY of NORCO STANDARD DRAWING

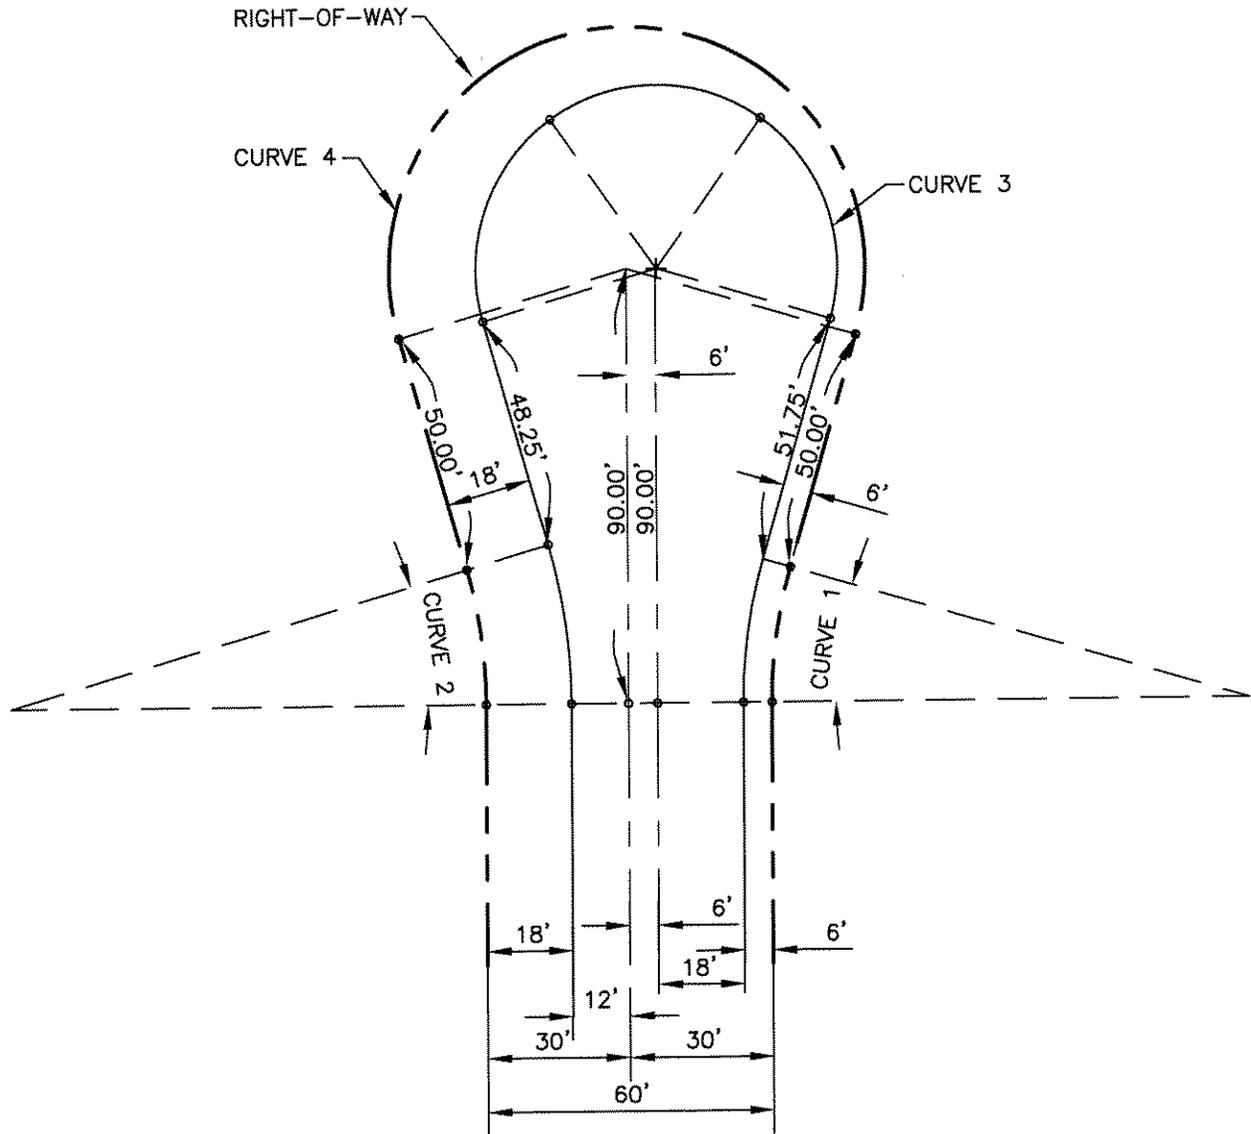

CURVE 3			
△	CURB		
	R	L	T
212°31'13"	38'	140.95'	130.27'

CURVE 4			
△	PROPERTY		
	R	L	T
212°31'13"	50'	185.46'	171.43'

CURVE 1						
△	CURB			PROPERTY		
	R	L	T	R	L	T
16°15'37"	106'	30.08'	15.14'	100'	28.38'	14.29'

CURVE 2						
△	CURB			PROPERTY		
	R	L	T	R	L	T
16°15'37"	118'	33.49'	16.86'	100'	28.38'	14.29'

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:	

APPROVED: *Joseph Schenk* 24039  
 CITY ENGINEER RCE


Drawn By: LJA

Date: 3/19/04

## CUL-DE-SAC (SYMMETRICAL)

Std. Dwg. No.  
**140C**  
 Sheet 1 of 1

# CITY of NORCO STANDARD DRAWING

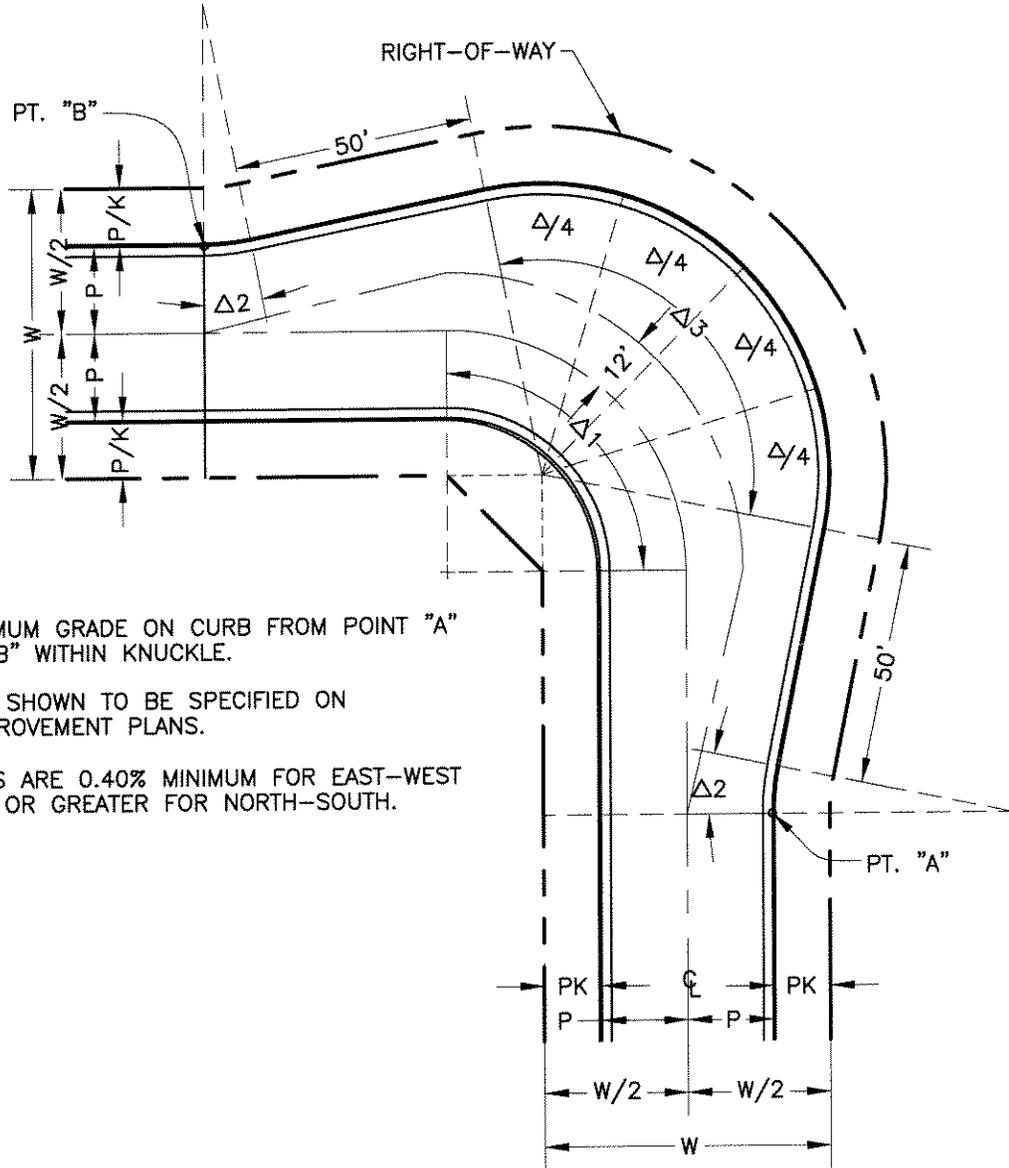

**NOTES:**

- ① 0.60% MINIMUM GRADE ON CURB FROM POINT "A" TO POINT "B" WITHIN KNUCKLE.
- ② ELEVATIONS SHOWN TO BE SPECIFIED ON STREET IMPROVEMENT PLANS.
- ③ C.L. GRADES ARE 0.40% MINIMUM FOR EAST-WEST AND 0.60% OR GREATER FOR NORTH-SOUTH.

				CURVE 1			CURVE 2						CURVE 3								
				△ 1	CURB			△ 2	CURB			PROPERTY			△ 3	CURB			PROPERTY		
W	W/2	P	PK		R	L	T		R	L	T	R	L	T		R	L	T	R	L	T
60'	30'	18'	12'	VARIES	32'	VARIES	VARIES	11'21'25"	50'	9.91'	4.97'	38'	7.53'	3.78'	Δ1+(2 Δ2)	60'	VARIES	VARIES	72'	VARIES	VARIES
60'	30'	20'	10'	VARIES	32'	VARIES	VARIES	9'43'36"	50'	8.49'	4.25'	38'	6.45'	3.23'	Δ1+(2 Δ2)	60'	VARIES	VARIES	72'	VARIES	VARIES

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:


APPROVED: *Joseph J. Schenk* 24039  
CITY ENGINEER RCE

Drawn By: LJA Date: 07/14/04

## INTERSECTION KNUCKLE

Std. Dwg. No.  
**145A**  
Sheet 1 of 1

# CITY of NORCO STANDARD DRAWING

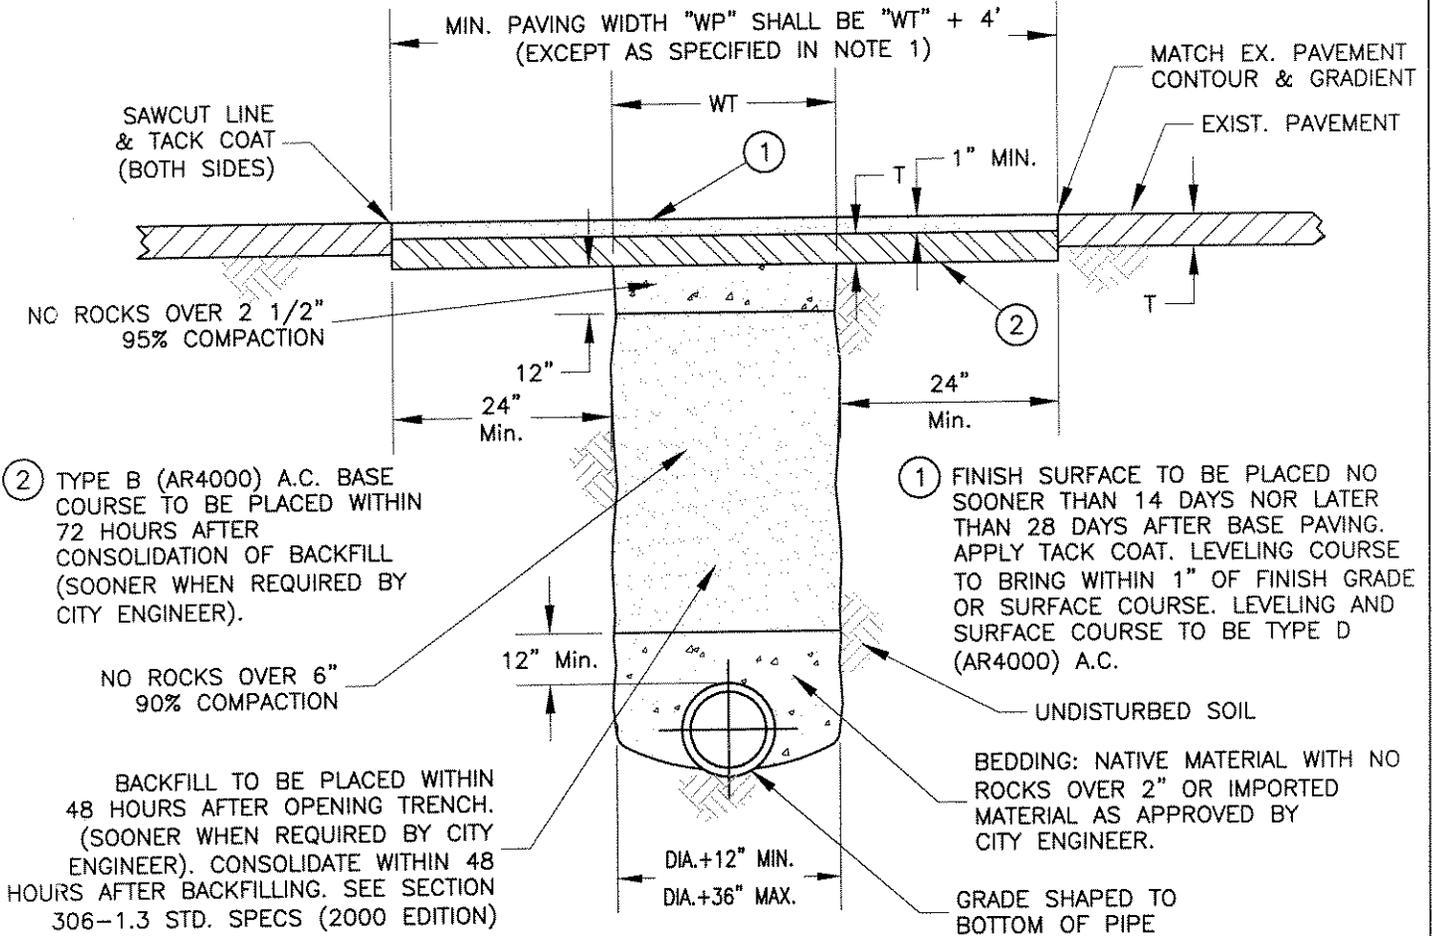

② TYPE B (AR4000) A.C. BASE COURSE TO BE PLACED WITHIN 72 HOURS AFTER CONSOLIDATION OF BACKFILL (SOONER WHEN REQUIRED BY CITY ENGINEER).

① FINISH SURFACE TO BE PLACED NO SOONER THAN 14 DAYS NOR LATER THAN 28 DAYS AFTER BASE PAVING. APPLY TACK COAT. LEVELING COURSE TO BRING WITHIN 1" OF FINISH GRADE OR SURFACE COURSE. LEVELING AND SURFACE COURSE TO BE TYPE D (AR4000) A.C.

BACKFILL TO BE PLACED WITHIN 48 HOURS AFTER OPENING TRENCH. (SOONER WHEN REQUIRED BY CITY ENGINEER). CONSOLIDATE WITHIN 48 HOURS AFTER BACKFILLING. SEE SECTION 306-1.3 STD. SPECS (2000 EDITION)

1. MIN. 10' WIDE A.C. PAVEMENT/OVERLAY LAID WITH PAVING MACHINE SHALL BE REQUIRED FOR ALL TRENCH PATCHES IN EXCESS OF 300 L.F., AS DETERMINED BY THE CITY ENGINEER.
2. SPREADER BOXES MAY BE EMPLOYED FOR TRENCH PAVING JOBS LESS THAN 300 L.F. WHEN APPROVED BY THE CITY ENGINEER.
3. STRUCTURAL SECTION SHALL BE REPLACED IN KIND, EXCEPT ASPHALT PAVEMENT SHALL BE EXISTING PLUS ONE INCH.
4. UNLESS OTHERWISE INSTRUCTED BY THE CITY ENGINEER, TRENCH SHALL BE STRAIGHT GRADE ACROSS WIDTH OF TRENCH AND SHOULD NOT BE CROWNED AT CENTER.
5. ON SIXTH STREET AND HAMNER AVENUE, A.C. BASE COURSE SHALL BE PLACED THE SAME DAY OF EXCAVATION AFTER CONSOLIDATION OF BACKFILL (CLASS II C.A.B. REQUIRED) AND FINISH SURFACE SHALL BE PLACED WITHIN 72 HOURS OF EXCAVATION.
6. CONTRACTOR SHALL GIVE 24 HOUR NOTICE FOR INSPECTION PRIOR TO COMMENCEMENT OF ANY WORK.
7. ALL BACKFILLED TRENCHES SHALL BE PAVED WITH TEMPORARY A.C. PAVEMENT AS DIRECTED IN THE FIELD BY THE CITY INSPECTOR UNTIL PERMANENT PAVEMENT IS CONSTRUCTED.
8. RELATIVE COMPACTION IN SIXTH STREET AND HAMNER AVENUE SHALL BE 90% AND 95% IN THE TOP 12" OF SUBGRADE AND ABOVE.
9. THESE DETAILS ARE APPLICABLE TO BACKFILL AND STREET SURFACE REPLACEMENT FOR THE INSTALLATION OF UNDERGROUND FACILITIES AND ANY OTHER EXCAVATION IN CONJUNCTION WITH THE PLACEMENT OR CONSTRUCTION OF SAID FACILITIES.
10. ANY LANE CLOSURE WITHIN HAMNER AVENUE OR SIXTH STREET SHALL REQUIRE AN ELECTRONIC ARROW BOARD AT MINIMUM, AS A MEANS OF TRAFFIC CONTROL.

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:	APPROVED:  CITY ENGINEER 427172 RCE

Drawn By: LJA

Date: 10/25/05

## STREET PAVEMENT REPAIR


Std. Dwg. No.  
**155**  
Sheet 1 of 1

**200**  
**CURB, GUTTERS**  
**AND DRIVEWAY**  
**STANDARDS**





# CITY of NORCO STANDARD DRAWING

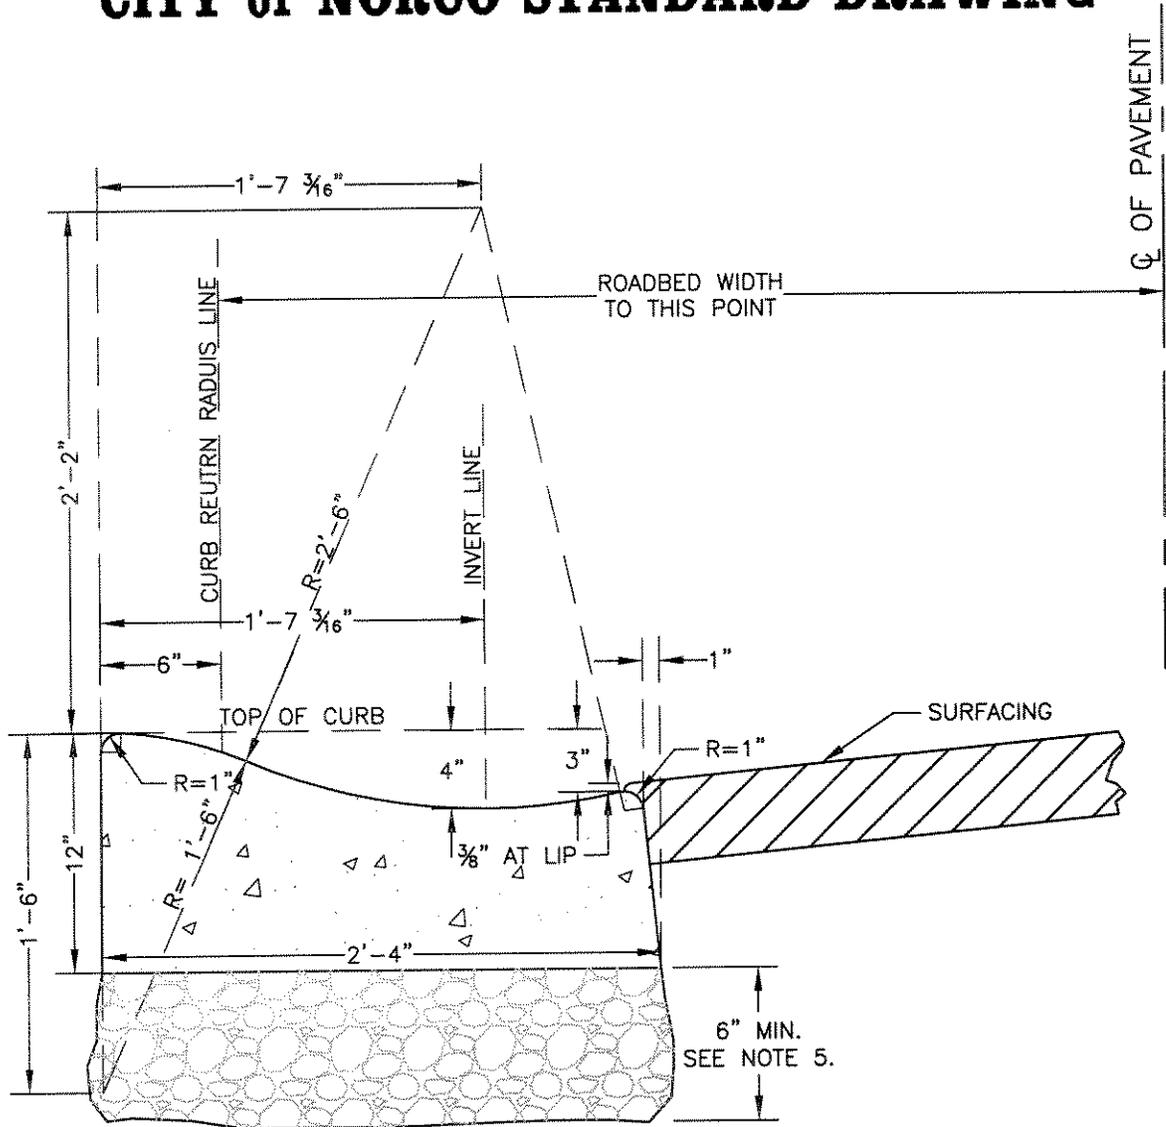



## NOTES

1. CONCRETE SHALL BE PER GREENBOOK, SECTION 201-1, MOST CURRENT EDITION.
2. FINISH SHALL BE FINE BROOM.
3. ALL EXISTING PCC SHALL BE SAWCUT PRIOR TO REMOVAL.
4. CURBS SHALL HAVE EXPANSION PAPER AT 60' INTERVALS, AND WEAKENED PLANE JOINT 15' INTERVALS ONLY; NO SCORE LINES ALLOWED.
5. INSTALL A MINIMUM OF 6" CLASS II BASE MATERIAL FOR EXPANSIVE SOILS.
6. WHEN CURB IS PLACED BY AN EXTRUSION MACHINE, FINISHING SHALL BE DONE TO PROVIDE AN ACCEPTABLE FINISH AND WEAKENED PLANE JOINT MAY BE SAWCUT.

1.789 CU. FT/L.F.  
 CU. YD. = 15.09 L.F.  
 MINIMUM PERMISSIBLE GRADE 0.40%

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:	APPROVED: <i>Joseph Schenk</i> 24039 CITY ENGINEER RCE	
Drawn By: LJA			Date: 01/29/04					
<b>STANDARD ROLLED CURB</b>							Std. Dwg. No. <b>205</b> Sheet 1 of 1	

# CITY of NORCO STANDARD DRAWING

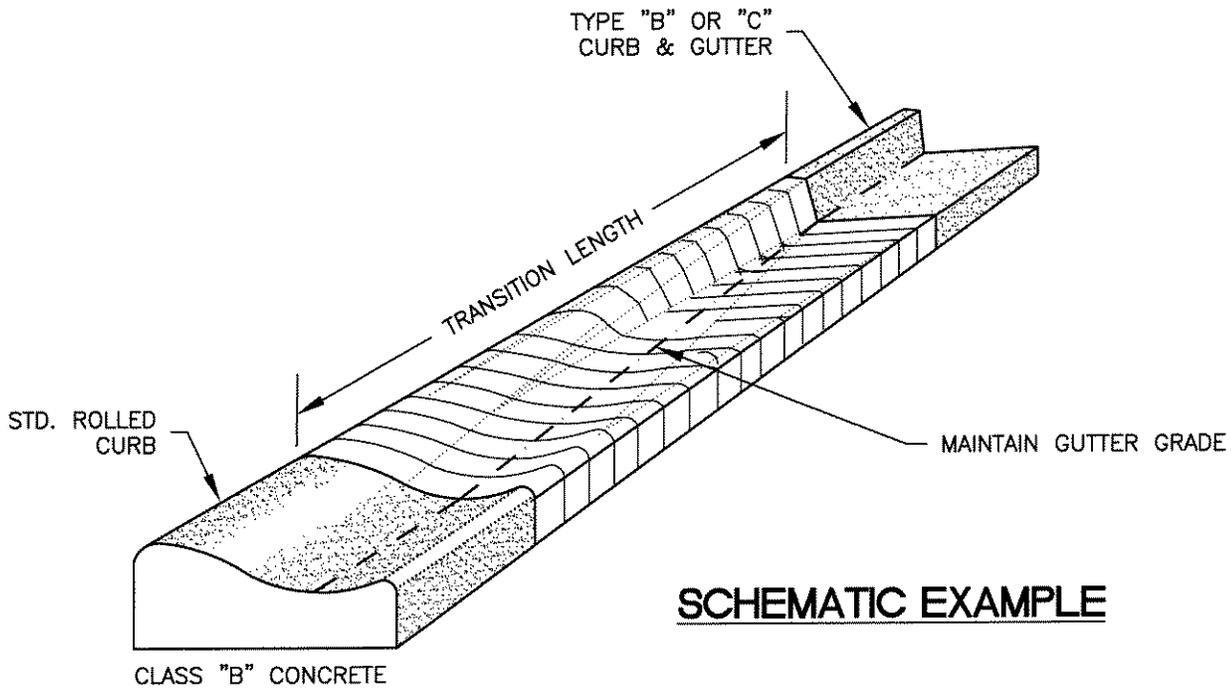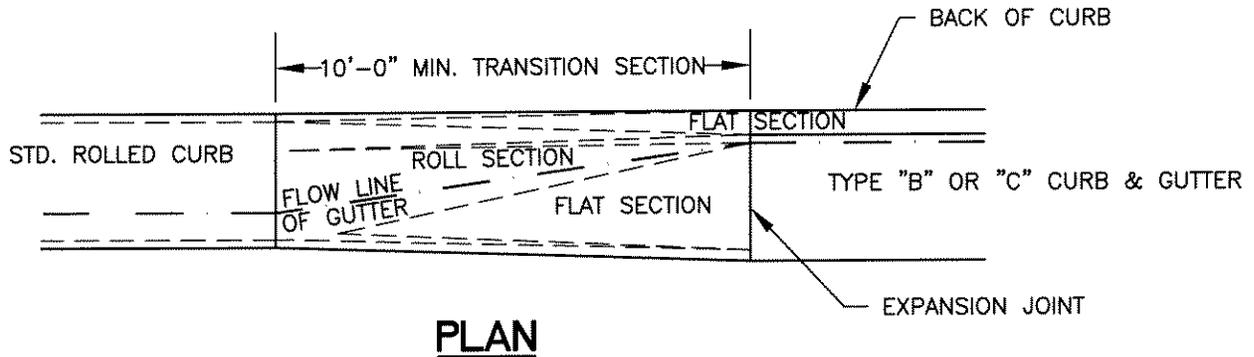

**NOTES**


1. TRANSITION TO BE USED ONLY WHEN STD. 205 HAS BEEN APPROVED FOR USE BY THE CITY ENGINEER PRIOR TO DESIGN.

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:	APPROVED: <i>Joseph Schenk</i> 24039 CITY ENGINEER RCE
Drawn By: LJA			Date: 03/19/04				

## CURB TRANSITION

Std. Dwg. No.  
**215**  
Sheet 1 of 1

# CITY of NORCO STANDARD DRAWING

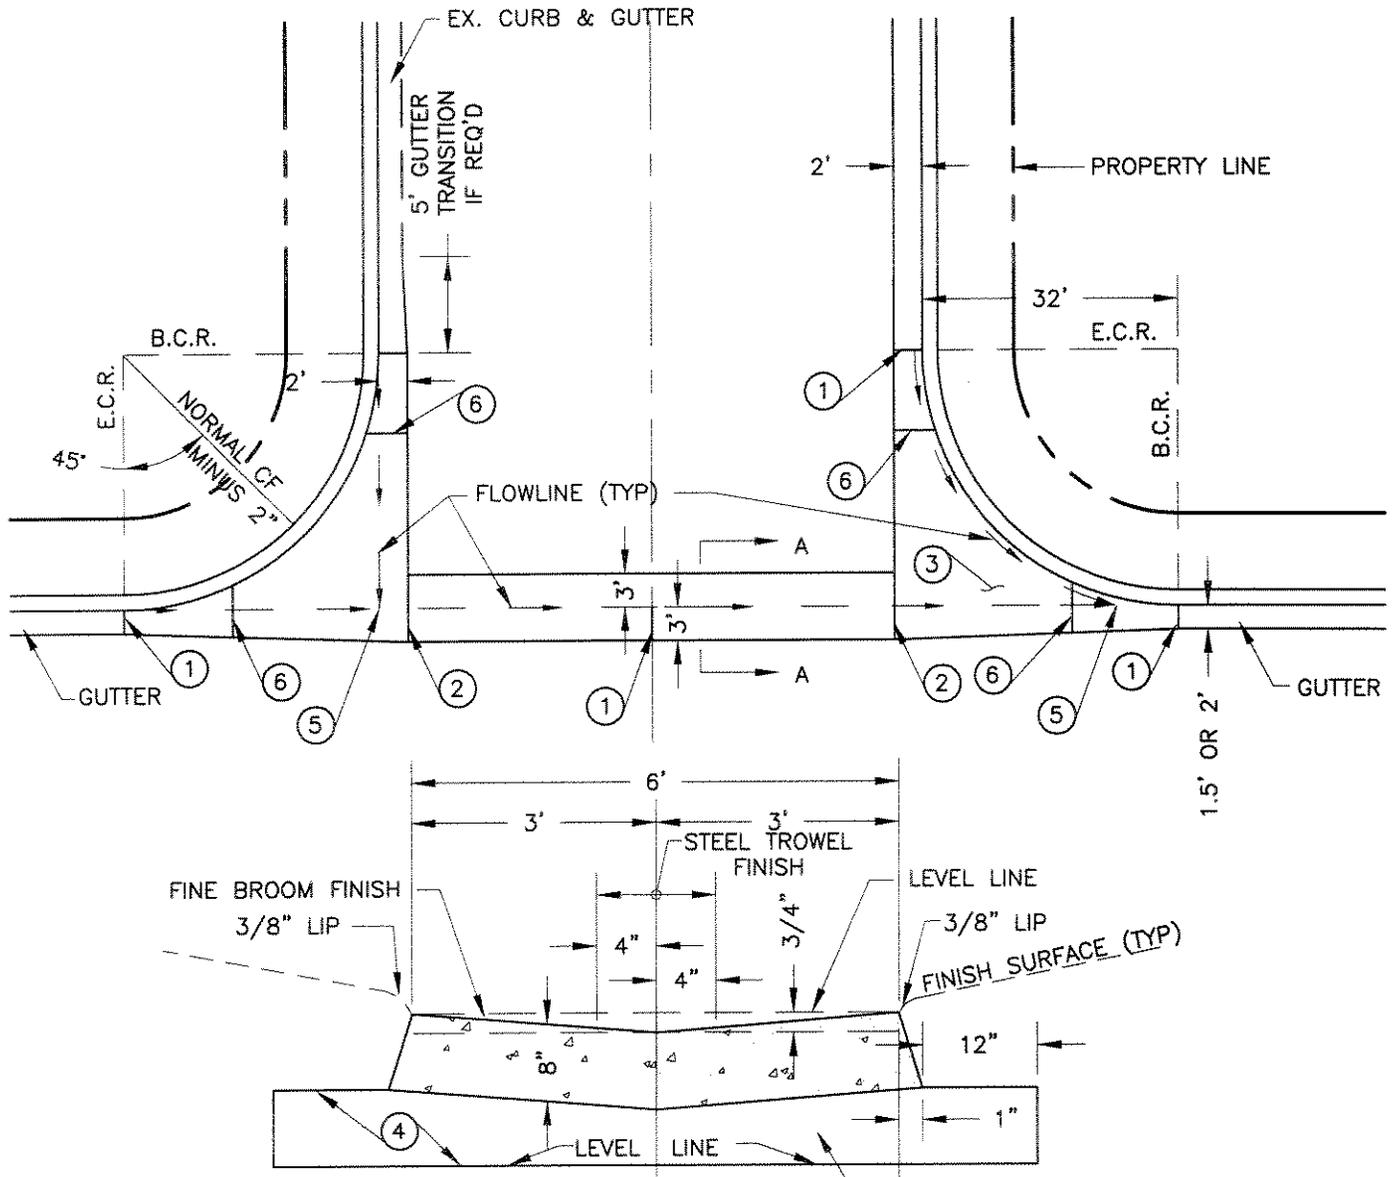

**SECTION A-A**

**NOTES:**


- ① 1/2" EXPANSION JOINT (TYPICAL)
  - ② COLD JOINT
  - ③ 8" CONCRETE (PER GREENBOOK, SECTION 201-1, MOST CURRENT EDITION), CURED WITH WHITE PIGMENTED COMPOUND
  - ④ BASE SHALL EXTEND A MIN. OF 12" OUTSIDE AREA ENCLOSED BY CURB RETURN, SPANDREL AND CROSS GUTTER
  - ⑤ ALL FLOWLINE P.I.'S SHALL BE LOCATED BY SURVEY & GRADE-STAKED PRIOR TO PLACING OF CONCRETE
  - ⑥ WEAKENED PLANE JOINT (MIN. DEPTH 1.5")
- CRUSHED AGGREGATE BASE  
6" MIN. UNLESS OTHERWISE SPECIFIED

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:	12/29/04  APPROVED: <i>Joseph S. Schenk</i> 24039 CITY ENGINEER RCE
Drawn By: LJA			Date: 12/29/04				

## CROSS GUTTER and SPANDREL

Std. Dwg. No.  
**225**  
Sheet 1 of 1

# CITY of NORCO STANDARD DRAWING

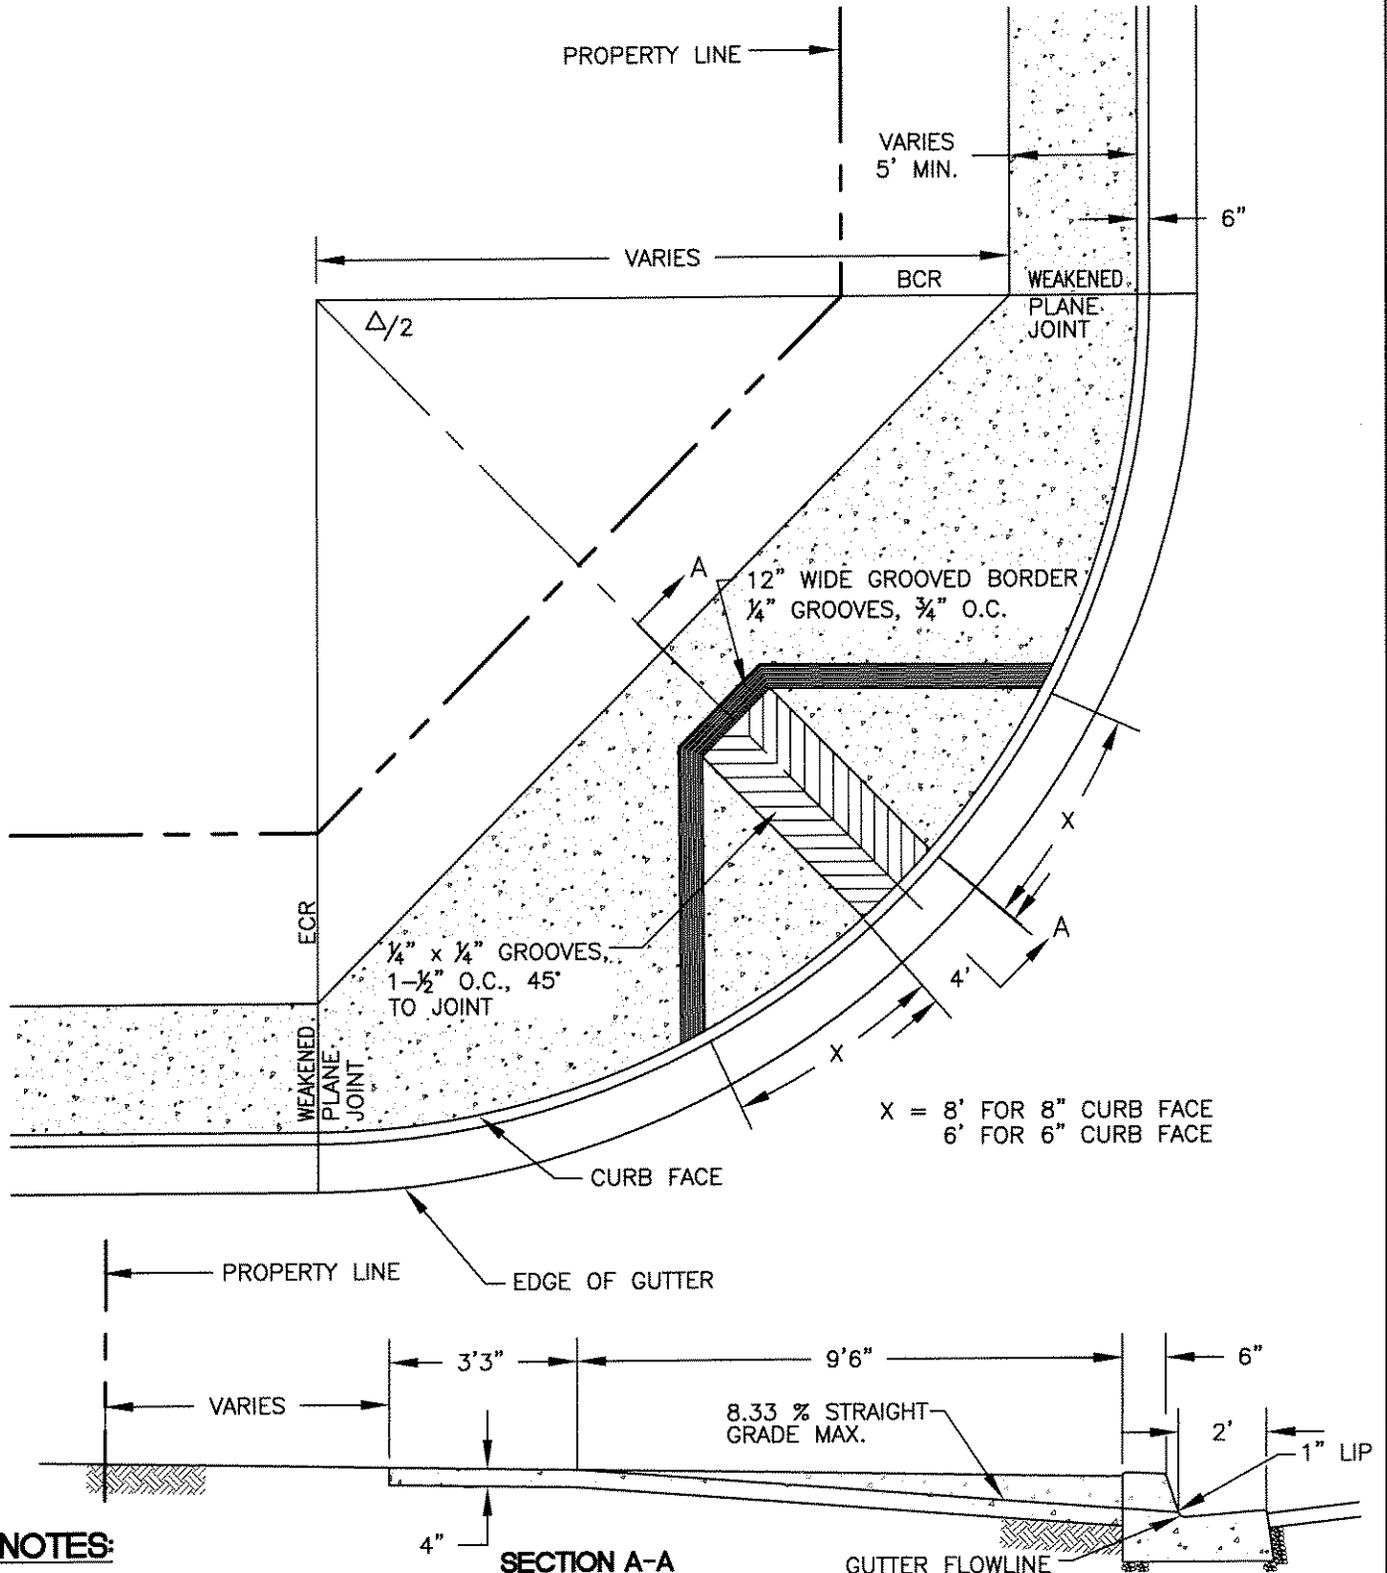

**NOTES:**

- ① RAMPS SHALL BE CONSTRUCTED OF CLASS 520-C-2500 CONCRETE.

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:

Drawn By: LJA

Date: 03/19/04


APPROVED: *Joseph Schenk* 24039  
 CITY ENGINEER RCE

## RAMP FOR THE PHYSICALLY DISABLED

Std. Dwg. No.  
**235**  
 Sheet 1 of 1



# CITY of NORCO STANDARD DRAWING

NO. BY DATE IN REVISIONS  
 DATE NO. BY DATE NO. BY DATE NO. BY  
 4-24-88 A.A.  
 7-22-88 N.A.  
 7-22-88 N.A.

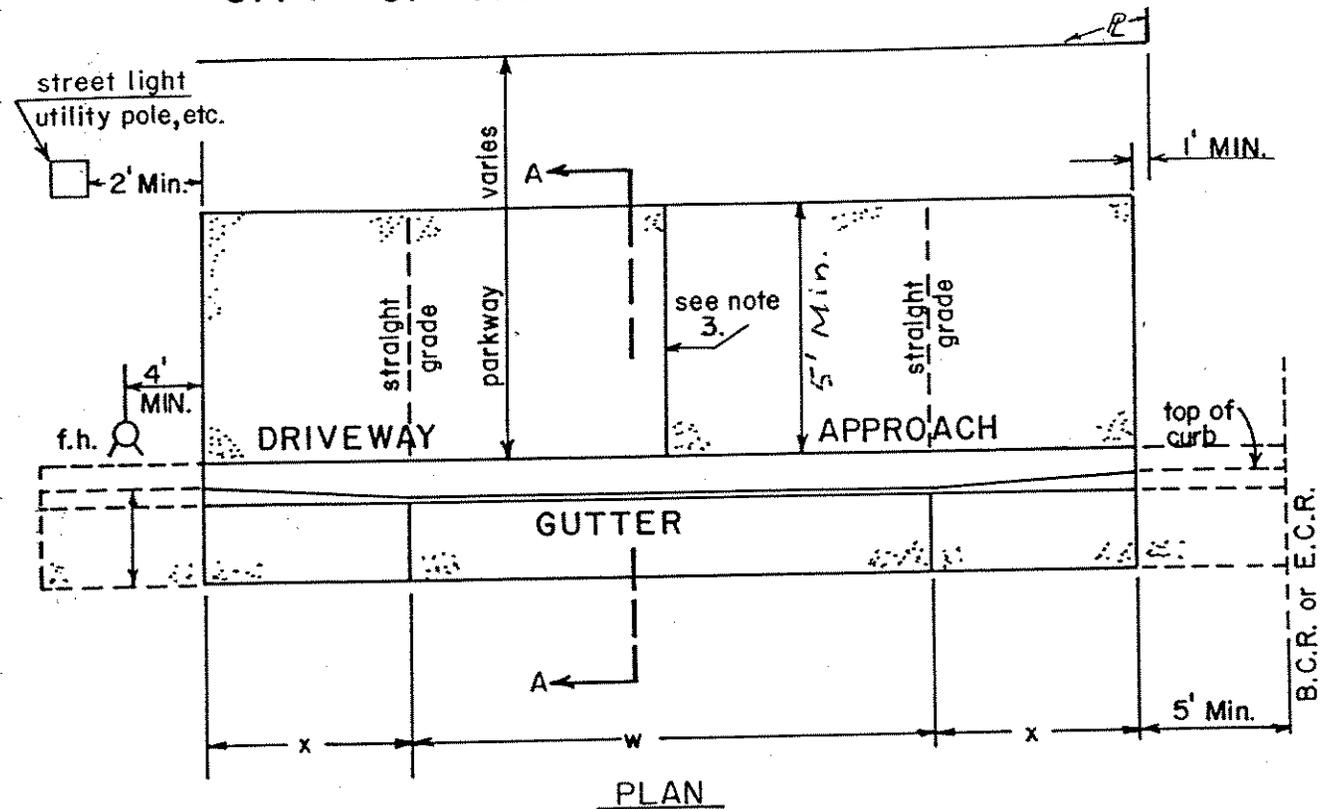

	6" c.f.	8" c.f.	over 8" c.f.
X =	3'	4'	5'

	MIN	MAX
W =	10'	30'

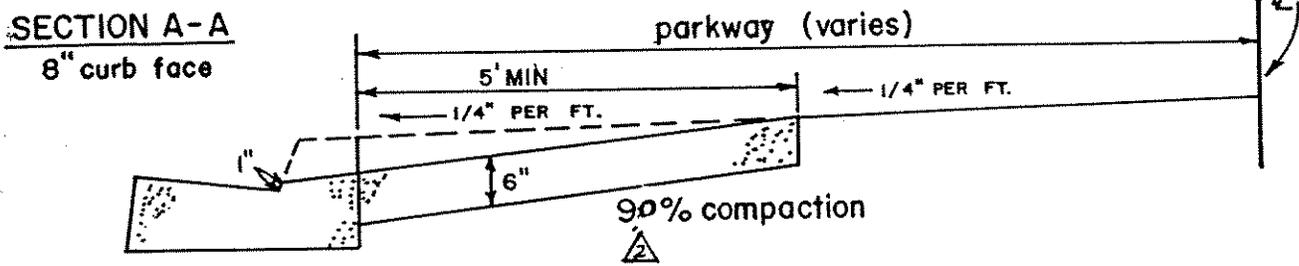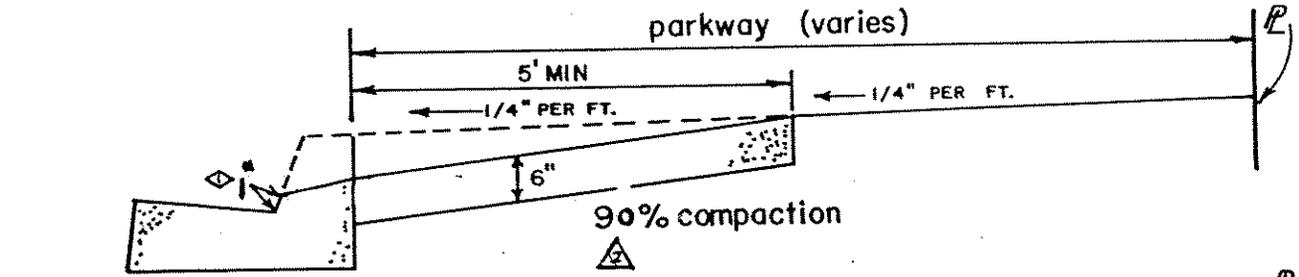

### NOTES

1. ALL CONCRETE SHALL BE CLASS 5.5C 2500, CURED WITH WHITE PIGMENTED COMPOUND.
2. ALL EXISTING P.C.C. SHALL BE SAWCUT IF REMOVED.
3. WEAKENED PLANE JOINT REQUIRED FOR ("W") EXCEEDING 14 FEET.

Drawn By: E.W.

Date: 10-22-85


APPROVED: *Jim Ostercraft*  
CITY ENGINEER

## RESIDENTIAL DRIVEWAY APPROACH

STD. DWG. NO.


240

# CITY of NORCO STANDARD DRAWING

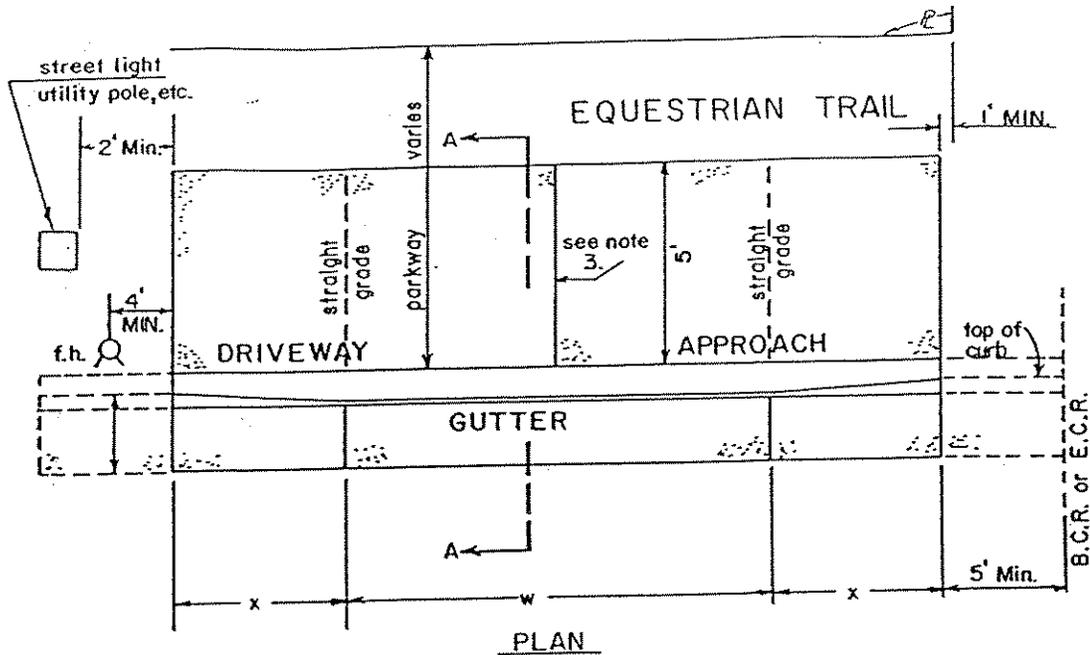

	6" c.f.	8" c.f.	over 8" c.f.
X =	3'	4'	5'

	MIN	MAX
W =	10'	30'

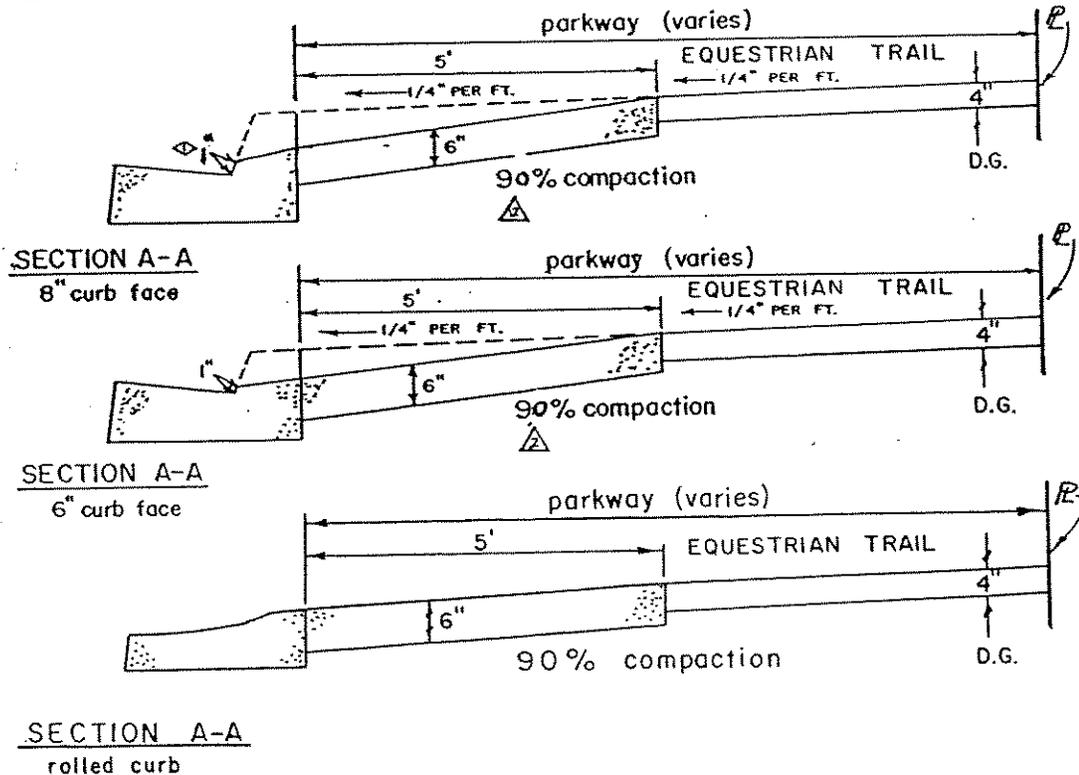

### NOTES

1. ALL CONCRETE SHALL BE CLASS 5.5C 2500, CURED WITH WHITE PIGMENTED COMPOUND.
2. ALL EXISTING P.C.C. SHALL BE SAWCUT IF REMOVED.
3. WEAKENED PLANE JOINT REQUIRED FOR ("W") EXCEEDING 14 FEET.

Drawn By:

Date: 5/12/92

APPROVED:

*George D. W. Mack*  
CITY ENGINEER RCE 9399

## RESIDENTIAL DRIVEWAY APPROACH

W/EQUESTRIAN TRAIL

STD. DWG. NO.



245

NO.	BY	DATE	NO.	BY	DATE

REVISIONS

# CITY of NORCO STANDARD DRAWING

NO.	BY	DATE	NO.	BY	DATE	NO.	BY	DATE

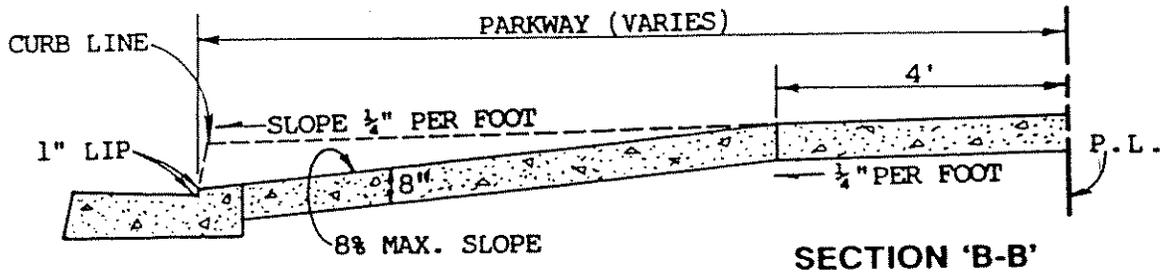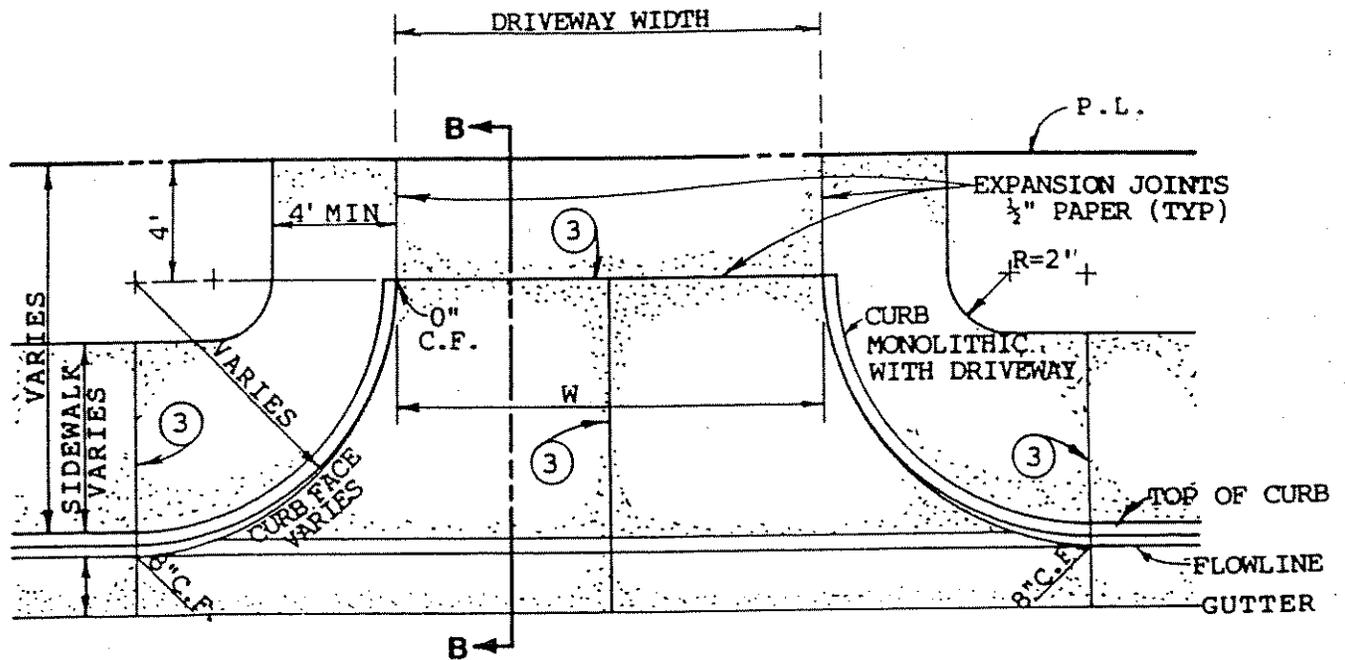

95% COMPACTION

\*Not to exceed 50% of the individual lot frontage.

	MIN	MAX*
W	30'	40'

**NOTES:**

- ① All existing P.C.C. to be removed shall be sawcut at the join.
- ② All concrete shall be Class 520-C-2500, cured with white pigmented compound.
- ③ Weakened plane joint.
- ④ This driveway approach may be required by the City Engineer on commercial developments.

Drawn By:

Date: 5/12/92

APPROVED: *George S. Albrecht*  
CITY ENGINEER RCE 9399


## COMMERCIAL & INDUSTRIAL DRIVEWAY APPROACH

STD. DWG. NO

250


# CITY of NORCO STANDARD DRAWING

NO. BY DATE IN DATE NO. BY DATE NO. BY DATE NO. BY DATE NO. BY DATE

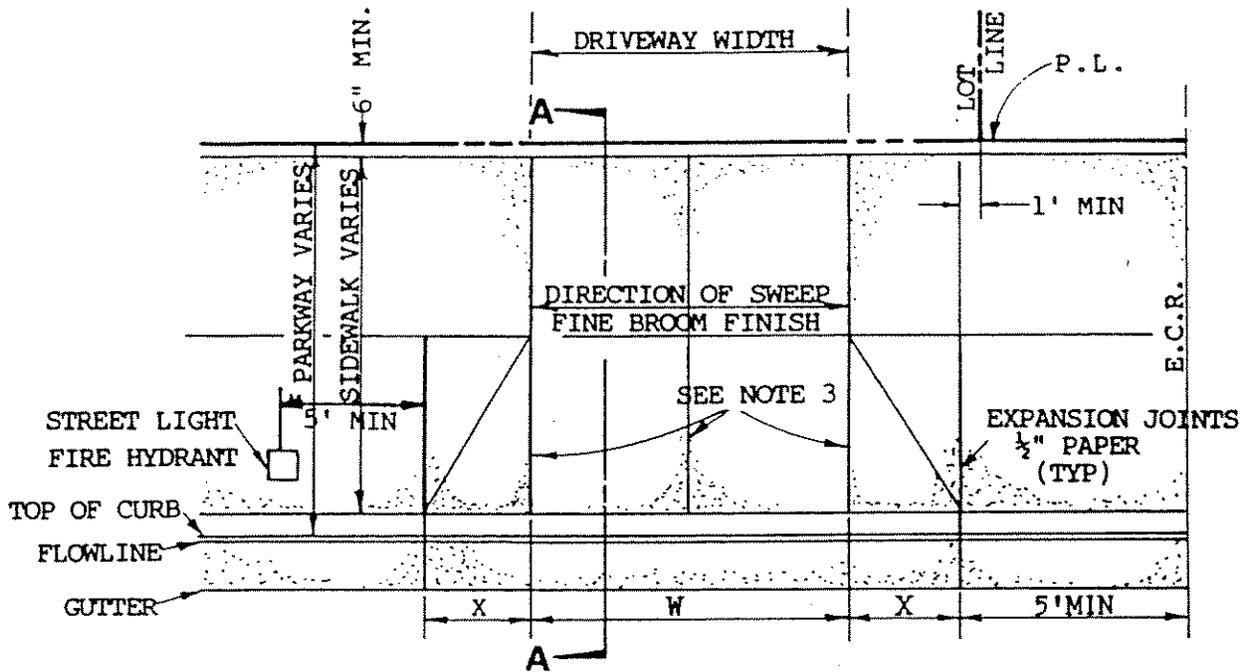

X	6" C.F.	8" C.F.	OVER 8"
	3'	4'	5'

W	MIN	MAX *
	20'	30'

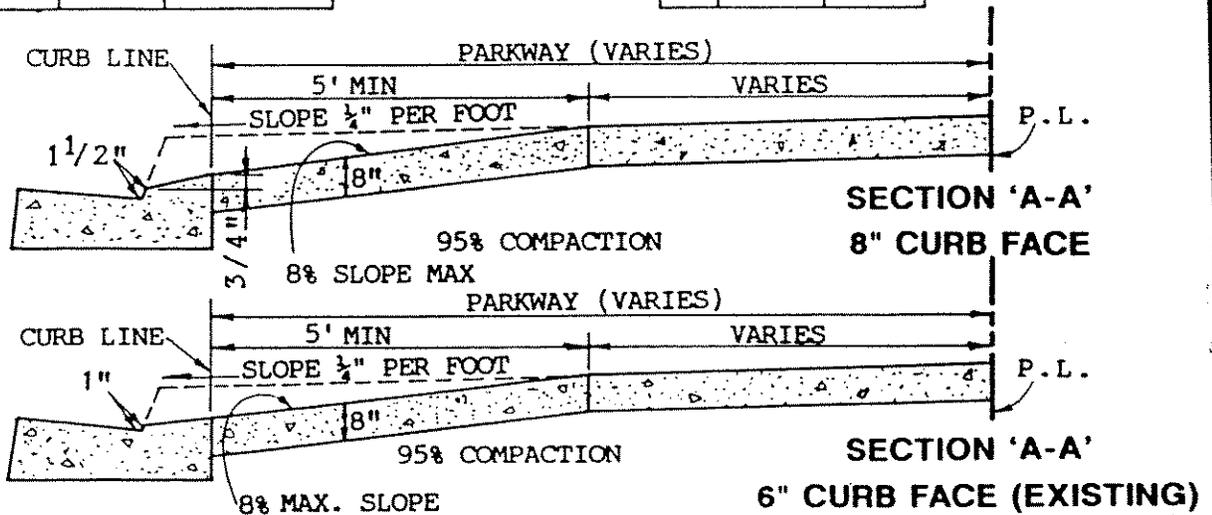

\*Not to exceed 50% of the individual lot frontage.

**NOTES:**

- ① All existing P.C.C. to be removed shall be sawcut at the join.
- ② All concrete shall be Class 520-C-2500, cured with white pigmented compound.
- ③ Weakened plane joint.

Drawn By:

Date: 5/12/92

APPROVED:

*George W. Black*  
CITY ENGINEER RCE 9399

**COMMERCIAL DRIVEWAY APPROACH (ALTERNATE)**


STD. DWG. NO.

255


**300**  
**DRAINAGE**  
**STANDARDS**




# CITY of NORCO STANDARD DRAWING

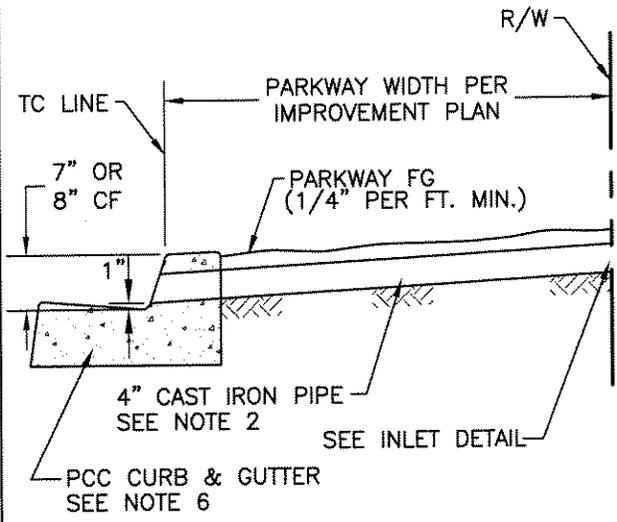


SECTION A-A

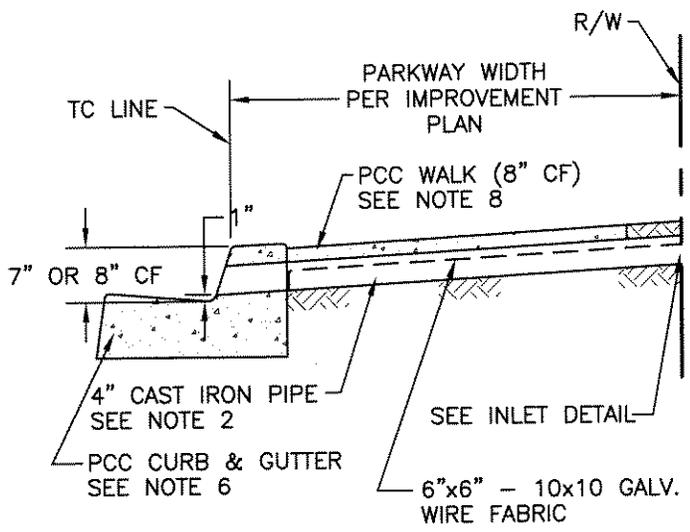

SECTION B-B

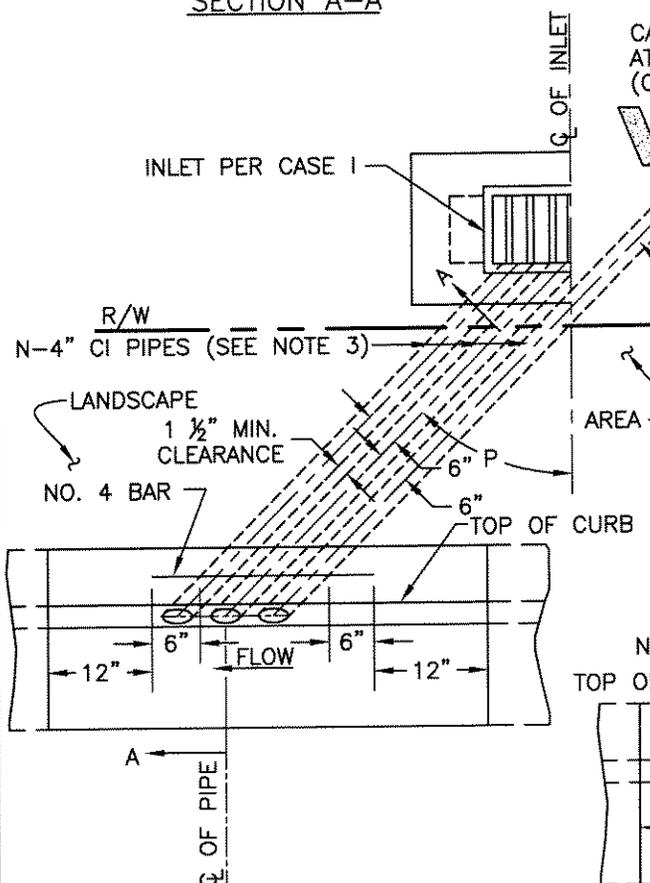

**PARKWAY DRAIN PLAN**  
ALTERNATE 1 (NO SIDEWALK)

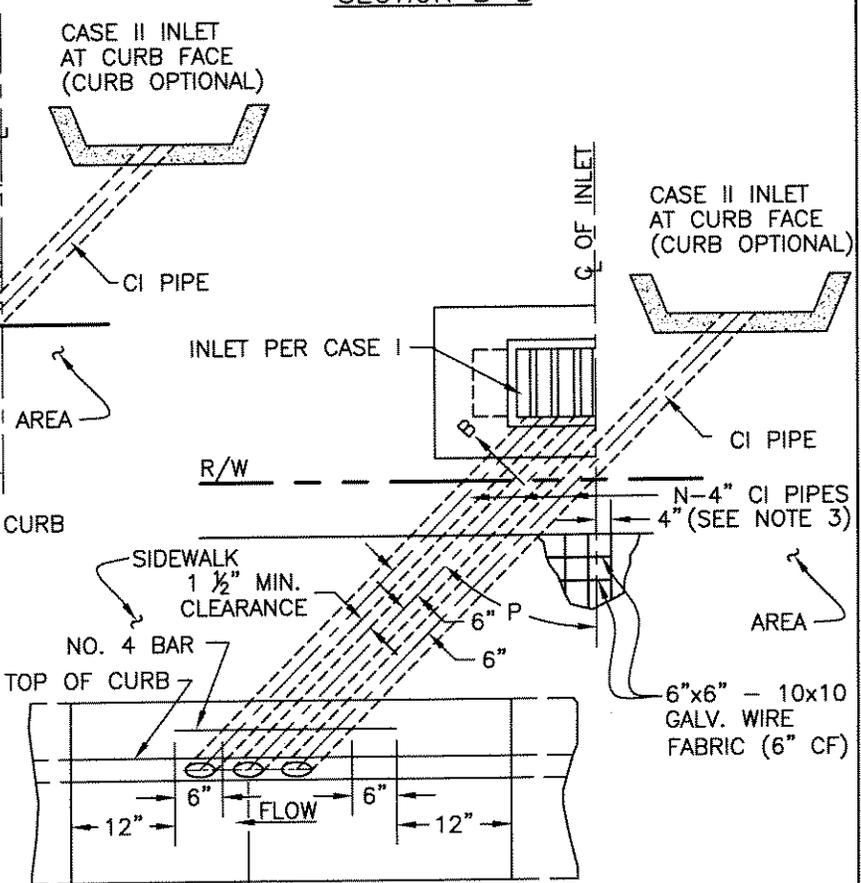

**PARKWAY DRAIN PLAN**  
ALTERNATE 2 (SIDEWALK)

**NOTE:**  
SEE STD. DWG NO. 300B FOR NOTES AND INLET DETAILS.

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:

Drawn By: LJA Date: 03/19/04


APPROVED: *Joseph Schenk* 4039  
CITY ENGINEER RCE

## PARKWAY DRAIN

Std. Dwg. No.  
**300A**  
Sheet 1 of 1



# CITY of NORCO STANDARD DRAWING

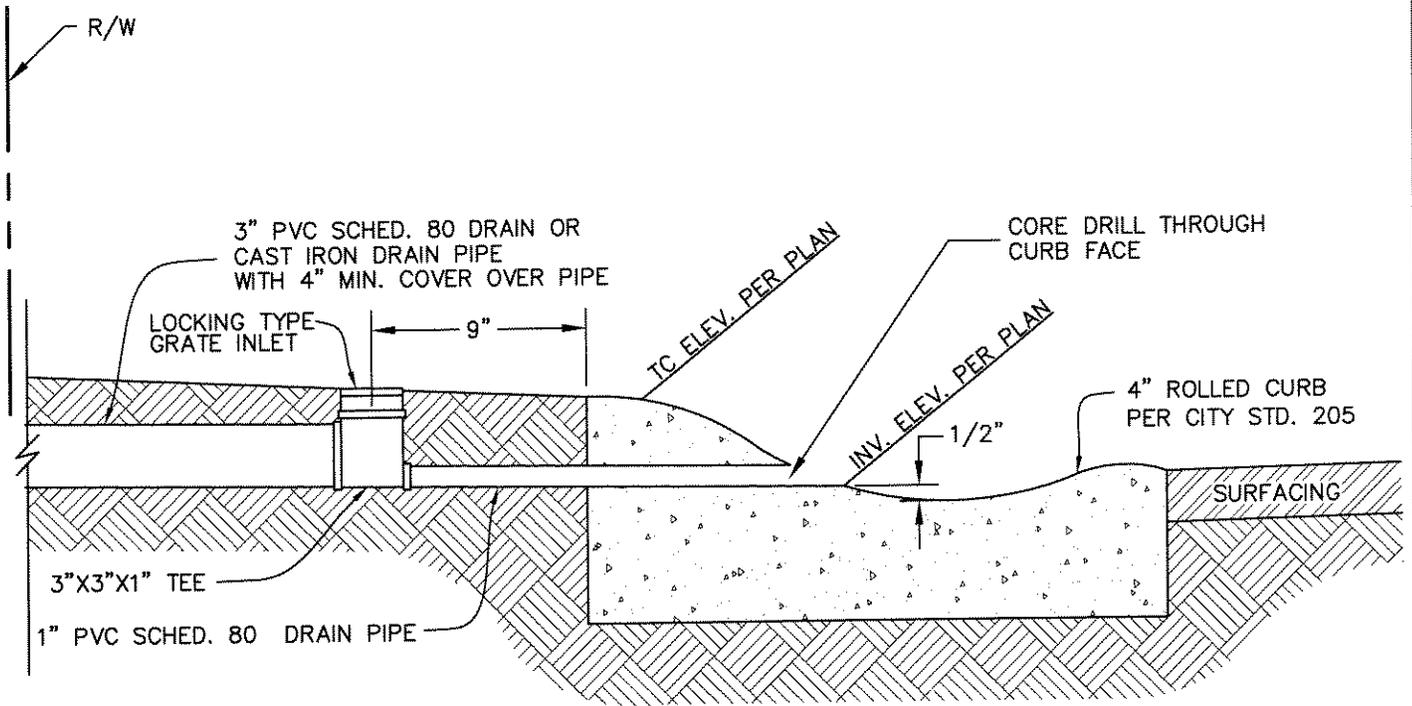

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:

Drawn By: LJA

Date: 03/19/04

APPROVED: *Joseph Schenk* 24039  
CITY ENGINEER RCE

## CURB OUTLET FOR RESIDENTIAL ROLLED CURB

Std. Dwg. No.  
**301**  
Sheet 1 of 1


**400**  
**WATER**  
**STANDARDS**




# CITY of NORCO STANDARD DRAWING

WATER AND SEWER MAINS SHALL BE INSTALLED IN SEPARATE TRENCHES WHENEVER POSSIBLE. WATER MAINS SHALL BE INSTALLED AT LEAST 10 FEET HORIZONTALLY FROM, AND 1 FOOT ABOVE SANITARY SEWERS WHEN PARALLEL TO THE SEWER MAIN AND 1 FOOT HIGHER THAN SANITARY SEWERS WHEN CROSSING THE SEWER MAIN.

**PARALLEL CONSTRUCTION**

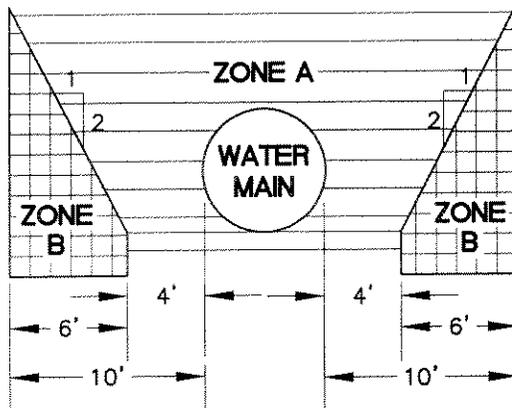

**PERPENDICULAR CONSTRUCTION**

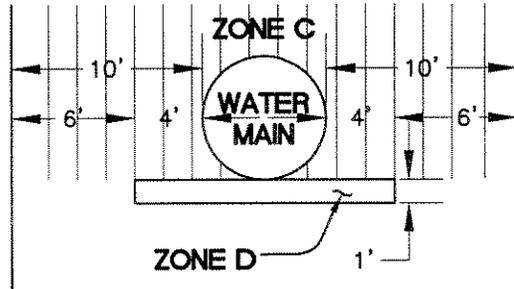


NOTE:

1. DIMENSIONS ARE FROM OUTSIDE OF WATER MAIN TO OUTSIDE OF SEWER.


SANITARY SEWERS ARE NOT PERMITTED WITHIN ANY OF THE ABOVE INDICATED ZONES UNLESS CONSTRUCTED IN CONFORMANCE WITH THE SPECIAL REQUIREMENTS AS SHOWN BELOW.

**ZONE**


**SPECIAL SEWER CONSTRUCTION REQUIREMENTS**



SEWER LINES WILL NOT BE PERMITTED IN THIS ZONE WITHOUT SPECIAL PERMISSION FROM STATE OF CALIFORNIA, DEPARTMENT OF HEALTH SERVICES.



EXTRA-STRENGTH VITRIFIED CLAY PIPE WITH COMPRESSION JOINTS; OR CONCRETE PIPE WITH REINFORCED CONCRETE COLLARS AROUND THE JOINTS, WHICH JOINTS SHALL HAVE A MINIMUM THICKNESS OF SIX INCHES AND A MINIMUM DISTANCE ALONG THE PIPE OF SIX INCHES ON EITHER SIDE OF THE JOINT; OR RUBBER GASKET REINFORCED CONCRETE PIPE; OR RUBBER GASKETED ASBESTOS CEMENT PIPE; OR RUBBER GASKETED PLASTIC PIPE; OR CAST IRON PIPE WITH COMPRESSION JOINTS.



CLASS 150 OR HEAVIER CAST IRON PIPE WITH HOT DIP BITUMINOUS COATING AND COMPRESSION JOINTS; OR ANY SEWER PIPE WITHIN A CONTINUOUS STEEL CASING, WHICH CASING SHALL HAVE A THICKNESS OF NOT LESS THAN ONE-FOURTH INCH AND WITH ALL VOIDS BETWEEN SEWER PIPE AND CASING PRESSURE GROUTED WITH SAND CEMENT GROUT.

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:	12/15/04  APPROVED: <i>Joseph L. Schenk</i> 24039 CITY ENGINEER RCE
Drawn By: LJA			Date: 3/19/04				

## SEPARATION OF SEWER AND WATER

Std. Dwg. No.  
**400A**  
Sheet 1 of 1

# CITY of NORCO STANDARD DRAWING

THE SPECIAL CONSTRUCTION REQUIREMENTS SHALL APPLY TO HOUSE LATERALS THAT CROSS ABOVE A PRESSURE WATER MAIN BUT NOT TO THOSE HOUSE LATERALS THAT CROSS BELOW A PRESSURE WATER MAIN.


1. SEWER FORCE MAINS ARE NOT PERMITTED TO BE CONSTRUCTED OVER WATER MAINS. FORCE MAINS MUST HAVE THE REQUIRED 10' SEPARATION REGARDLESS OF CONSTRUCTION. WHEN SEWER FORCE MAINS MUST CROSS UNDER WATER MAINS, SPECIAL APPROVAL OF THE HEALTH DEPARTMENT IS REQUIRED IN ADVANCE.
2. CONSTRUCTION OF ANY SANITARY SEWERS WITHIN 25' HORIZONTAL DISTANCE OF LOW HEAD WATER MAINS SHALL BE REVIEWED AND APPROVED BY THE HEALTH DEPARTMENT IN ADVANCE. (LOW HEAD WATER MAINS ARE DEFINED IN THE STATE HEALTH DEPARTMENT POLICY AS ANY WATER MAIN WHICH HAS LESS THAN 5 PSI AT ANY TIME AT ANY POINT IN THE MAIN.)
3. WHERE A SEWER MUST CROSS OVER A WATER MAIN; IT SHOULD CROSS AT A 90 DEGREE ANGLE IF POSSIBLE AND THE LENGTH OF SEWER PIPE SHALL BE CENTERED ON THE WATER MAIN SO THE SEWER JOINTS ARE THE MAXIMUM DISTANCE FROM THE WATER MAIN.

IF AN EXISTING SEWER IS LOCATED WITHIN ZONE A, B, C, OR D (SEE SHEET 400A) OF A PROPOSED WATER MAIN, THE FOLLOWING SPECIAL REQUIREMENTS APPLY:

**ZONE**


- A. NO WATER MAINS SHALL BE CONSTRUCTED WITHOUT SPECIAL PERMISSION FROM THE DEPARTMENT OF HEALTH.
- B. IF THE SEWER DOES NOT MEET ZONE B REQUIREMENTS GIVEN ABOVE, THE WATER MAIN SHALL BE CLASS 200 PIPE OR EQUIVALENT.
- C. NO WATER MAINS SHALL BE CONSTRUCTED WITHOUT SPECIAL PERMISSION FROM THE DEPARTMENT OF HEALTH. IF PERMISSION IS GRANTED, THE SEWER SHALL BE ENCASED WITH REINFORCED CONCRETE AND THE WATER MAIN SHALL BE OF CLASS 200 PIPE OR EQUIVALENT.
- D. THE SEWER SHALL BE ENCASED WITH REINFORCED CONCRETE.

CONCRETE SHALL BE CLASS 560-B-3250.

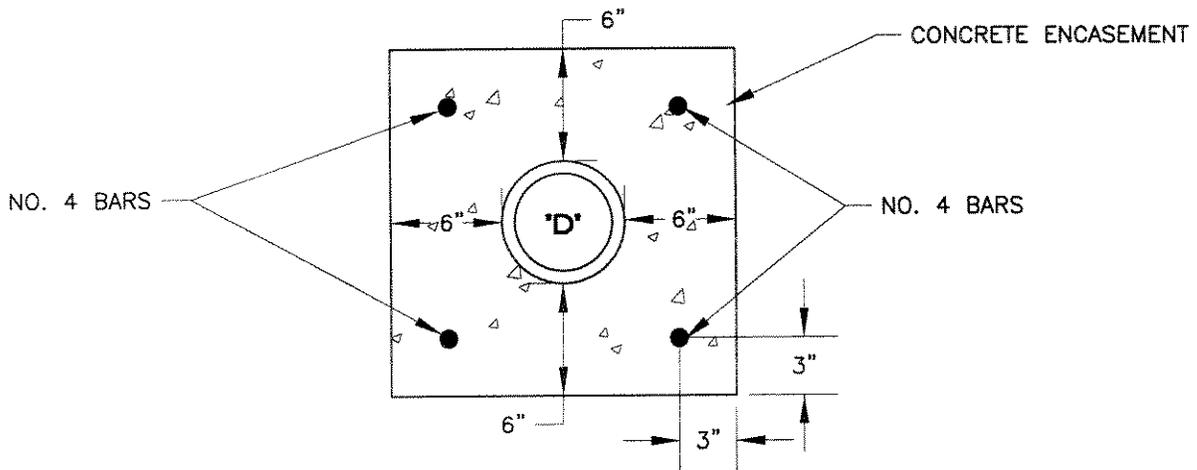

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:	12/15/04	
							APPROVED: <i>Joseph S. Schenk</i> 24039 CITY ENGINEER RCE	
Drawn By: LJA			Date: 3/19/04					

# CITY of NORCO STANDARD DRAWING

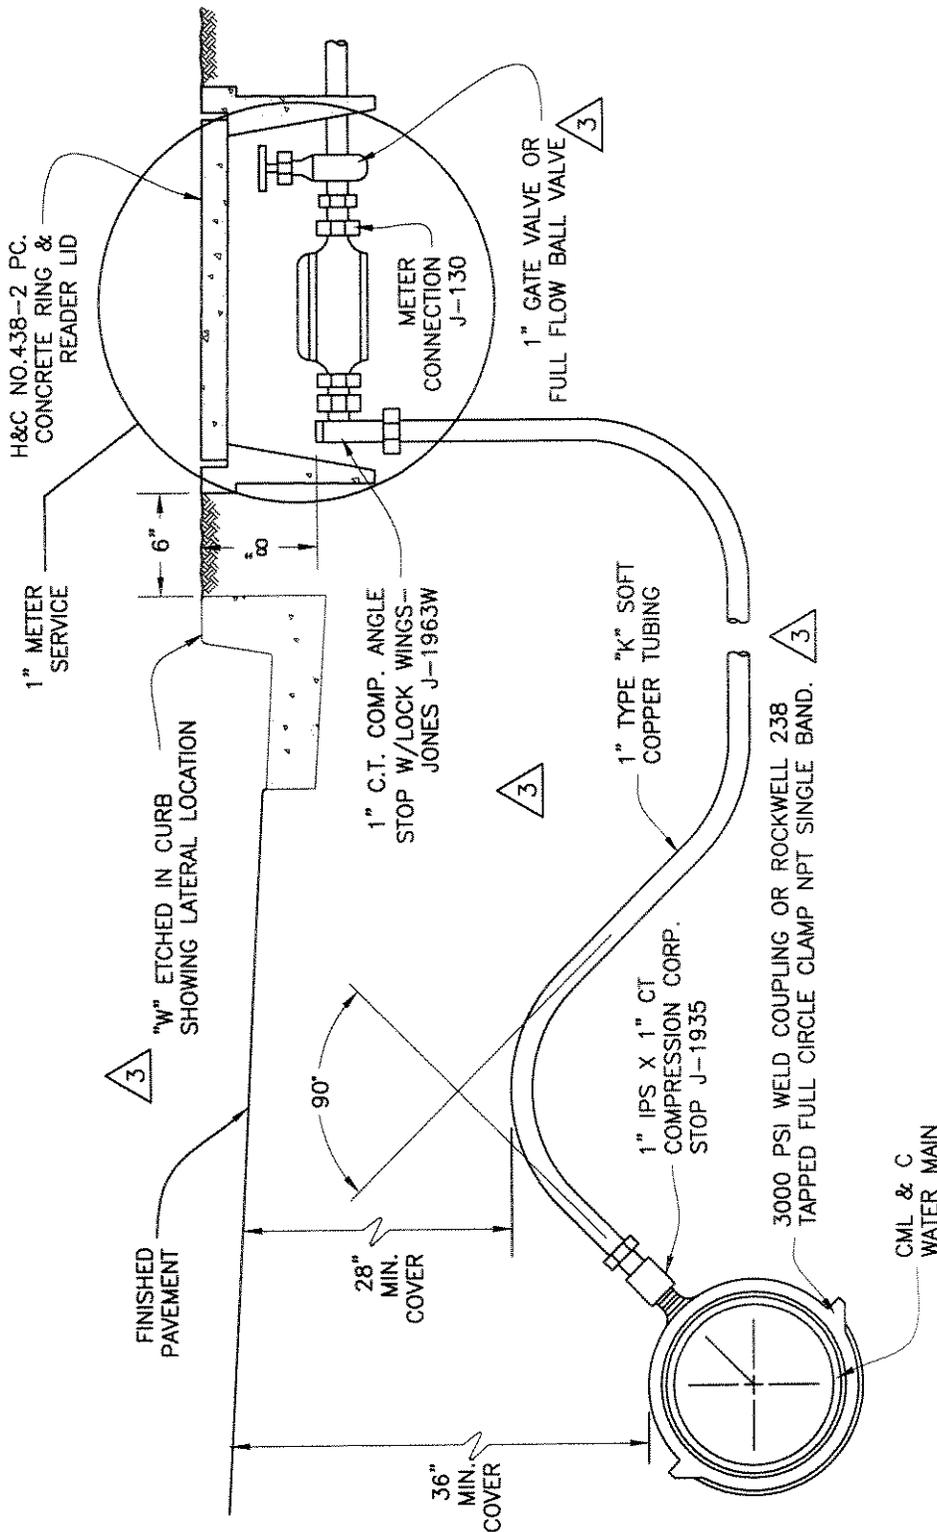

**NOTES**

1. ON ALL WATER MAINS THE CONTRACTOR SHALL FURNISH AND INSTALL SERVICE CONNECTIONS ON BOTH SIDES OF METER AND METERBOX, EXCEPT WHEN OTHERWISE AUTHORIZED BY THE CITY ENGINEER. ONLY THE WATER METER SHALL BE FURNISHED BY THE CITY.
2. BOTH THE SERVICE AND CONSUMER LINES SHALL BE FURNISHED AND INSTALLED BY THE CONTRACTOR PRIOR TO SIDEWALK CONSTRUCTION.
3. STRICT ADHERENCE TO SPECIAL PROVISIONS FOR TESTING AND DISINFECTING CML & C WATER LINES SHALL BE ENFORCED.
4. NO DIRECT TAPS SHALL BE MADE INTO CITY WATER MAIN.
5. INSTALL METER IMMEDIATELY - JUMPER NOT ALLOWED.

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:
1		JMA	6/9/86	3	LJA	5/02/02
2		JS	7/21/00			

12/15/04

APPROVED: *Joseph S. Schenk* 24039  
CITY ENGINEER RCE


Drawn By: LJA

Date: 3/19/04

## 1" WATER SERVICE CONNECTION

Std. Dwg. No.  
**405**  
Sheet 1 of 1

# CITY of NORCO STANDARD DRAWING

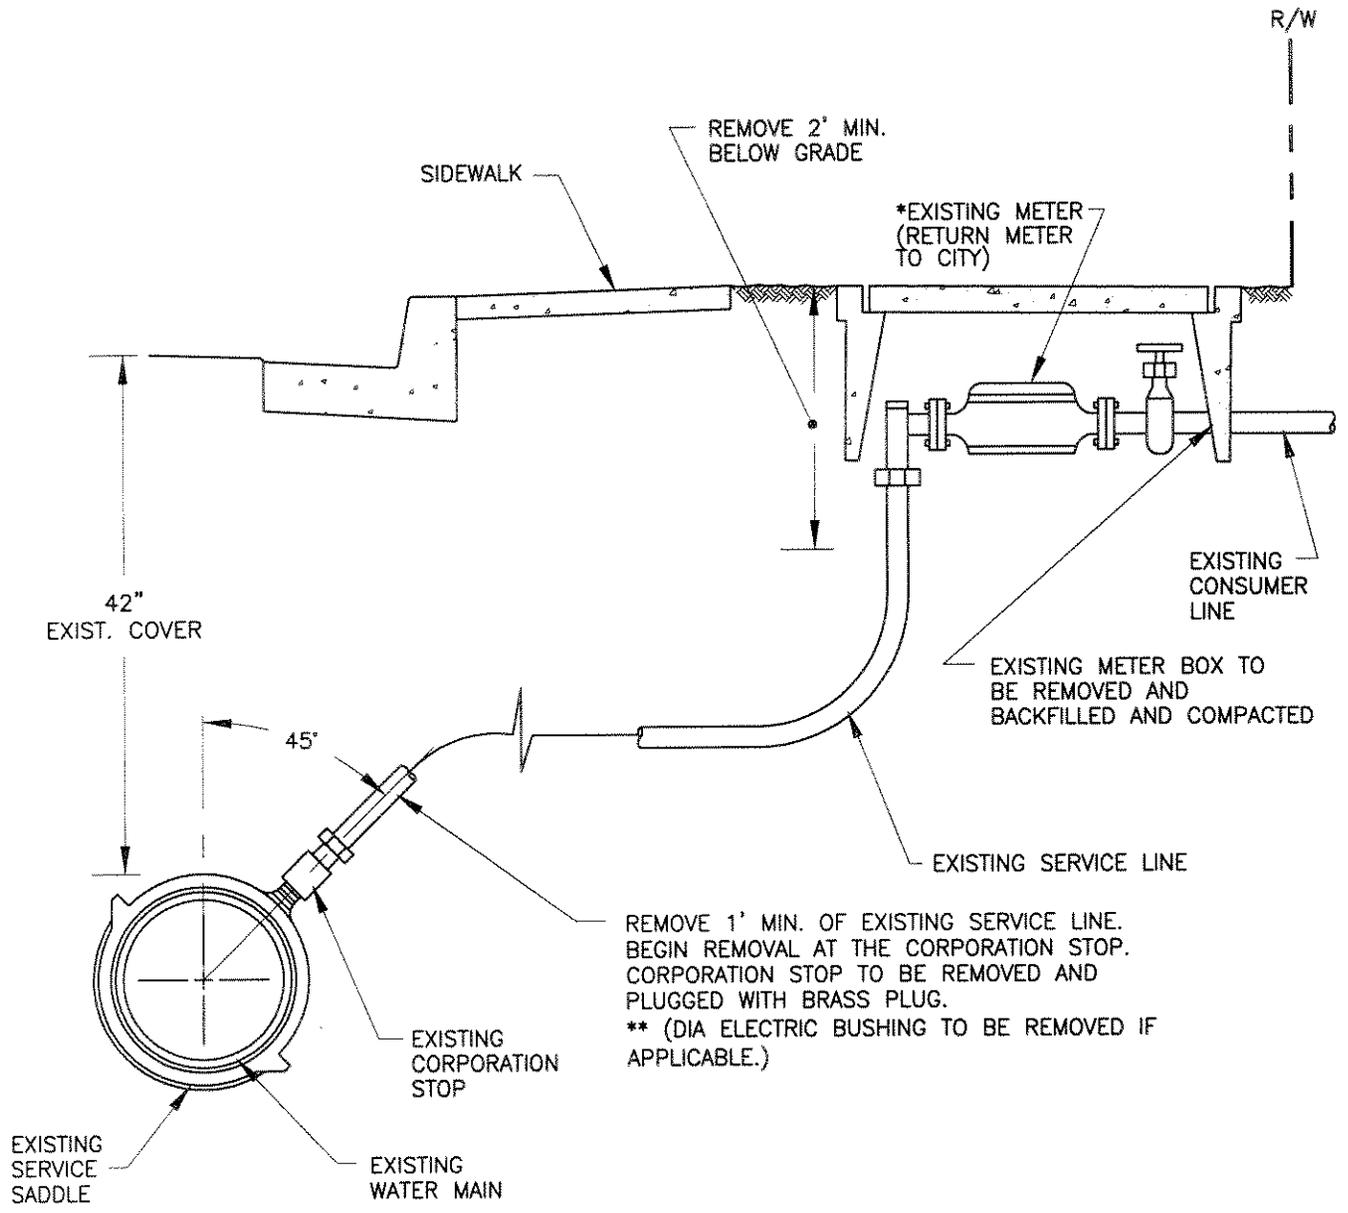

**NOTES**


1. ALL WATER SERVICE ABANDONMENT SHALL BE INSPECTED BY THE CITY PUBLIC WORKS INSPECTOR OR AUTHORIZED REPRESENTATIVE PRIOR TO BACKFILL AND TRENCH RESTORATION.
  2. TRENCH RESTORATION PER CITY STANDARD DRAWING NO. 155.
  3. PLUG COUPLING AND/OR SADDLE. COAT SADDLE WITH CEMENT PRIOR TO BACKFILL.
  4. ABANDONMENT MAY REQUIRE BONDING OR RESECTIONING PER CITY.
- \* UTILITIES DIVISION TO BE CONTACTED FOR REMOVAL OF WATER METER. 2 DAY MIN.
- \*\* IF IN A COMMERCIAL ZONE, SHUTDOWN WILL HAVE TO START AFTER 9:00 P.M. DEPENDING ON CLOSURE OF BUSINESS.

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:	12/15/04  APPROVED: <i>Joseph S. Schenk</i> 24039 CITY ENGINEER RCE
	1	JS	7/21/00				
Drawn By: LJA			Date: 3/19/04				

## WATER SERVICE ABANDONMENT

Std. Dwg. No.  
**406**  
Sheet 1 of 1

# CITY of NORCO STANDARD DRAWING

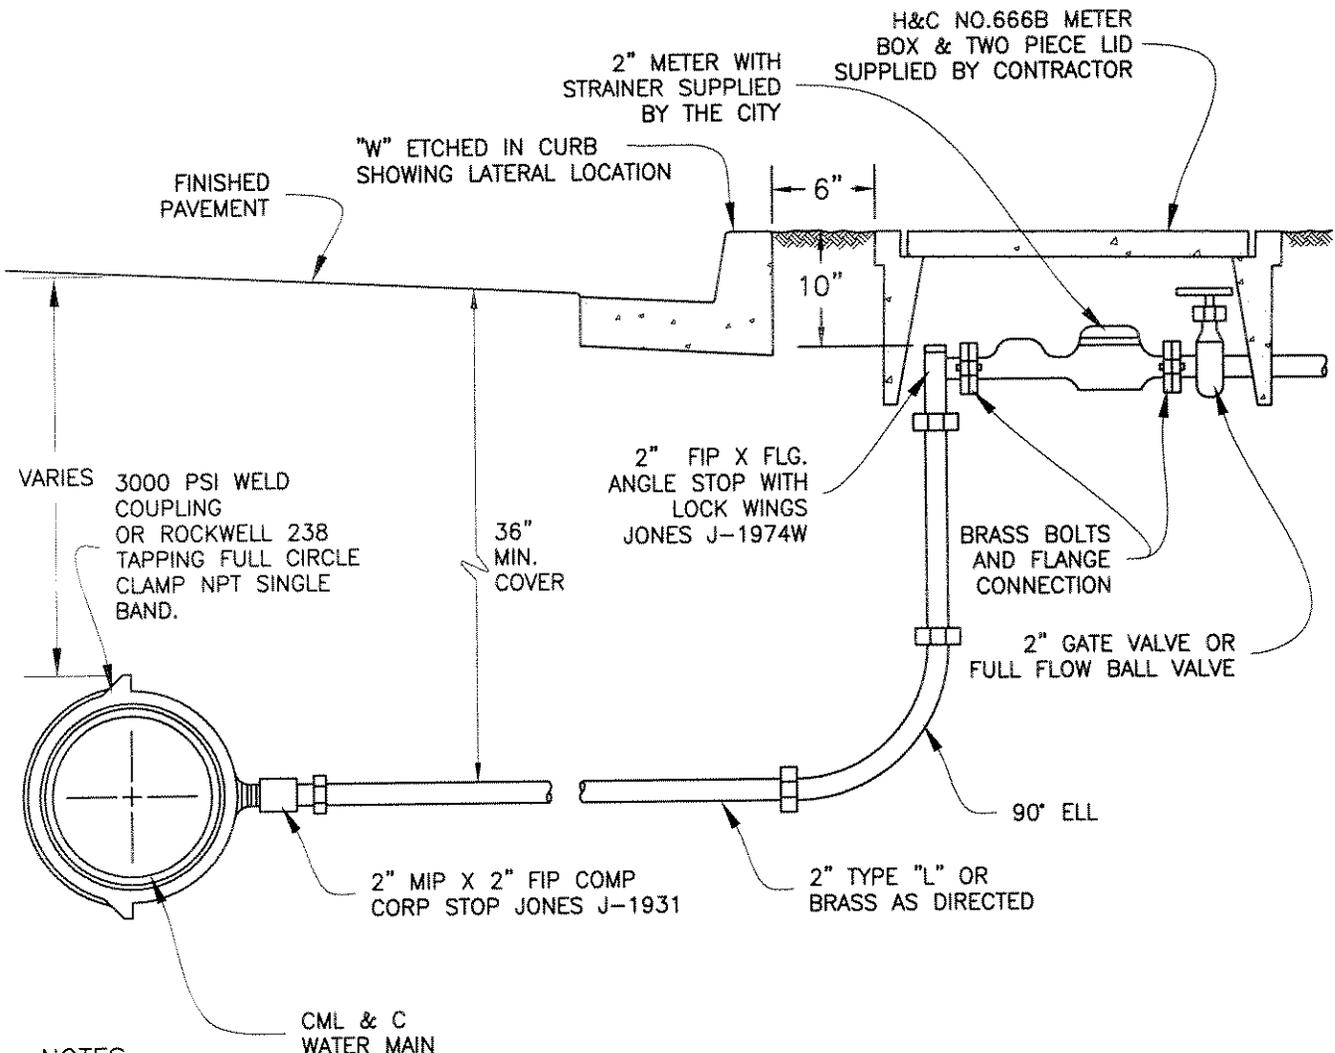

**NOTES**

1. ON ALL WATER MAINS THE CONTRACTOR SHALL FURNISH AND INSTALL SERVICE CONNECTIONS ON BOTH SIDES OF METER AND METERBOX, EXCEPT WHEN OTHERWISE AUTHORIZED BY THE CITY ENGINEER. ONLY THE WATER METER SHALL BE FURNISHED BY THE CITY.
2. BOTH THE SERVICE AND CONSUMER LINES SHALL BE FURNISHED AND INSTALLED BY THE CONTRACTOR PRIOR TO SIDEWALK CONSTRUCTION.
3. STRICT ADHERENCE TO SPECIAL PROVISIONS FOR TESTING AND DISINFECTING CML & C WATER LINES SHALL BE ENFORCED. ALL COATING TO BE REMOVED PRIOR TO INSTALLATION AND TO BE RECOATED AFTER INSTALLATION.
4. NO DIRECT TAPS SHALL BE MADE INTO CITY MAIN.
5. NO COMPRESSION FITTINGS ALLOWED BETWEEN CORPORATION STOP AND ANGLE METER STOP UNLESS AUTHORIZED BY INSPECTOR.
6. INSTALL METER IMMEDIATELY - JUMPER NOT ALLOWED.

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:	12/15/04
	1	JS	7/21/00				APPROVED: <i>Joseph S. Schenk</i> 44039 CITY ENGINEER
	2	JS	5/02/02				
Drawn By: LJA			Date: 3/19/04			RCE	

## 2" WATER SERVICE CONNECTION


Std. Dwg. No.  
**410**  
Sheet 1 of 1

# CITY of NORCO STANDARD DRAWING

- ① — SENSUS HYDRO/TURBO METER. METER CALIBRATED TO 100 CU. FT.
- ② — SENSUS STRAINER
- ③ — SENSUS #912 ADAPTER
- ④ — SPOOL PIECE, (2 PIPE DIAMETERS MIN.)
- ⑤ — TEST NIPPLE AND CAP
- ⑥ — VALVE
- ⑦ — REDUCING TEE
- ⑧ — 90° ELBOW
- ⑨ — BYPASS PIPING
- ⑩ — SENSUS #411 COUPLING
- ⑪ — BYPASS VALVE
- ⑫ — SPOOL PIECE, (5 PIPE DIAMETERS MIN.)
- ⑬ — SPOOL PIECE, 36" MINIMUM
- ⑭ — WELDED FLANGE COUPLING ADAPTER
- ⑮ — CL 200, 4" MINIMUM
- ⑯ — RESILIENT WEDGE GATE VALVE UP TO 4" DIA.; BUTTERFLY VALVE 6" AND ABOVE.
- ⑰ — TAPPING SLEEVE OR TEE ON MAIN
- ⑱ — CONCRETE THRUST BLOCK PER CITY STD. NO.XXX
- ⑲ — SERVICE LINE TO CUSTOMER
- ⑳ — UTILITY VAULT, (SEE GENERAL NOTES)

### GENERAL NOTES

1. VAULTS SHALL BE BEST CONCRETE PRODUCTS, BROOKS PRODUCTS, QUICK-SET, OR EQUAL APPROVED IN WRITING PRIOR TO CONSTRUCTION. VAULTS SHALL BE FABRICATED SO THERE IS 18" HORIZONTAL CLEARANCE MINIMUM ON ALL SIDES OF THE METER ASSEMBLY.
2. ALL VAULTS SHALL HAVE TRAFFIC COVERS. NO PARKWAY COVERS WILL BE ALLOWED. COVERS SHALL HAVE A 7 1/2" ROUND READING LID CENTERED OVER THE METER.
3. CONCRETE PIERS SHALL BE PLACED UNDER VAULT CORNERS.
4. 6" OF 3/4" ROCK SHALL BE PLACED IN THE BOTTOM OF THE VAULT.
5. THE METER SHALL BE SUPPORTED BY ADJUSTABLE PIPE SUPPORTS.
6. THE VAULT SHALL BE LOCATED 2' MINIMUM FROM THE BACK OF CURB, AND SHALL BE LOCATED SO THE ENTIRE VAULT IS IN THE PUBLIC RIGHT-OF-WAY.
7. WHERE BRAND NAMES ARE CALLED OUT, EQUALS, APPROVED IN WRITING PRIOR TO PLAN APPROVAL, MAY BE USED.
8. BYPASS PIPING CAN BE PURCHASED AS A ROCKWELL PRE FAB-PAC OR HYDRO PRECISION PACKAGE OR EQUAL, APPROVED BY THE CITY ENGINEER.
9. ALL FITTINGS, PIPES, VALVES, AND FLEXES SHALL BE RATED FOR 200 PSI MINIMUM.

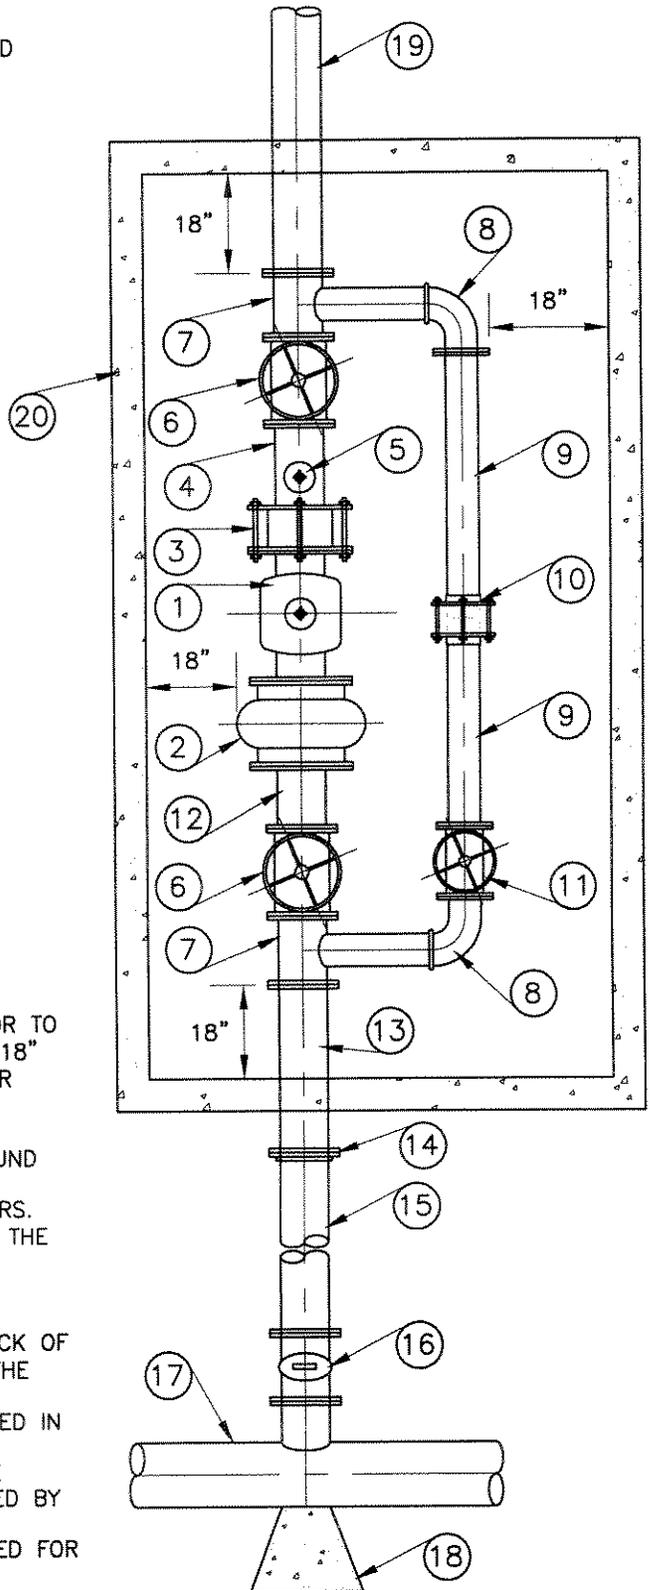

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:

Drawn By: LJA

Date: 3/19/04

12/10/04

APPROVED: *Joseph S. Schenk* 24039  
CITY ENGINEER RCE


## STANDARD WATER SERVICE 3" and LARGER

Std. Dwg. No.  
**415**  
Sheet 1 of 1


# CITY of NORCO STANDARD DRAWING

**NOTE:**

BYPASS METER NOT REQUIRED WHEN LINE SIZE METER IS INSTALLED BEFORE BACKFLOW PREVENTION DEVICE

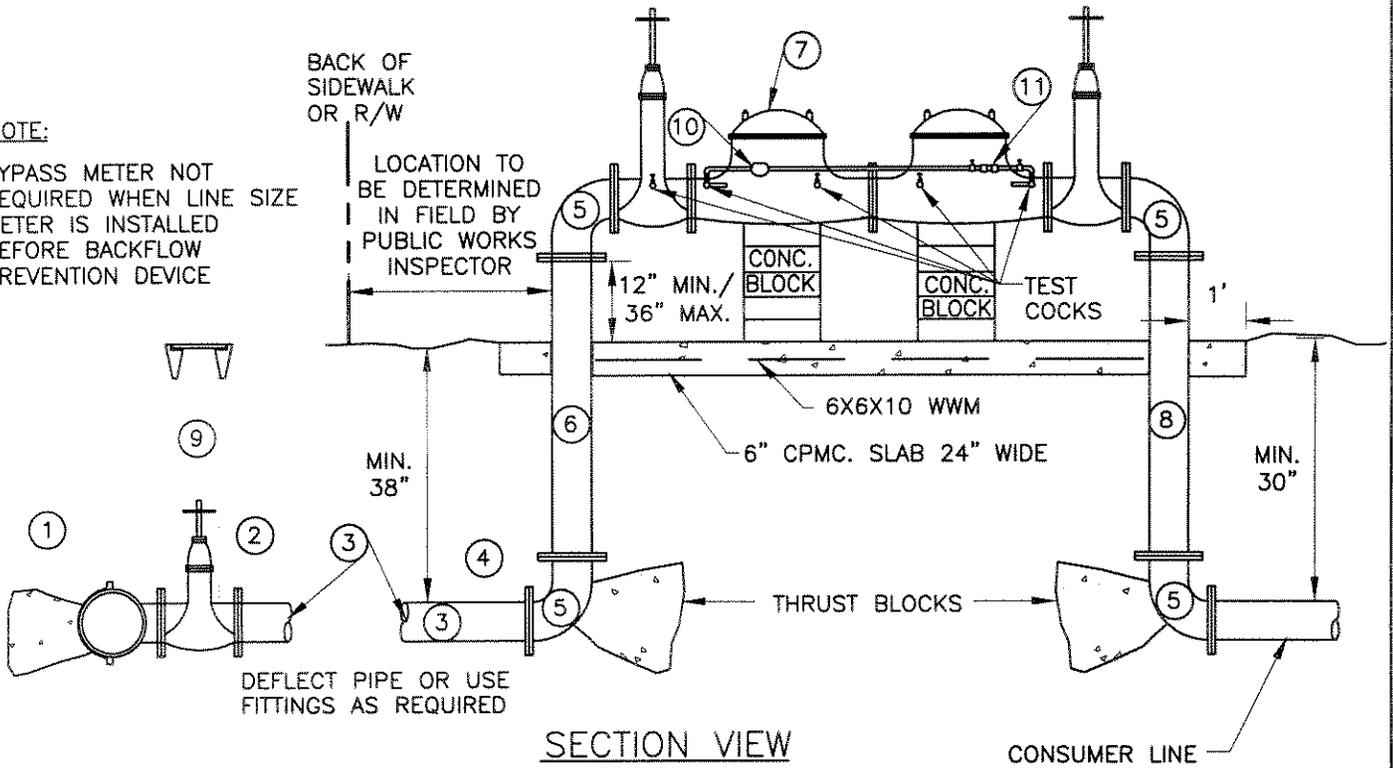

SECTION VIEW

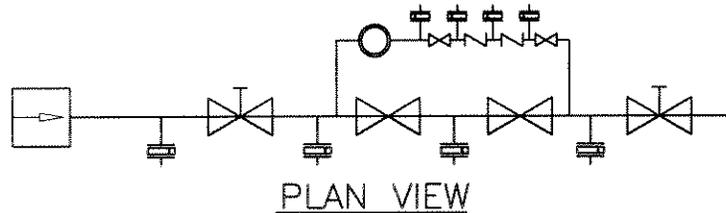

PLAN VIEW

KEY	QUANTITY	DESCRIPTION
①	1	WELD COLLAR PER NORCO STD. 465
②	1	AWWA APPROVED RESILIENT SEAT GATE VALVE
③	-	PIPE - 10 GA. STEEL, CML & C
④	1	WELDED FLANGE, RAISED FACE
⑤	4	RAISED FACE 90° FLANGED ELBOW, CML & C STD. STEEL
⑥	1	RAISED FACE FLANGED SPOOL, CML & C STD. STEEL
⑦	1	DOUBLE CHECK VALVE ASSEMBLY WITH OS & Y VALVES, AS APPROVED BY THE FOUNDATION FOR CROSS CONNECTION CONTROL
⑧	1	RAISED FACE FLANGED SPOOL, CML & C STD. STEEL
⑨	1	VALVE CAN PER NORCO STD. 450 AND 455
⑩	1	3/4" BYPASS "SENSUS" METER ALL BRASS (10" - USE 1" METER) TO BE SUPPLIED BY CONTRACTOR
⑪	1	3/4" DOUBLE CHECK VALVE ASSEMBLY AS APPROVED BY THE FOUNDATION FOR CROSS CONNECTION CONTROL (10" - USE 1" D.C.)

<b>REVISION</b>	NO:	BY:	DATE:	NO:	BY:	DATE:	
							12/15/04
							APPROVED: <i>Joseph J. Schenk</i> 24039 CITY ENGINEER RCE


Drawn By: LJA

Date: 3/19/04

## DETECTOR CHECK DOUBLE CHECK VALVE

Std. Dwg. No.  
**420**  
Sheet 1 of 1

# CITY of NORCO STANDARD DRAWING

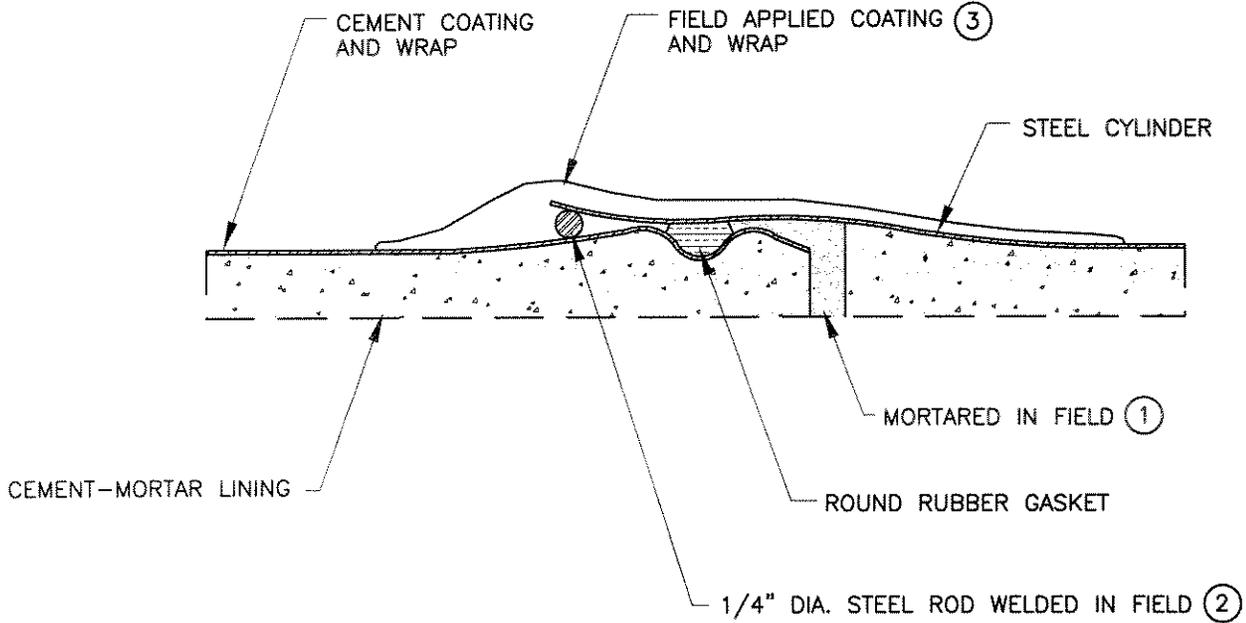

## CEMENT-MORTAR LINED AND CEMENT COATED STEEL PIPE


- ① FOR PIPE 20" DIA. AND SMALLER, THE BELL END SHALL BE DAUBED WITH MORTAR PRIOR TO JOINING, AND SHALL BE SWABBED SMOOTH AFTER JOINING. PIPE 24" DIA. AND LARGER SHALL BE MORTARED AND SWABBED FROM THE INSIDE AFTER JOINING.
- ② STEEL ROD SHALL BE 2" LONG AND DOUBLE FILLET WELDED ON THE TOP OF THE JOINT. WHERE SPECIFIED, THE WELD SHALL BE CONTINUOUS AROUND THE JOINTS.
- ③ CONCRETE DIAPER

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:
						12/15/04
Drawn By: LJA			Date: 3/19/04			APPROVED: <i>Joseph S. Schenk</i> 24039 CITY ENGINEER RCE
<b>STEEL PIPE JOINTS</b>						Std. Dwg. No. <b>425</b> Sheet 1 of 1

# CITY of NORCO STANDARD DRAWING


## DOUBLE CHECK VALVE ASSEMBLY

BRAND NAMES: USC/AWWA APPROVED ASSEMBLY

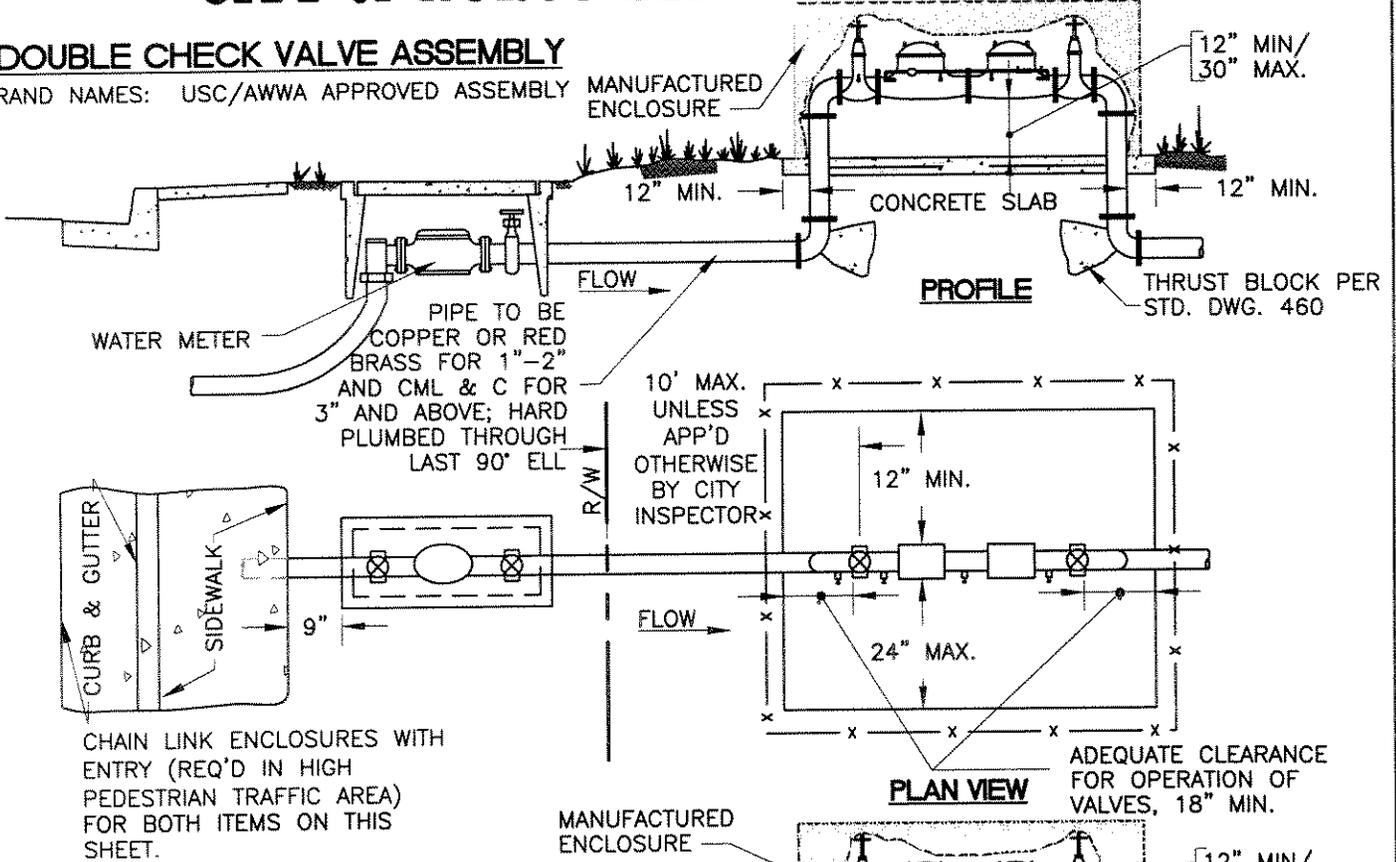

## REDUCED PRESSURE PRINCIPLE DEVICES

BRAND NAMES: USC/AWWA APPROVED ASSEMBLY

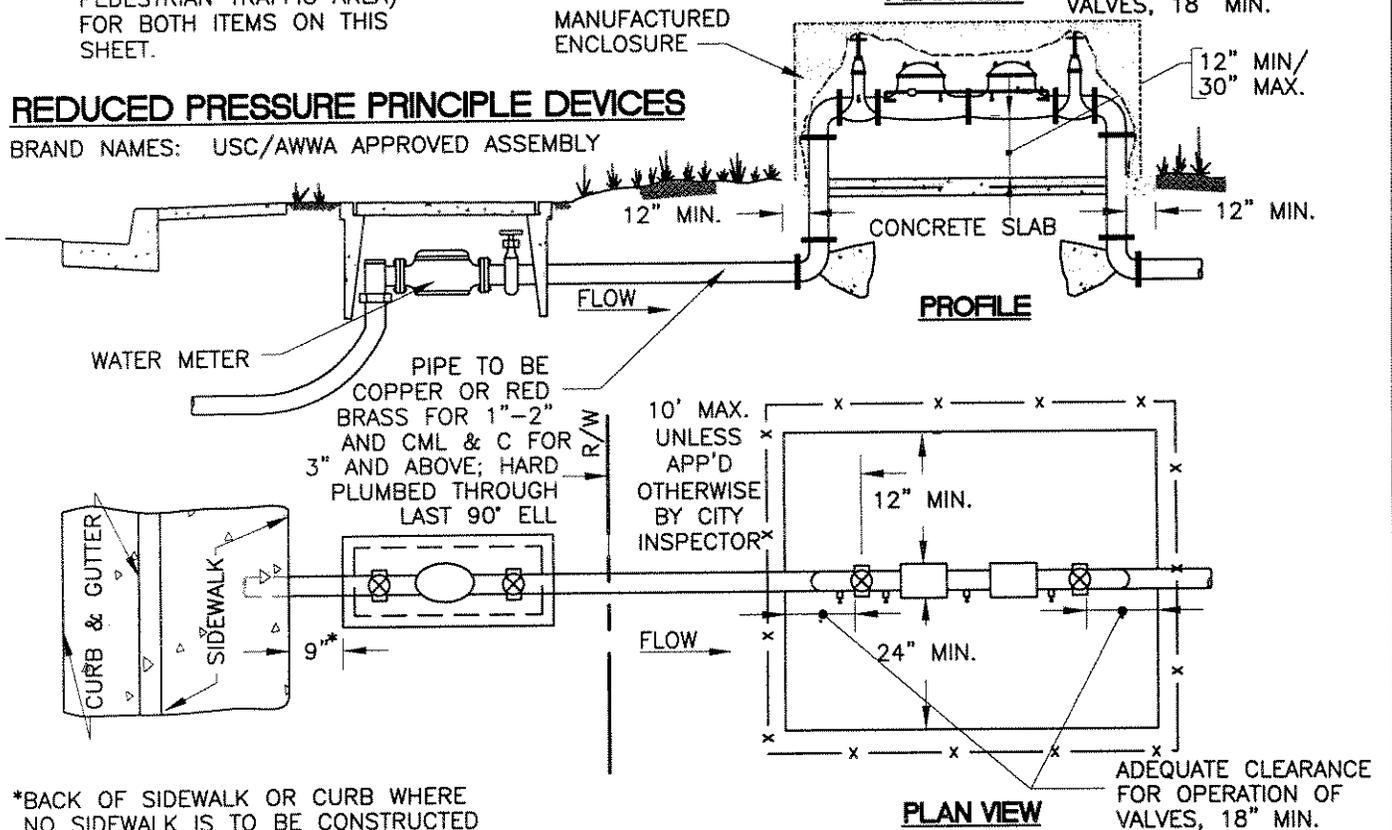


REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:	12/15/04
							APPROVED: <i>Joseph J. Schenk</i> 24039 CITY ENGINEER RCE
Drawn By: LJA							Date: 06/30/04

## INSTALLATION OF BACKFLOW PREVENTION ASSEMBLY


Std. Dwg. No.  
**430A**  
Sheet 1 of 1

# CITY of NORCO STANDARD DRAWING

NOTE  
ABSOLUTELY NO MEANS OF SHUT-OFF ON THE DISCHARGE SIDE OF THE VACUUM BREAKER.

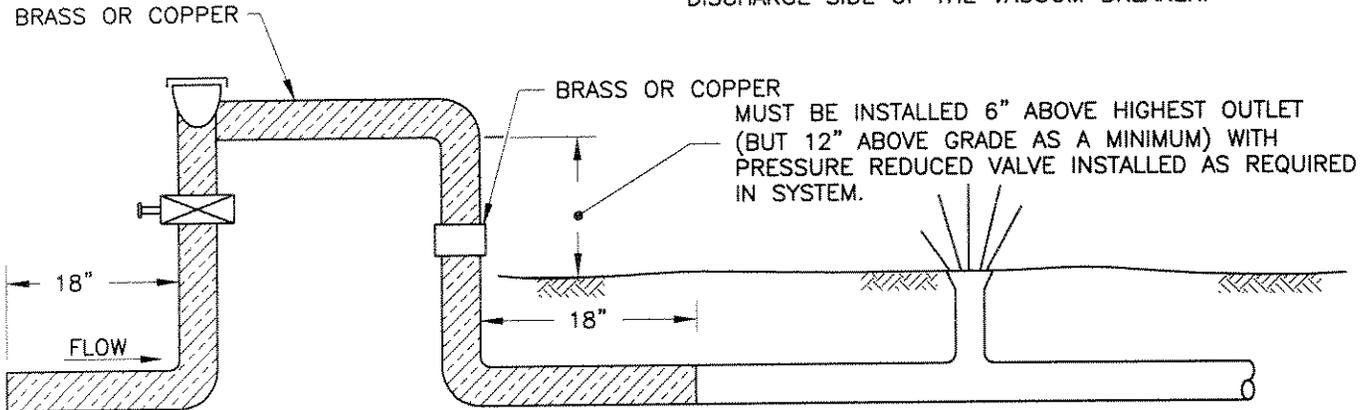

**ATMOSPHERE VACUUM BREAKER INSTALLATION**

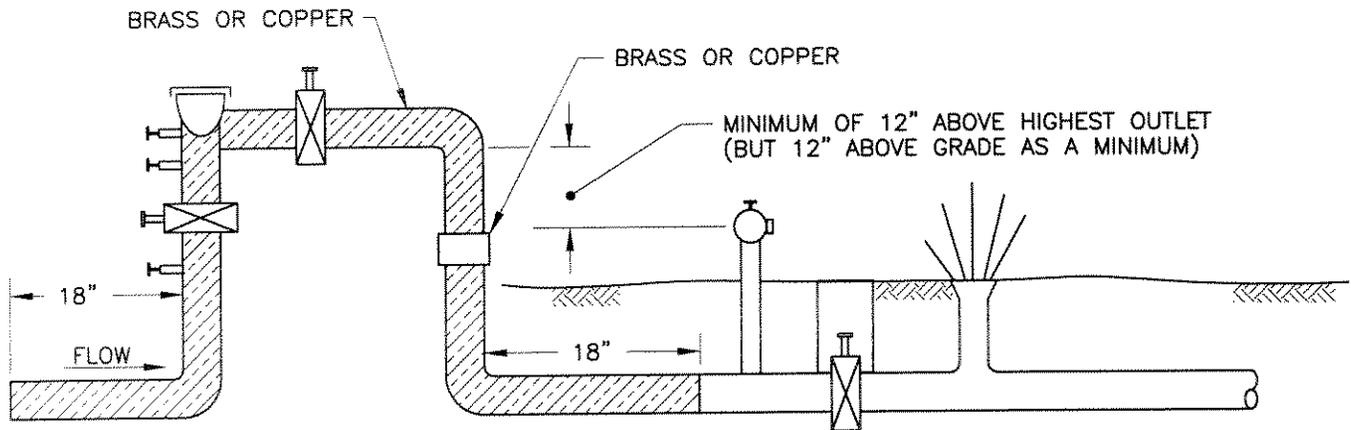

**PRESSURE VACUUM BREAKER INSTALLATION**

**GENERAL INSTALLATION REQUIREMENTS:**


THE BACKFLOW PREVENTION ASSEMBLY SHALL BE INSTALLED ON THE PROPERTY SIDE OF AND ADJACENT TO THE METER. SUPPLY PIPELINE BETWEEN THE METER AND THE PROTECTIVE ASSEMBLY MUST BE EXPOSED FOR INSPECTION BY THE WATER PURVEYOR. A DEVIATION MAY BE GRANTED UNDER CERTAIN CIRCUMSTANCES, FOR EXAMPLE, WHERE THE LINE PASSES UNDER THE SIDEWALK OR PAVING. THE PROTECTIVE ASSEMBLY SHOULD BE INSTALLED 12" OR MORE ABOVE HIGH WATER LEVEL OF SURROUNDING GROUND, UNLESS OTHERWISE SPECIFICALLY APPROVED BY THE CITY OF NORCO. ALSO, THE ASSEMBLY MUST BE PROTECTED FROM VEHICULAR TRAFFIC AND SHALL IN NO WAY INTERFERE WITH THE PEDESTRIAN RIGHT-OF-WAY. THERE MUST BE NO OUTLET TEE, TAP, OR CONNECTION OF ANY SORT TO OR FROM THE SUPPLY PIPELINE BETWEEN THE METER AND THE PROTECTIVE ASSEMBLY. RECOMMENDATION OF AN APPROVED BACKFLOW ASSEMBLY MAY BE OBTAINED THROUGH THE CITY OF NORCO, PUBLIC WORKS DEPARTMENT AS PUBLISHED BY U.S.C FOUNDATION FOR CROSS CONNECTION CONTROL AND HYDRAULIC RESEARCH.

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:	
							12/15/04
							APPROVED: <i>Joseph S. Schenk</i> 24039 CITY ENGINEER RCE
Drawn By: LJA			Date: 06/30/04				

## INSTALLATION OF BACKFLOW PREVENTION ASSEMBLY

Std. Dwg. No.  
**430B**  
Sheet 1 of 1


# CITY of NORCO STANDARD DRAWING

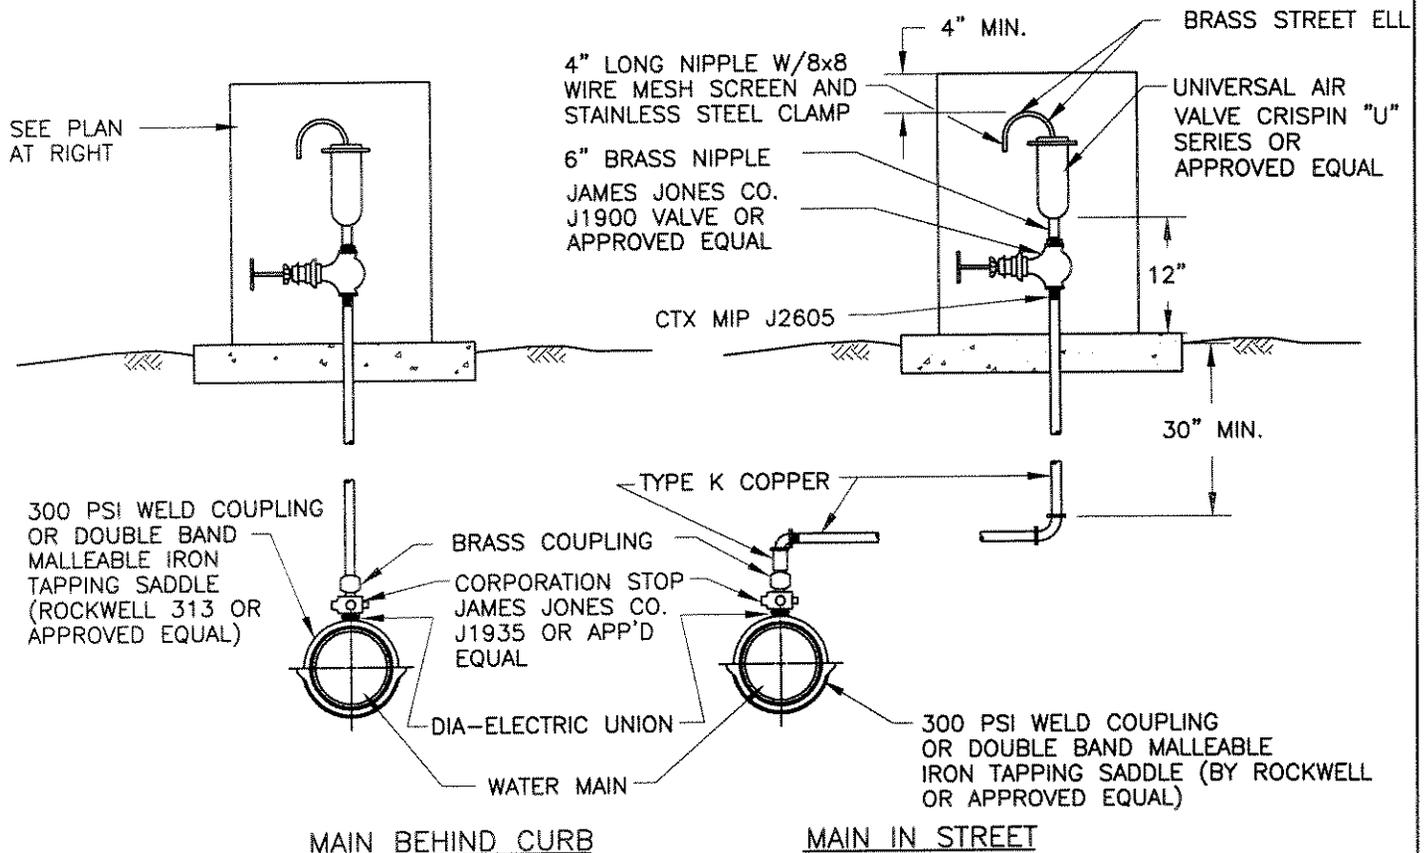

MAIN BEHIND CURB

MAIN IN STREET

ALL COUPLINGS SHALL BE TYPE K SOFT COPPER.

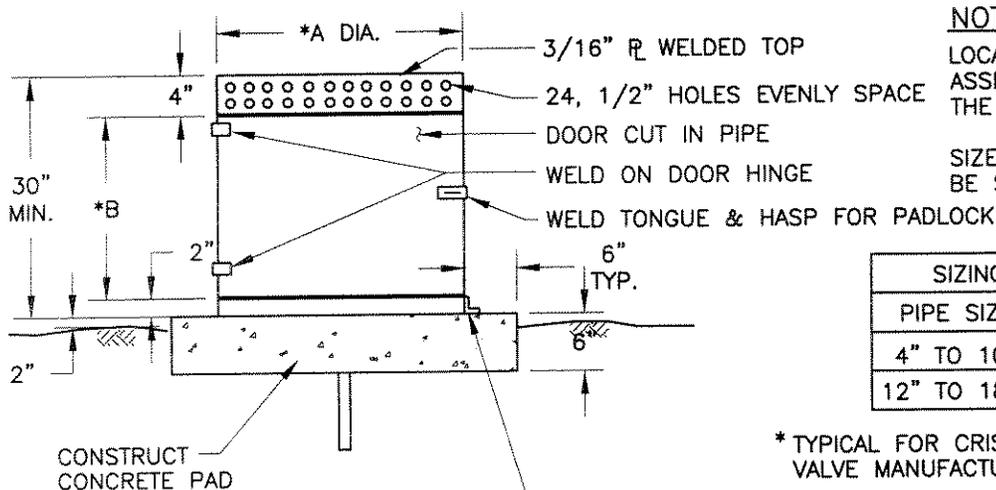

ENCLOSURE DETAIL

**NOTES:**

LOCATION OF UNIVERSAL AIR VALVE ASSEMBLY WILL BE DETERMINED AT THE TIME OF INSTALLATION.

SIZE OF UNIVERSAL AIR VALVE WILL BE SHOWN ON PLANS.

SIZING FOR NORMAL INSTALLATIONS			
PIPE SIZE	*A	*B	VALVE SIZE
4" TO 10"	14"	24"	1"
12" TO 18"	16"	28"	2"

\* TYPICAL FOR CRISPIN VALVES ONLY. SEE VALVE MANUFACTURER FOR ENCLOSURE DIMENSIONS.

2" x 2" x 1/4" CLIP ANGLE  
1/2" ANCHOR BOLTS, GALV.  
3 REQUIRED, EQUALLY SPACED

**NOTE:**


ENCLOSURE SHALL BE PAINTED IN THE SAME MANNER AS THE FIRE HYDRANTS (SEE STD. DWG. NO 445, NOTE 5).

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:	12/16/04	
Drawn By: LJA							Date: 3/19/04	
APPROVED: <i>Joseph S. Schenk</i> 24039							CITY ENGINEER RCE	

## UNIVERSAL AIR VALVE ASSEMBLY

Std. Dwg. No.  
**435**  
Sheet 1 of 1

# CITY of NORCO STANDARD DRAWING

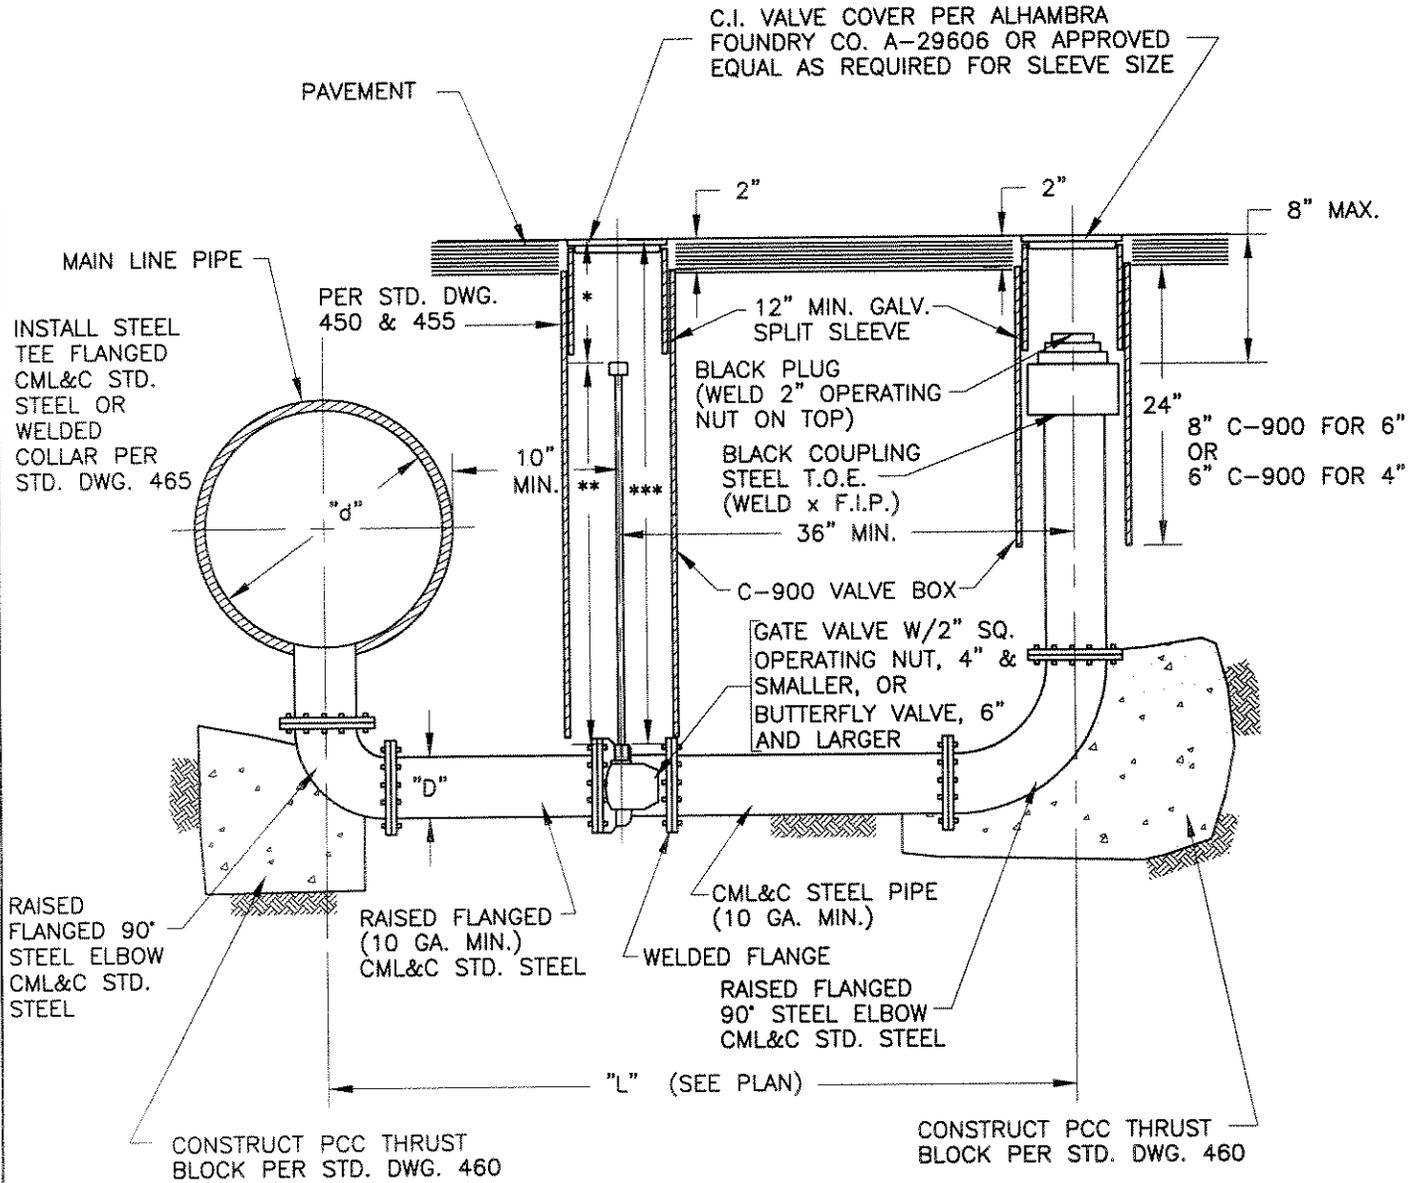

VALVE SIZE	SLEEVE SIZE
2" THRU 8"	6"
9" THRU 24"	8"

\*30" MAX./24" MIN.  
 \*\*12" MIN. VALVE EXTENSION  
 \*\*\*48" MAX. W/O EXTENSION REQUIRED

"d" (MAIN LINE)	"D" (NOMINAL SIZE OF BLOW-OFF PIPE & GATE VALVE)
12" THRU 16"	6"
18" THRU 24"	8"

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:

12/16/04  
 APPROVED: *Joseph S. Schenk* 24039  
 CITY ENGINEER RCE


Drawn By: LJA

Date: 3/19/04

## TRANSMISSION MAIN BLOW OFF ASSEMBLY


Std. Dwg. No.  
**440A**  
 Sheet 1 of 1

# CITY of NORCO STANDARD DRAWING

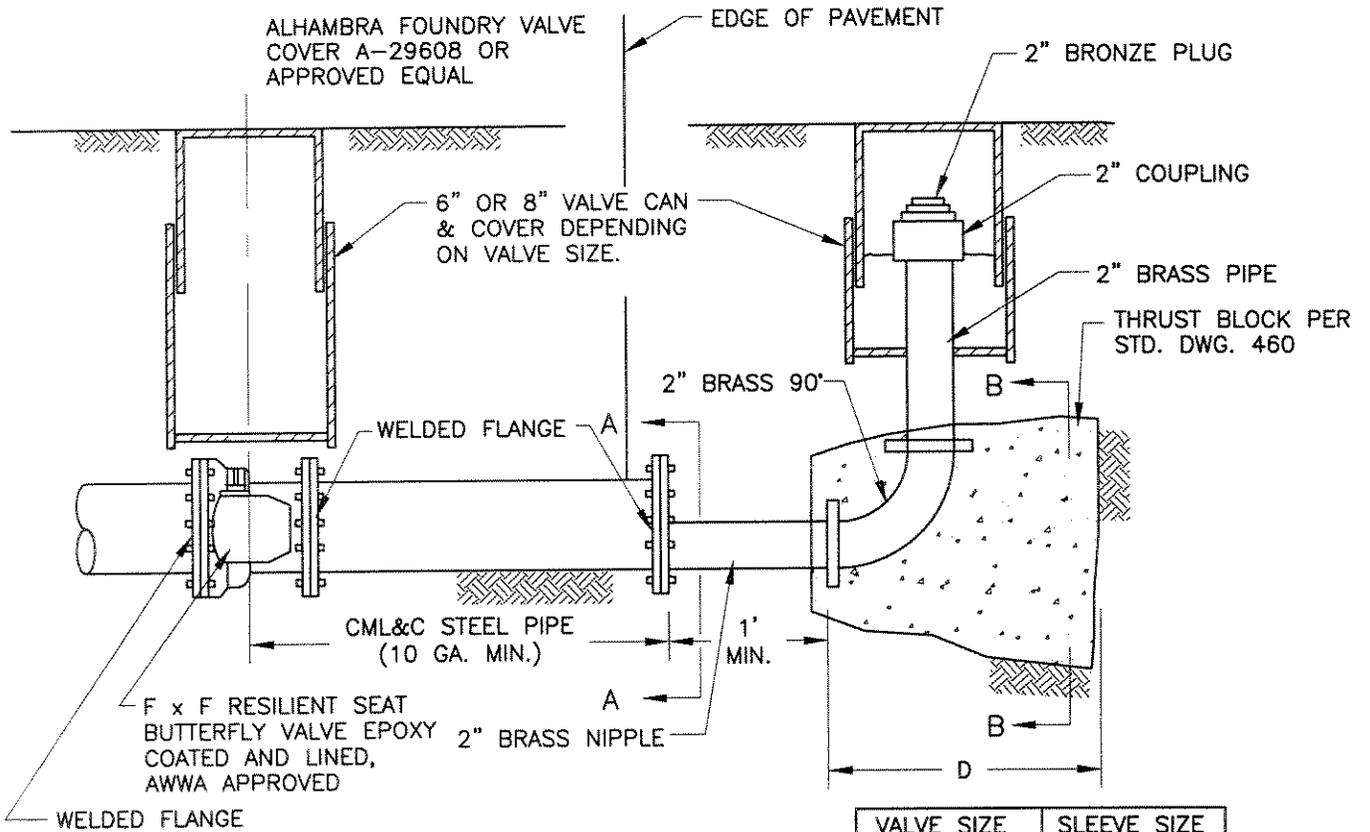

SEE BUTTERFLY VALVE INSTALLATION STD. DWG. 455A

VALVE SIZE	SLEEVE SIZE
2" THRU 8"	6"
10" THRU 24"	8"

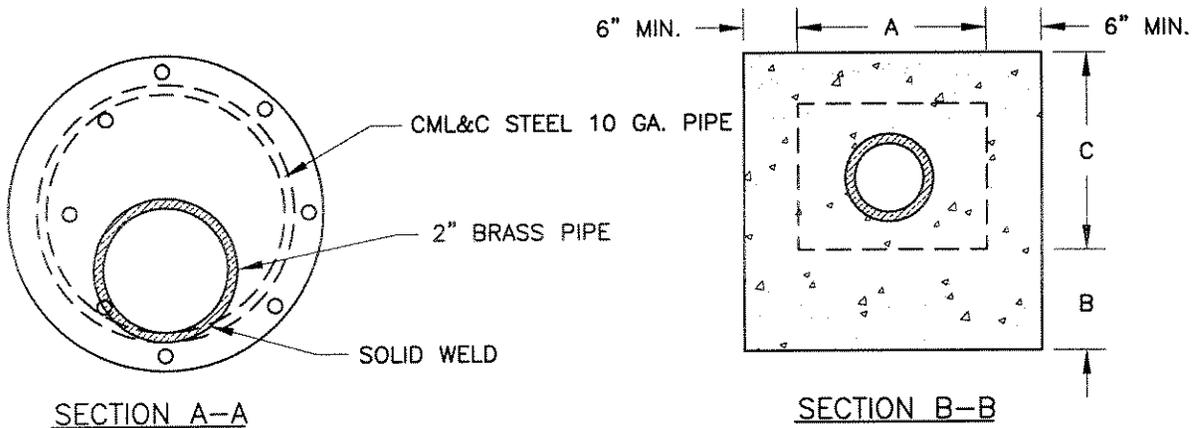

NOTE: ALL JOINTS WITHIN 120 FEET OF SECTION A-A SHALL RECEIVE A FULL WELD.

NOTE:


THE FUTURE EXTENSION STUB SHALL BE TESTED AND CHLORINATED WITH THE REST OF THE MAIN AND BLOWN OFF THROUGH THE 2" PLUG.

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:	12/16/04
							APPROVED: <i>Joseph S. Schenk</i> 24039 CITY ENGINEER RCE
Drawn By: LJA			Date: 3/19/04				
BLOW OFF (FOR FUTURE EXTENSION)							Std. Dwg. No. <b>440B</b> Sheet 1 of 1

# CITY of NORCO STANDARD DRAWING

NOTE:

(A) FRONT OF METER BOX TO BE LOCATED 4" BEHIND BACK OF CURB OR AS DIRECTED BY THE CITY ENGINEER.

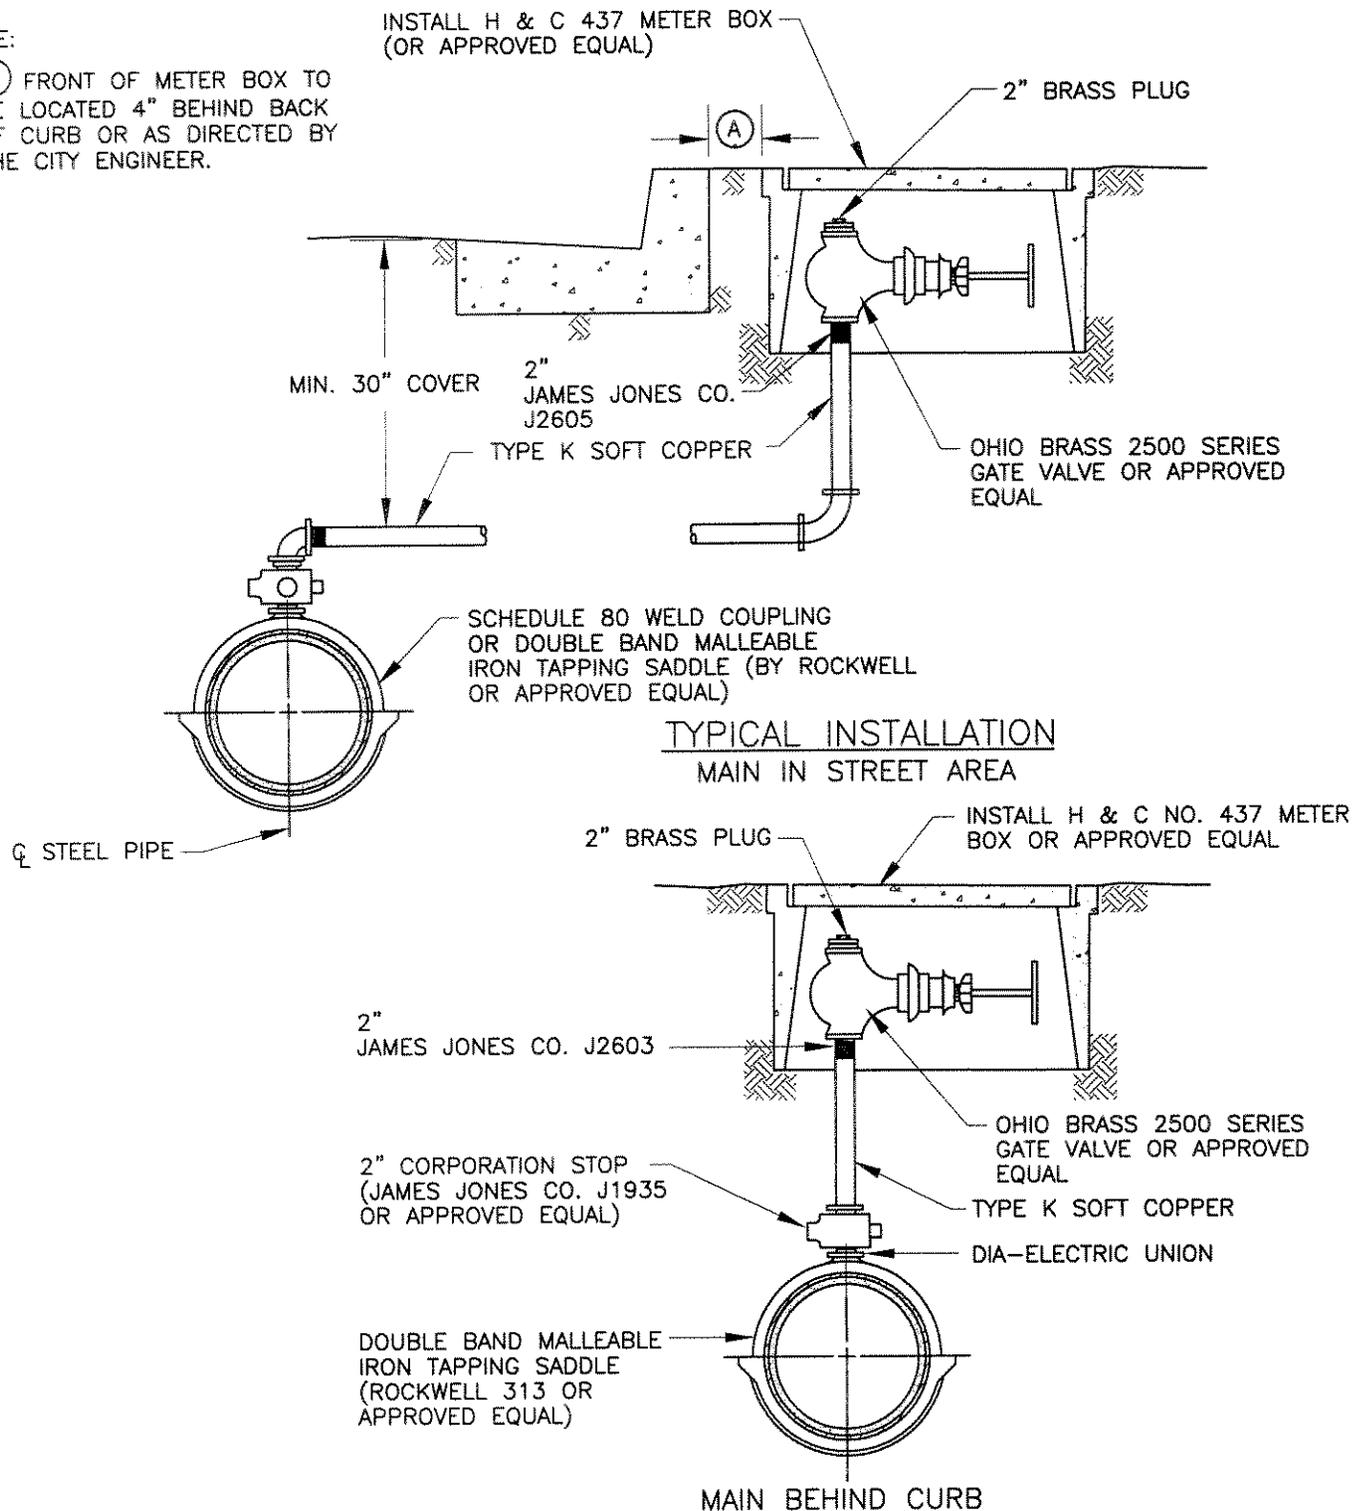


ALL COUPLINGS SHALL BE RED BRASS OR APPROVED EQUAL.

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:	12/16/04
							APPROVED: <i>Joseph S. Scheub</i> 24039 CITY ENGINEER
Drawn By: LJA			Date: 3/19/04			RCE	

## 2" BLOW OFF ASSEMBLY

Std. Dwg. No.  
**440C**  
Sheet 1 of 1

# CITY of NORCO STANDARD DRAWING

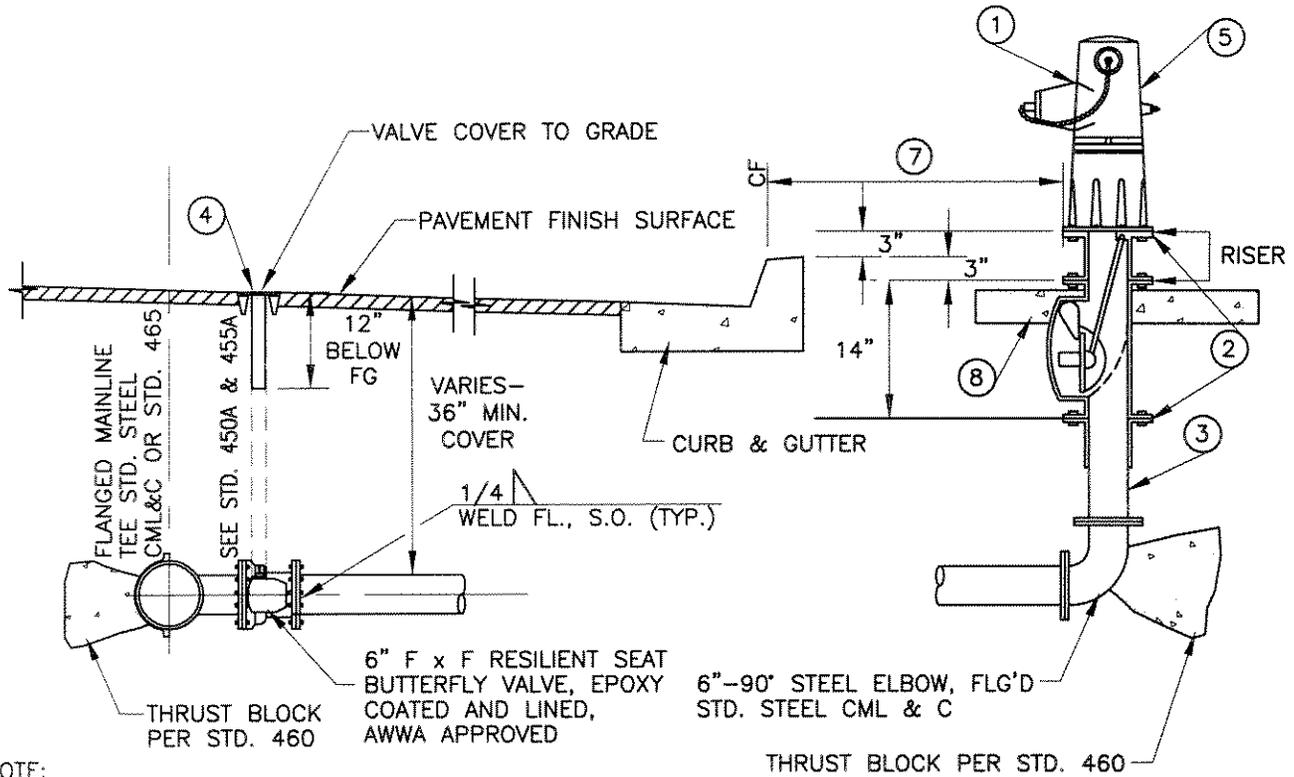

**NOTE:**

- ① TYPE "A" — FOR RESIDENTIAL ZONES — HYDRANT COMPLETE, ONE 4" STEAMER HOSE OUTLET AND ONE 2-½" OUTLET, 8 HOLE PATTERN, JAMES JONES MODEL J-3710. FURNISH WITH PLASTIC CAPS AND CHAIN. 4" OUTLET PERPENDICULAR TO CURB.
- TYPE "B" — FOR COMMERCIAL ZONES — HYDRANT COMPLETE, ONE 4" STEAMER HOSE OUTLET AND TWO 2-½" OUTLETS, 8 HOLE PATTERN. JAMES JONES MODEL J-3765. FURNISH WITH PLASTIC CAPS AND CHAIN. 4" OUTLET PERPENDICULAR TO CURB.
- ② 6" HYDRANT 8 HOLE SHEAR CHECK ASSEMBLY COMPLETE, EPOXY COATED, MFG. BY CLOW CORP. OR APPROVED EQUAL.
- ③ 6" A.S.A. 200# FLG X FLG 8 HOLE CML & C PIPE SPOOL.
- ④ CAST IRON VALVE COVER TO BE ALHAMBRA FOUNDRY #A29606 OR APPROVED EQUAL, MARKED WATER.
- ⑤ ALL EXPOSED SURFACES SHALL BE CLEANED AND GIVEN ONE COAT OF PRIMER NO. 2182 AS MANUFACTURED BY RUSTOLEUM CORP. AND ONE FINISH COAT OF NO. 2148 EQUIPMENT YELLOW AS MANUFACTURED BY RUSTOLEUM CORP. ON-SITE HYDRANTS FINISH COAT RED.
- ⑥ HYDRANTS SHALL BE INSTALLED NOT CLOSER THAN 5' FROM A DRIVEWAY OR STREET LIGHT, POWER POLE, SIGNAL, BEGIN CURB RETURNS, ETC.
- ⑦ 24" UNLESS OTHERWISE DIRECTED BY THE CITY ENGINEER.
- ⑧ POUR 6"D X 4'L X 4'W CONCRETE PAD. ALLOW ACCESS TO BOLTS.
- ⑨ INSTALL RAYOLITE BLUE PAVEMENT MARKER NO. 2SRPM-DB 6" OFF STREET  $\phi$  ON HYDRANT SIDE DIRECTLY IN FRONT OF HYDRANT PER CITY STD. DWG. NO. 446.

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:

12/16/04

APPROVED: *Joseph S. Schenk* 24039  
CITY ENGINEER RCE

Drawn By: LJA


Date: 3/19/04

## FIRE HYDRANT ASSEMBLY


Std. Dwg. No.  
**445**  
Sheet 1 of 1

# CITY of NORCO STANDARD DRAWING

**FIGURE 1  
TWO LANE STREET**

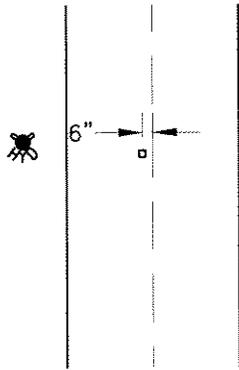

**FIGURE 2  
MULTI-LANE STREET**

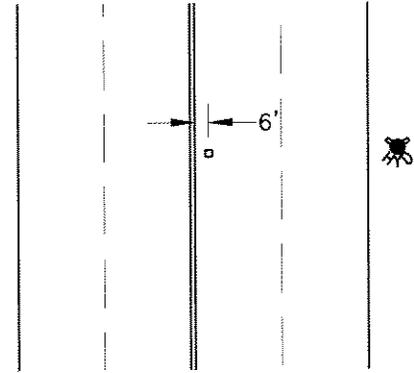

**LEGEND**




FIRE HYDRANT




BLUE PAVEMENT MARKER


**FIGURE 3  
AN INTERSECTION**

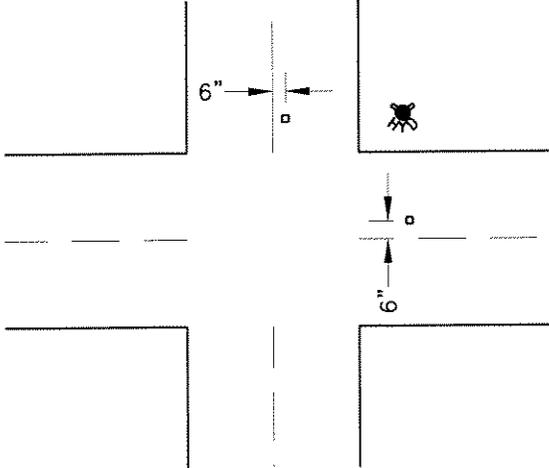


**FIGURE 4  
FOUR LANE STREET WITH TURN LANE AT INTERSECTION**

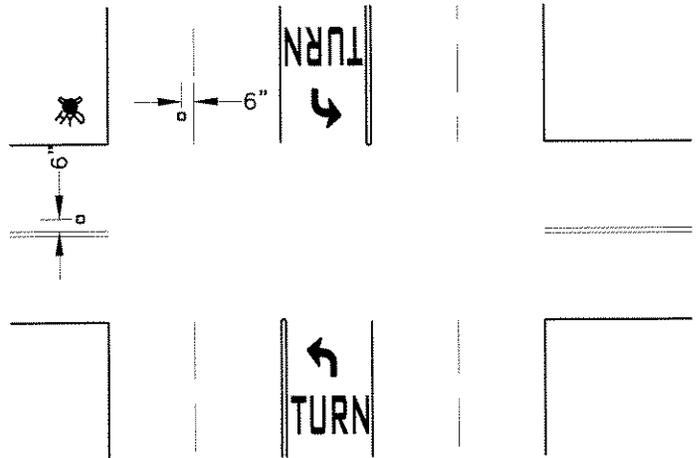

**FIGURE 5  
MULTI-LANE STREET WITH  
2-WAY TURN LANE**

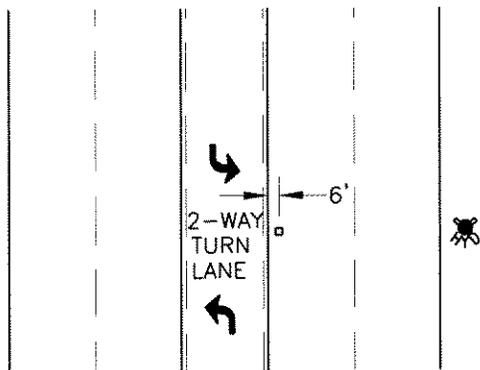

**FIGURE 6  
FREEWAYS AND EXPRESSWAYS**

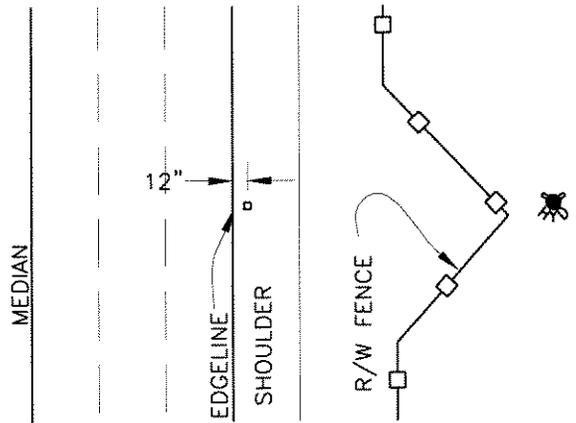


REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:	1/25/05  APPROVED: <i>Joseph S. Schenk</i> 24039 CITY ENGINEER RCE	
Drawn By: LJA			Date: 01/26/05					

## TYPICAL HYDRANT MARKER LOCATION

Std. Dwg. No.  
**446**  
Sheet 1 of 1



# CITY of NORCO STANDARD DRAWING

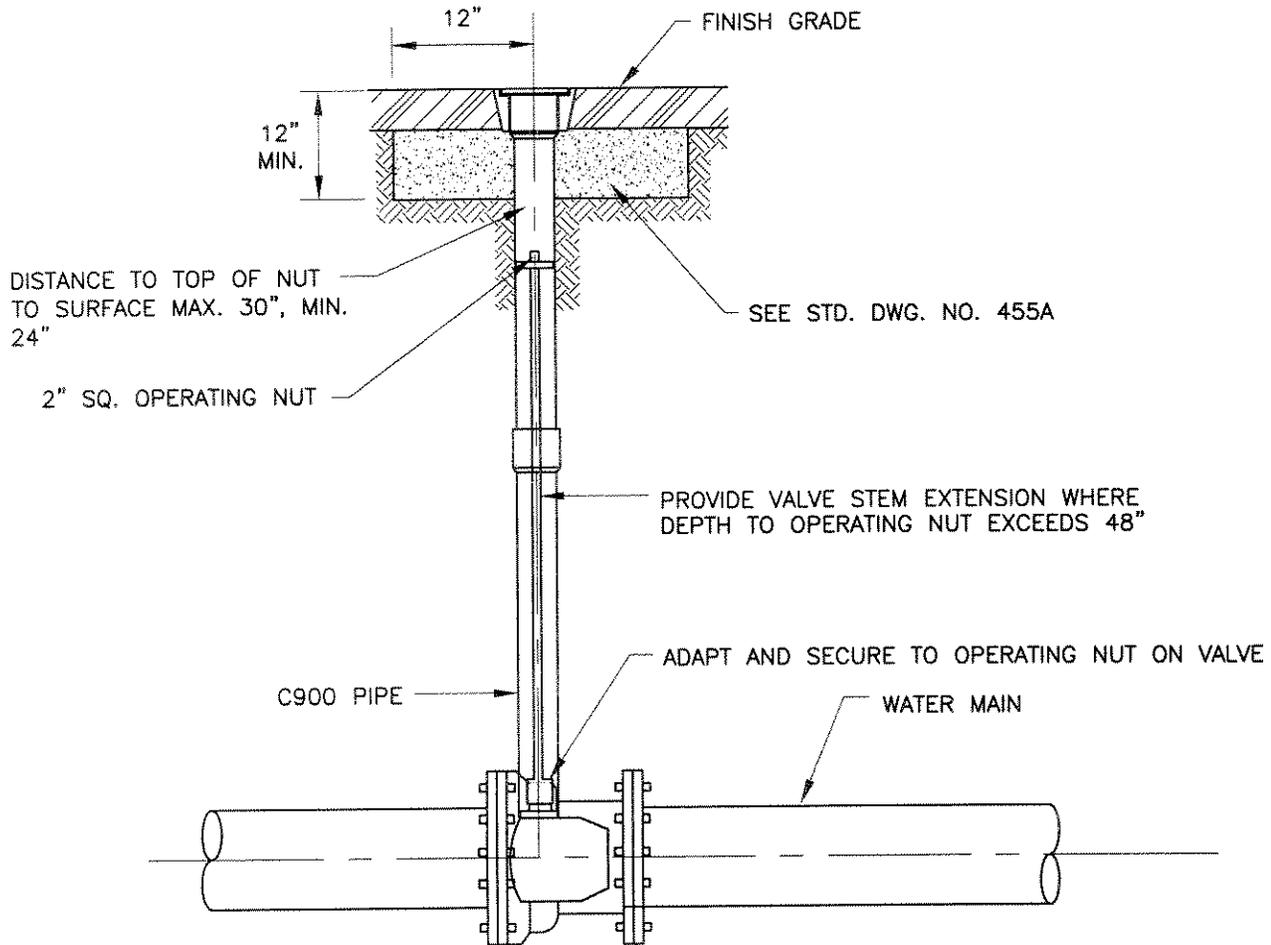


REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:	12/10/04
							APPROVED: <i>Joseph S. Schenk</i> 24039 CITY ENGINEER RCE
Drawn By: LJA			Date: 3/19/04				

## BUTTERFLY VALVE EXTENSION

Std. Dwg. No.  
**451**  
Sheet 1 of 1

# CITY of NORCO STANDARD DRAWING

VALVE SIZE	SLEEVE SIZE
2" THRU 8"	6"
10" THRU 24"	8"

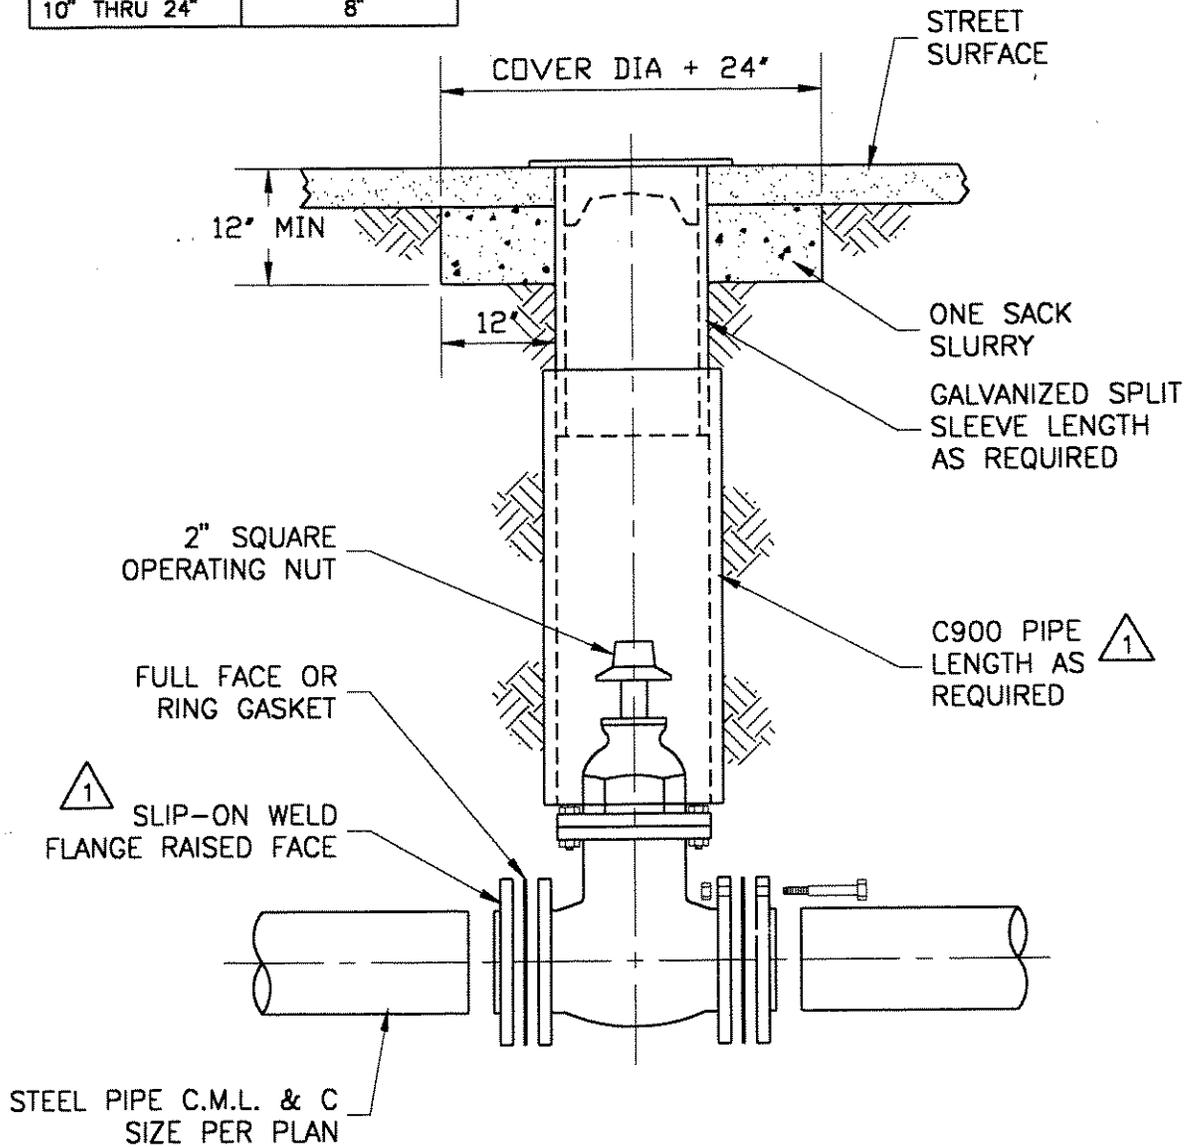

NOTE: 4" WATER VALVES SHALL BE RESILIENT SEAT WEDGE VALVES EPOXY LINED AND COATED AWWA APPROVED. 6" AND LARGER SHALL BE RESILIENT TYPE BUTTERFLY VALVES EPOXY LINED AND COATED AND AWWA APPROVED.

<sup>1</sup>

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:
	1	JS	7/21/00			

Drawn By: M Partida

Date: 11/02/99

APPROVED: *Joseph S. Schenk*  
CITY ENGINEER RCE 24039


## GATE VALVE and BOX

Std. Dwg. No.

**455**

Sheet 1 of 1

# CITY of NORCO STANDARD DRAWING

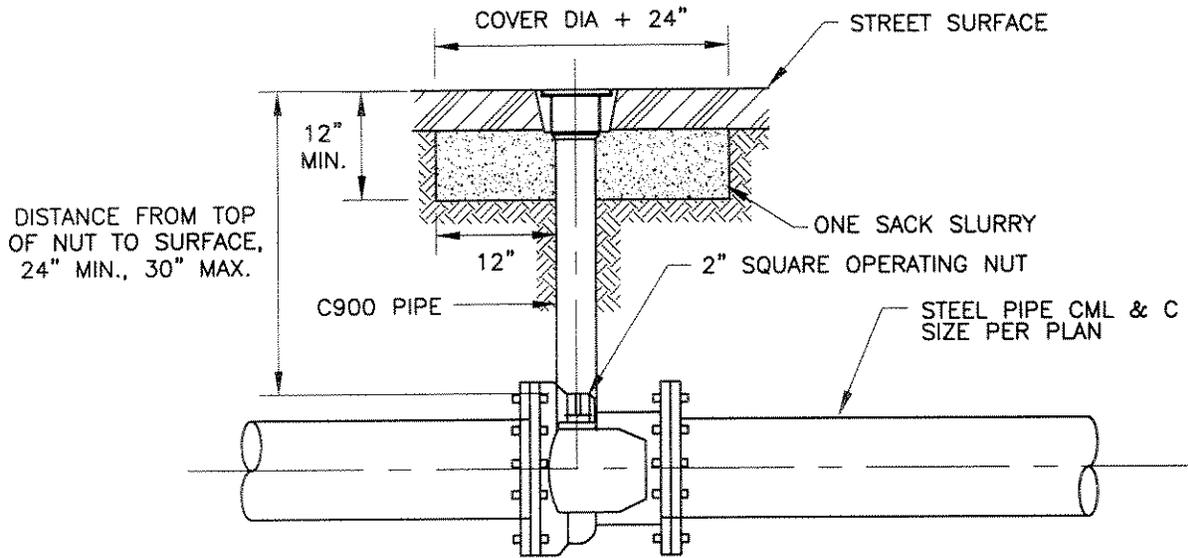


REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:		
							12/16/04	
Drawn By: LJA							Date: 3/19/04	APPROVED: <i>Joseph S. Schenk</i> 24039 CITY ENGINEER RCE

## BUTTERFLY VALVE AND BOX

Std. Dwg. No.  
**456**  
Sheet 1 of 1

# CITY of NORCO STANDARD DRAWING

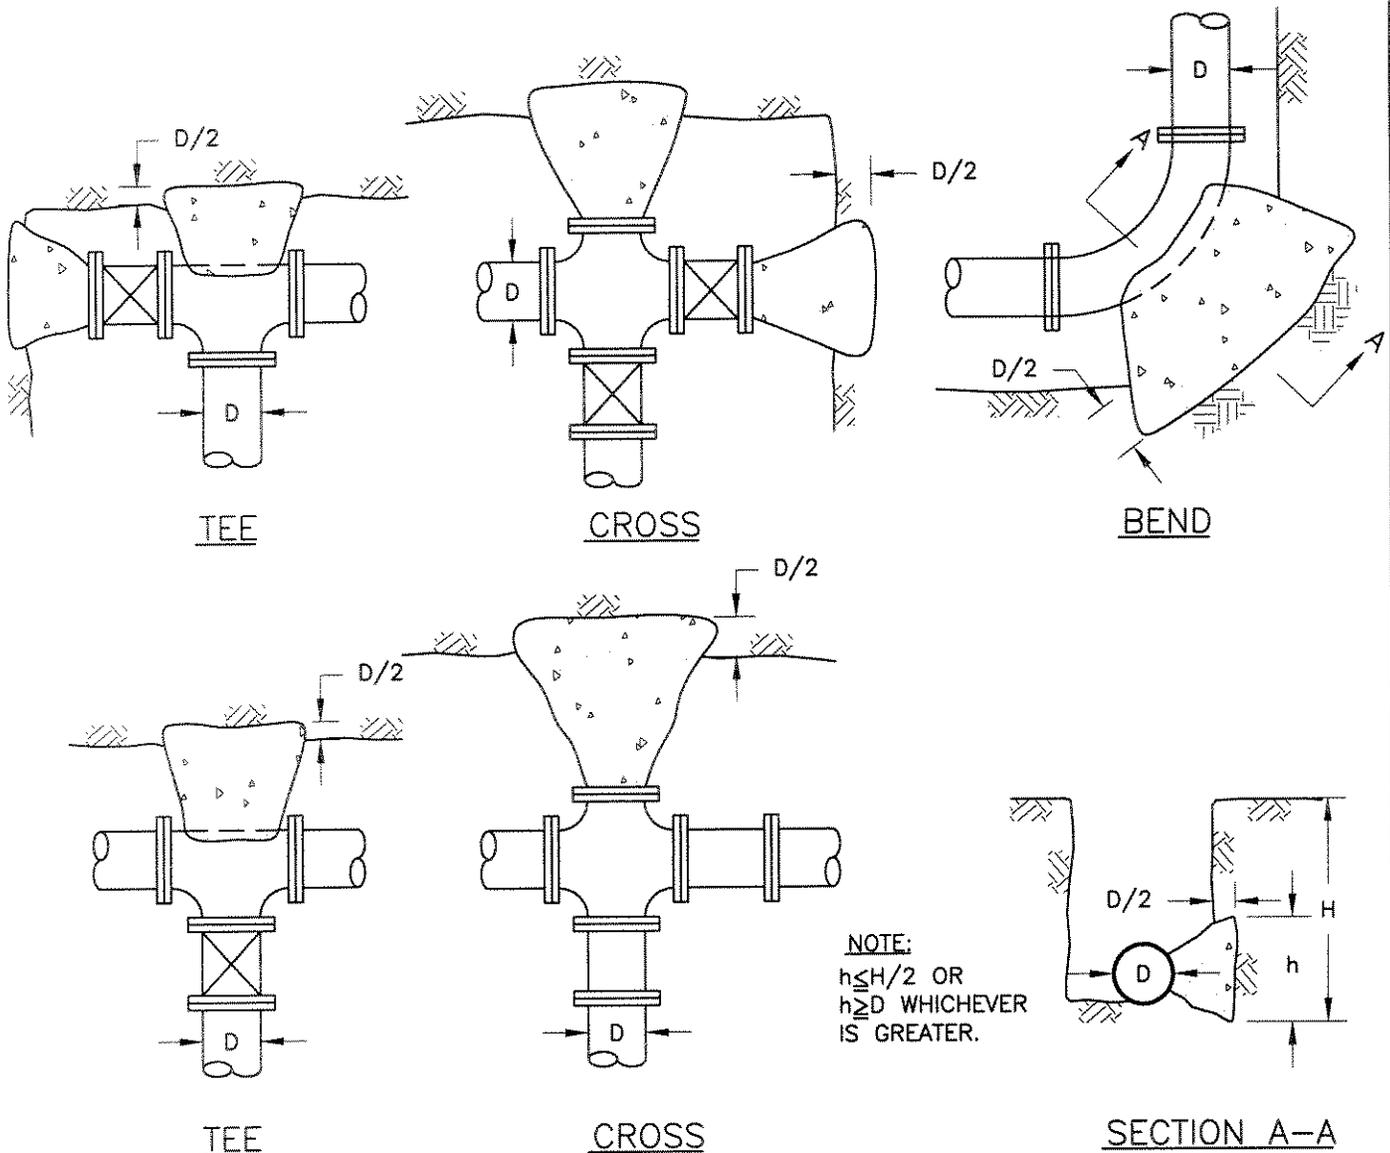

**NOTES:**

1. CONCRETE SHALL BE 420-C-2000.
2. THRUST BLOCKS SIZED FOR TEST PRESSURE AT 200 PSI WITH A SOIL BEARING PRESSURE VALUE OF 1500 PSF.
3. THRUST BLOCKING SHALL BE PLACED SO THE PIPE AND FITTING JOINTS WILL BE ACCESSIBLE FOR REPAIR.
4. THRUST BLOCK SHALL BE POURED AGAINST UNDISTURBED SOIL.
5. ALL WATER MAINS SHALL BE CEMENT MORTAR LINES AND CEMENT COATED STEEL, 10 GA. MIN.



BEARING AREA OF THRUST BLOCK (FT <sup>2</sup> )					
PIPE SIZE	TEES/ ENDS	90°	45°	22 ½%	11 ¼%
4"	2.5	3.5	2.0	N.A.	N.A.
6"	5.0	7.0	4.0	2.0	N.A.
8"	8.5	12.0	6.5	3.5	N.A.
10"	13.0	18.5	10.0	5.0	2.5
12"	18.5	25.5	14.0	7.0	3.5
14"	24.5	35.0	19.0	10.0	5.0
16"	32.0	45.0	24.0	12.5	6.0
18"	40.0	56.0	30.5	15.5	8.0
20"	49.0	69.0	37.5	19.0	10.0
24"	70.0	98.5	53.5	27.5	13.5

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:	12/16/04
							APPROVED: <i>Joseph J. Schenk</i> 24039 CITY ENGINEER RCE
Drawn By: LJA			Date: 3/19/04				

## THRUST BLOCKS

Std. Dwg. No.  
**460**  
 Sheet 1 of 1

# CITY of NORCO STANDARD DRAWING

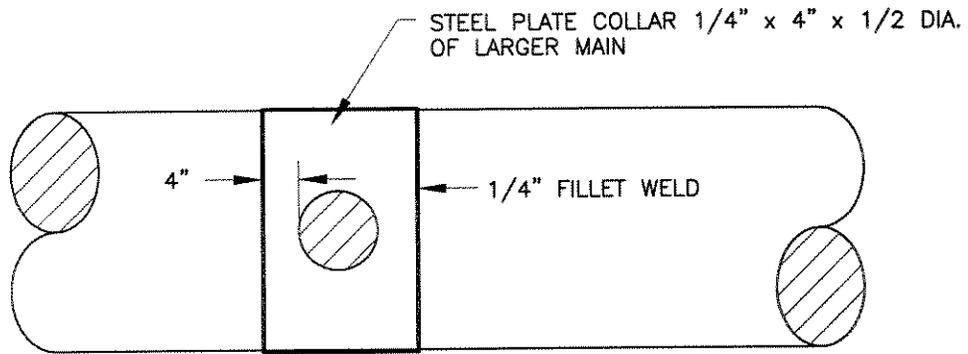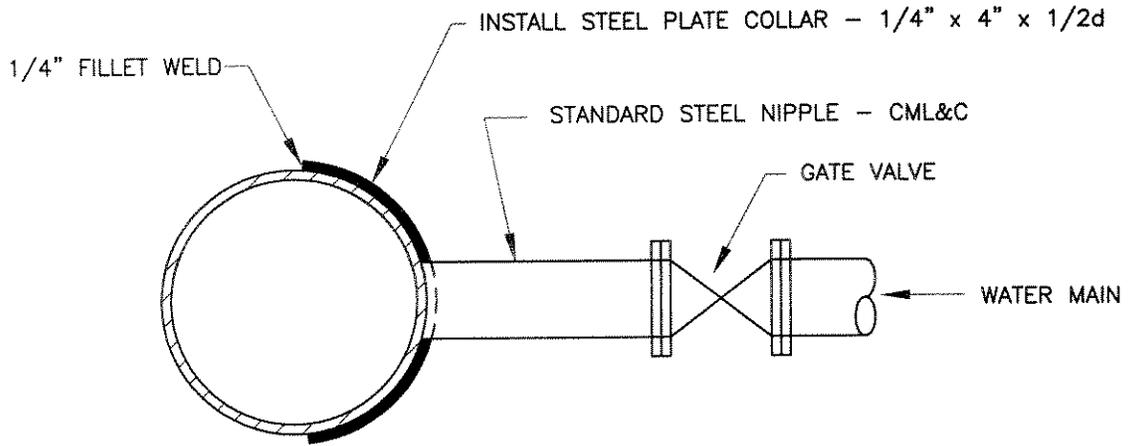


**NOTE:**

WHEN A VALVE IS INSTALLED ON A MAIN, A WELD COLLAR WILL BE INSTALLED ON PIPE AROUND NIPPLE.

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:	12/10/04  APPROVED: <i>Joseph S. Schenk</i> 24039 CITY ENGINEER RCE
Drawn By: LJA			Date: 3/19/04				
<b>WELD COLLAR</b>							Std. Dwg. No. <b>465</b> Sheet 1 of 1

# CITY of NORCO STANDARD DRAWING

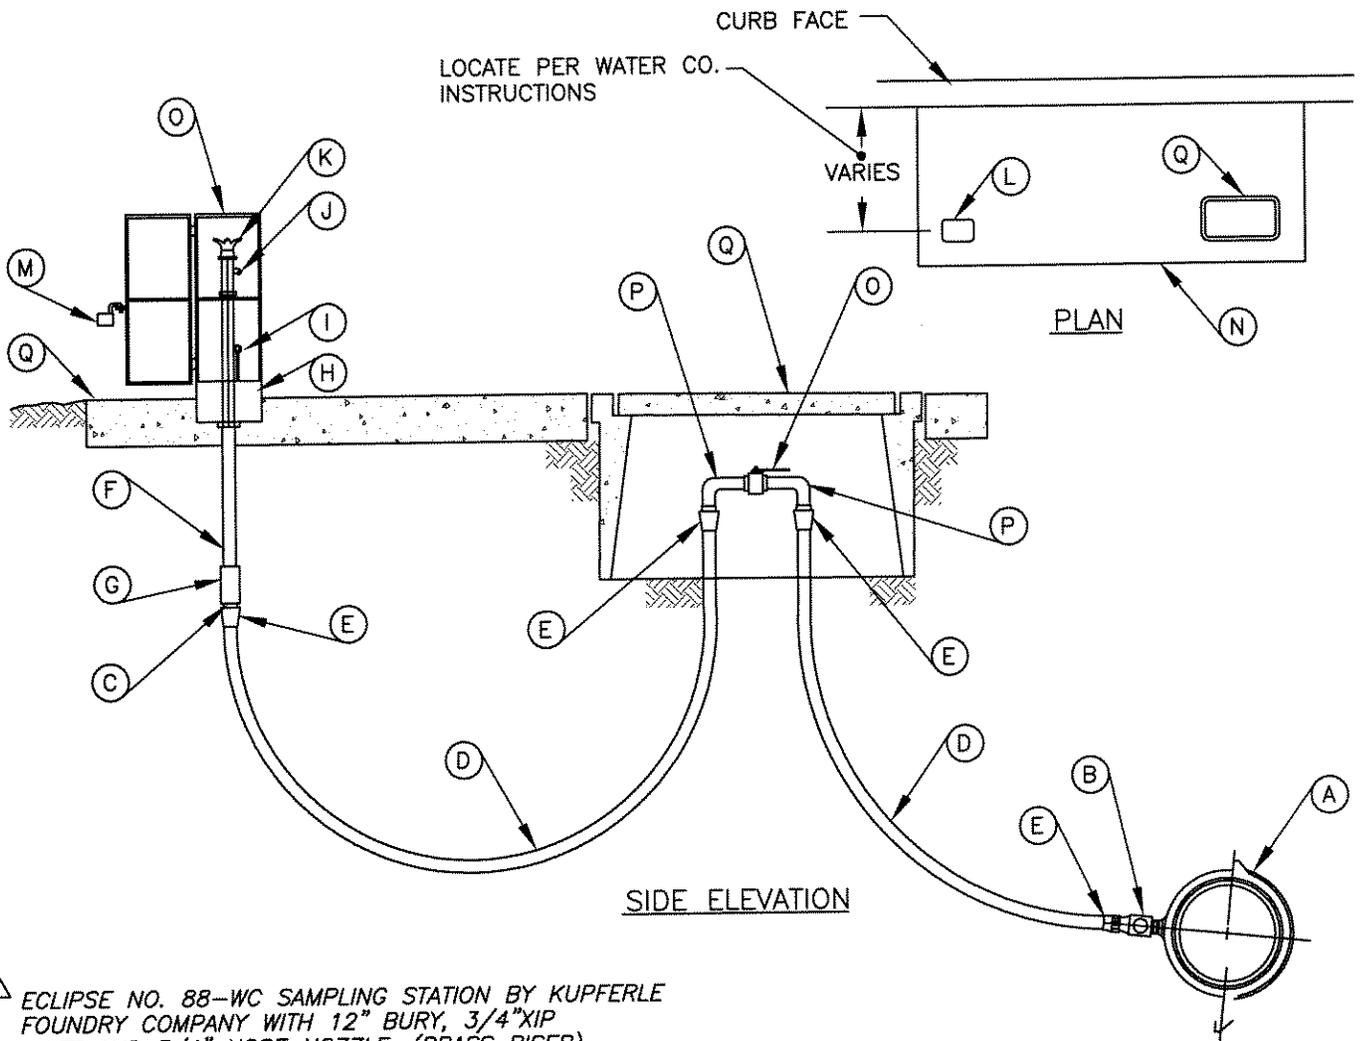

△ ECLIPSE NO. 88-WC SAMPLING STATION BY KUPFERLE  
 FOUNDRY COMPANY WITH 12" BURY, 3/4" XIP  
 INLET AND 3/4" HOSE NOZZLE. (BRASS RISER)

## DESCRIPTION

(A) SCHEDULE 80 COUPLING OR ROCKWELL MODEL 238 TAPPED FULL CIRCLE CLAMP, NPT SINGLE BAND (B) 1" BRASS CORPORATION STOP J-3403 (1" IPS x 1" CT COMPRESSION) (C) 3/4" MALE x 1" FEMALE BRASS BUSHING (D) 1" TYPE K SOFT COPPER TUBING (E) 1" BRASS MALE IRON PIPE THREAD x CT COMPRESSION J-2605 △(F) 3/8" BRASS PIPE INSIDE 1" BRASS PIPE △(G) BRASS VALVE BODY & ASSEMBLY △(H) ALUMINUM BASE △(I) BRASS PET COCK	△(J) BRASS NOZZLE WITH THREADS △(K) IRON HANDLE △(L) SAMPLING STATION CAST ALUMINUM COVER △(M) PADLOCK PROVISION (N) 2'-6" x 4'-6" x 4" THICK CONCRETE PAD (O) 1" BRASS CURB STOP, TEFLON COATED BALL VALVE W/LEVER HANDLE, JONES MODEL #J-1905 (P) 1" BRASS STREET ELBOW (TOTAL OF 2) (Q) CONCRETE METER BOX & COVER #437 1PC LID
--	---

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:

Drawn By: LJA

Date: 04/15/04

APPROVED: *Joseph Schenk* 24039  
 CITY ENGINEER RCE


## SAMPLING STATION

Std. Dwg. No.  
**470**  
 Sheet 1 of 1

# **500 SEWER STANDARDS**



# CITY of NORCO STANDARD DRAWING

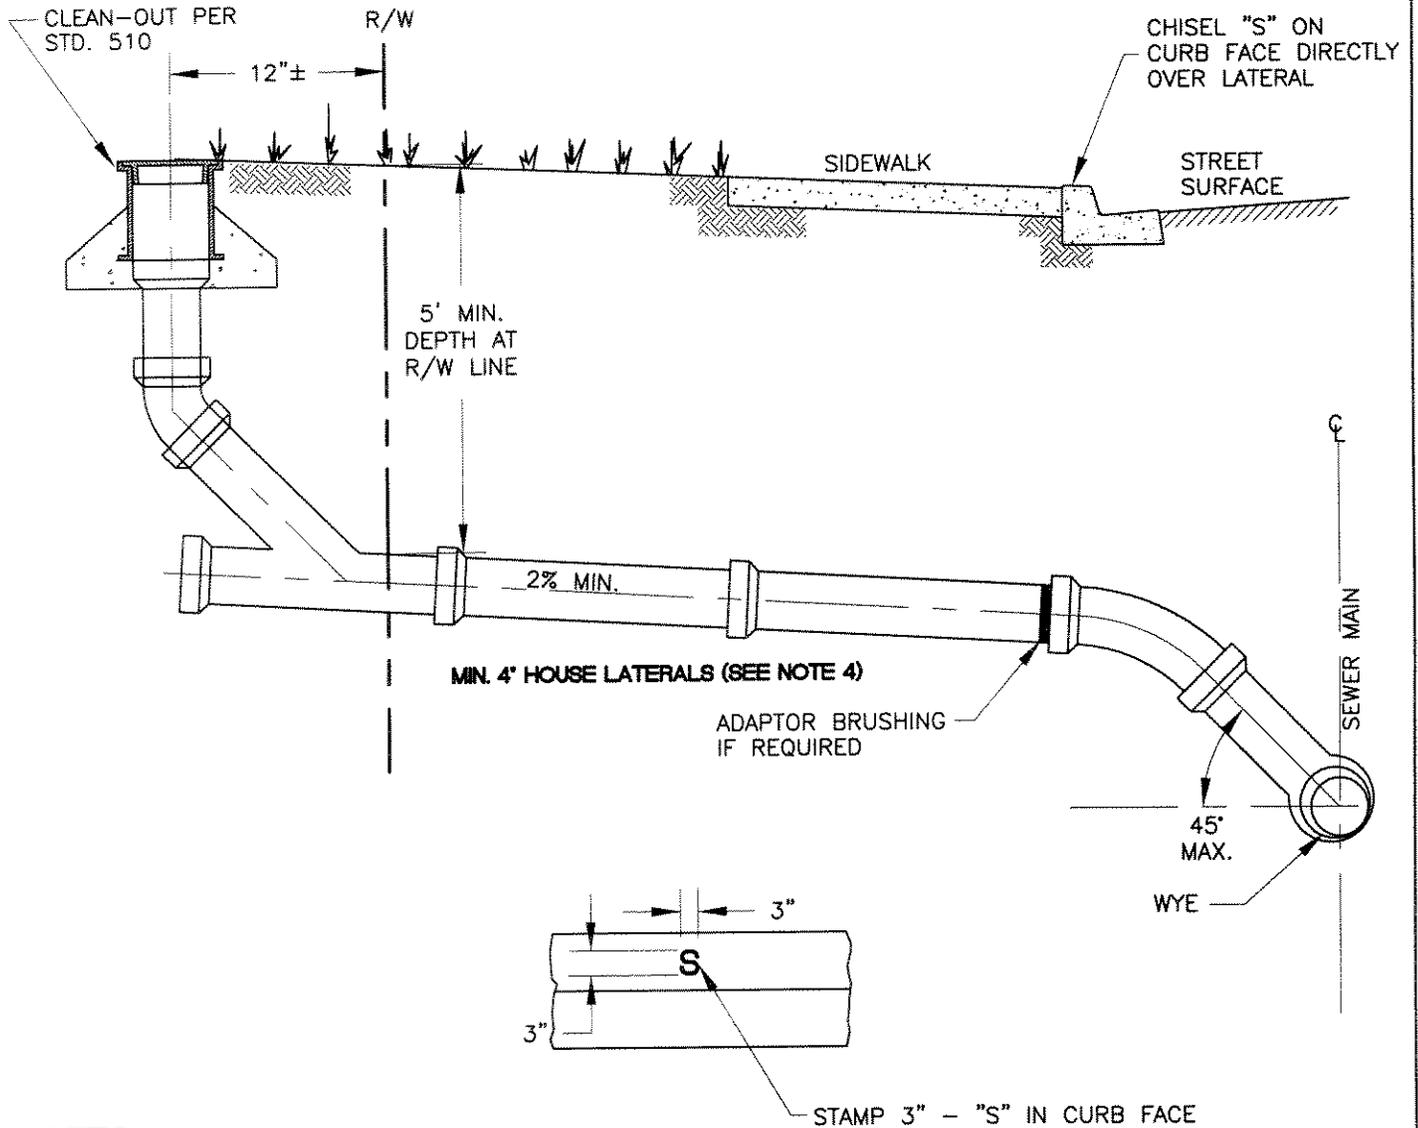

**NOTES:**


- ① LATERALS SHALL BE LAID 90 DEGREES TO MAIN.
- ② MINIMUM SLOPE IS 1/4" / FT, OR 2%. ANY VARIANCE MUST BE APPROVED BY THE CITY ENGINEER.
- ③ WHEN SEWER CONNECTION IS CONSTRUCTED IN THE VICINITY OF A WATERMAIN, SEE STD. DWG. 400 A & B FOR REQUIREMENTS.
- ④ MINIMUM 6" LATERAL IS REQUIRED FOR INDUSTRIAL AND MAJOR COMMERCIAL DEVELOPMENT (VCP).
- ⑤ LATERALS SHALL NOT BE CONSTRUCTED BENEATH A DRIVEWAY APPROACH.
- ⑥ ALL LATERALS SHALL BE VCP BELL AND SPIGOT.

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:	12/16/04
							APPROVED: <i>Joseph S. Schenk</i> 24039 CITY ENGINEER
Drawn By: LJA			Date: 3/19/04			RCE	

## SEWER SADDLE AND LATERALS

Std. Dwg. No.  
**500A**  
Sheet 1 of 1

# CITY of NORCO STANDARD DRAWING

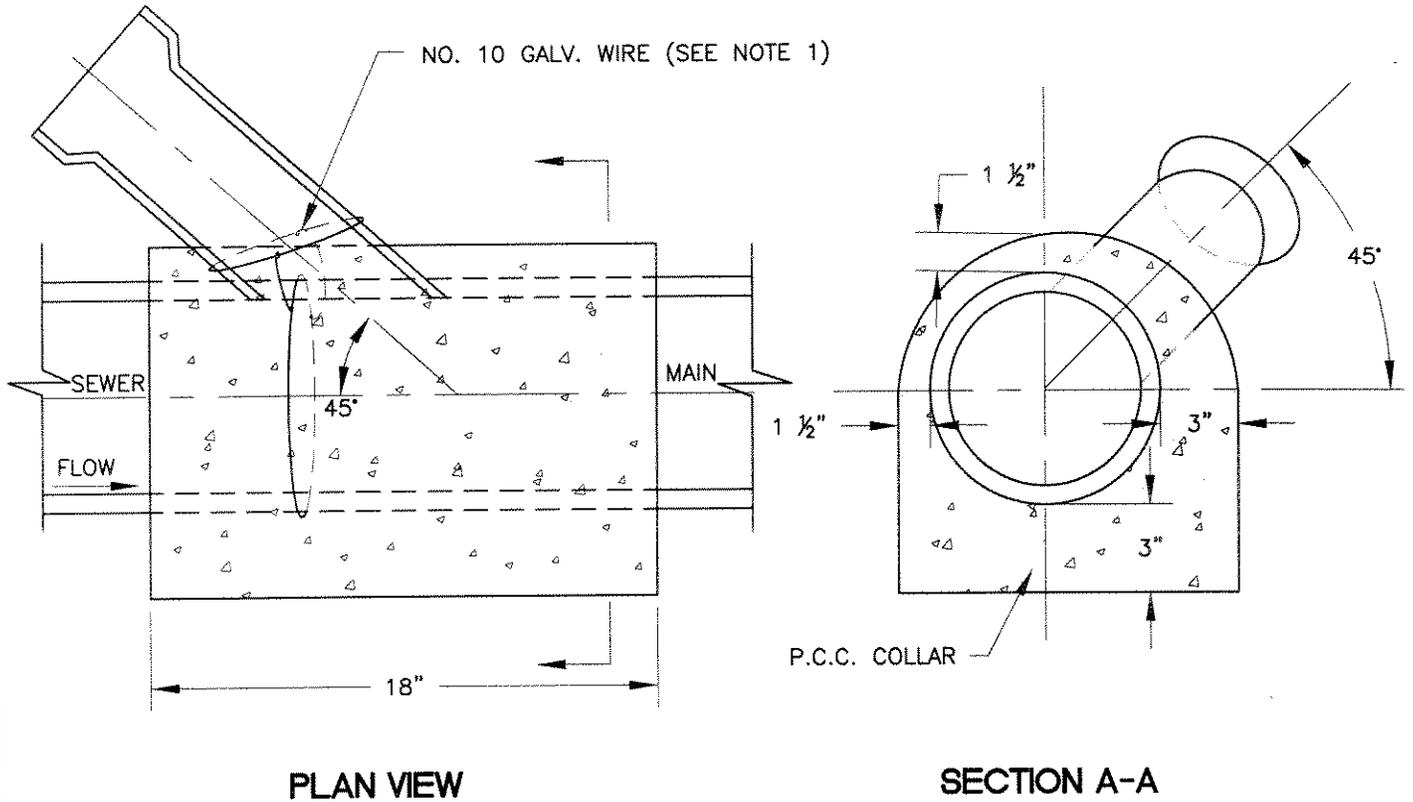

**NOTES:**


- ① STUB SHALL BE SECURED TO SEWER MAIN WITH #10 GALVANIZED WIRE AND EPOXY DURING CONSTRUCTION OF P.C.C. COLLAR.
- ② MAIN LINE SHALL BE BROKEN OUT FOR SADDLE, ONLY DURING THE PRESENCE OF THE PUBLIC WORKS INSPECTOR.
- ③ CONCRETE SHALL BE CLASS 560-C-3250.
- ④ NEW WYE REQUIRED WHEN DIAMETER OF LATERAL EXCEEDS 1/2 DIAMETER OF MAIN LINE PIPE.

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:	
						12/22/04	
Drawn By: LJA						Date: 3/19/04	APPROVED: <i>Ralph S. Schenk</i> 24039 CITY ENGINEER RCE

## SEWER SADDLE AND LATERALS

Std. Dwg. No.  
**500B**  
Sheet 1 of 1

# CITY of NORCO STANDARD DRAWING

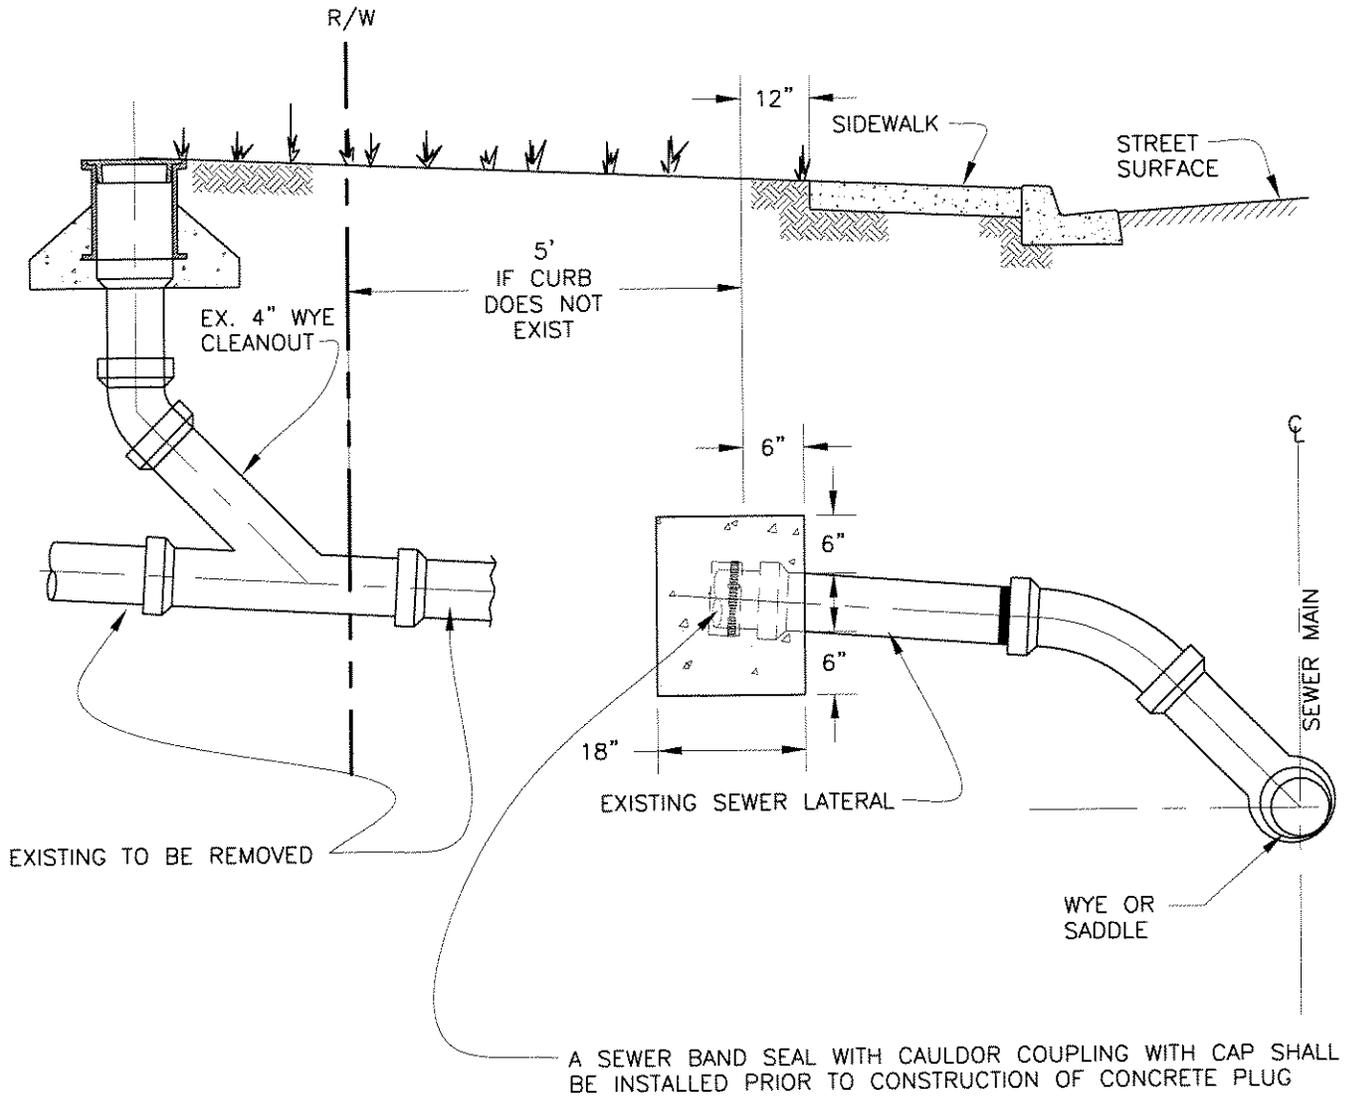

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:

Drawn By: LJA

Date: 01/04/05


1/4/05

APPROVED: *Joseph S. Schenk* 24039  
CITY ENGINEER RCE

## SEWER LATERAL ABANDONMENT

Std. Dwg. No.  
**505**  
Sheet 1 of 1

# CITY of NORCO STANDARD DRAWING

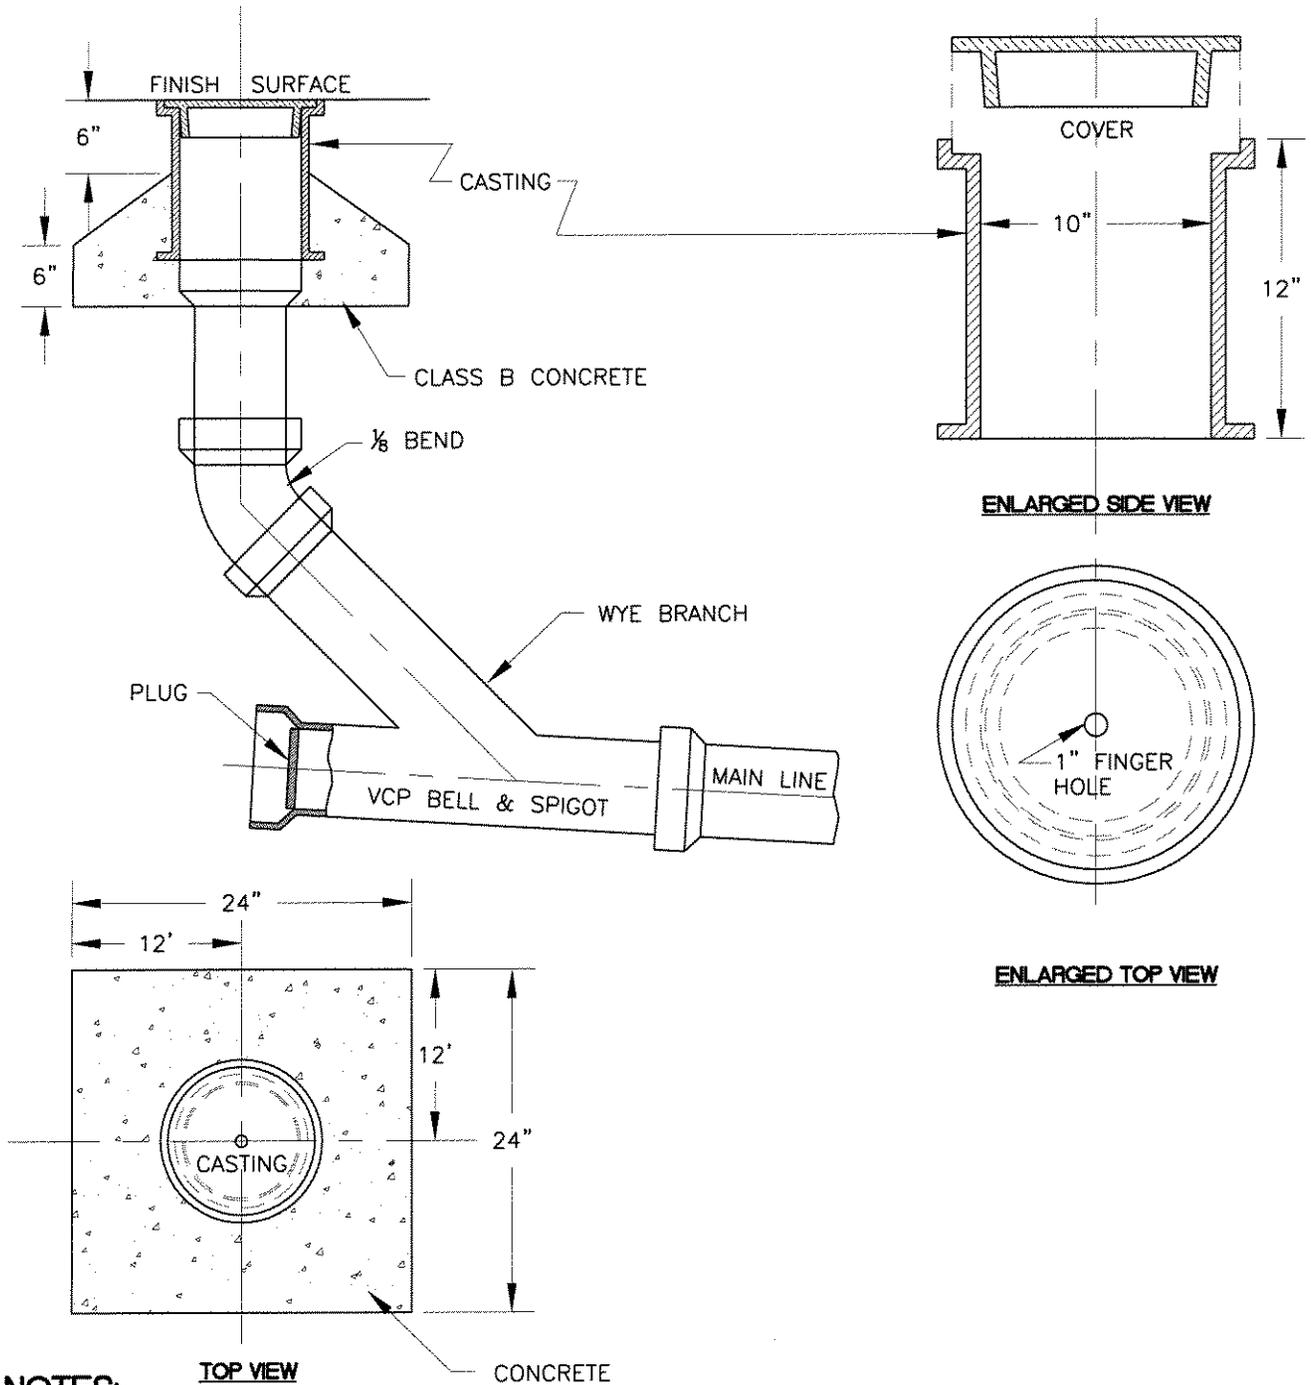

**NOTES:**

1. CLEAN-OUT PIPE MUST BE SAME DIAMETER AS MAIN LINE SEWER.
2. CASTING SHALL BE ALHAMBRA FOUNDRY NUMBER A-1240 OR EQUAL.
3. MAXIMUM DISTANCE BETWEEN SEWER MANHOLE AND TERMINAL CLEAN-OUT SHALL BE 150 FEET AND THERE SHALL BE NO MORE THAN 3 LATERALS BETWEEN TERMINAL CLEAN-OUT AND SEWER MANHOLE.

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:

Drawn By: LJA


Date: 01/04/05

1/4/05  
 APPROVED: *Joseph S. Schenk* 24039  
 CITY ENGINEER RCE

## SEWER TERMINAL CLEAN-OUT

Std. Dwg. No.  
**510**  
 Sheet 1 of 1

# CITY of NORCO STANDARD DRAWING

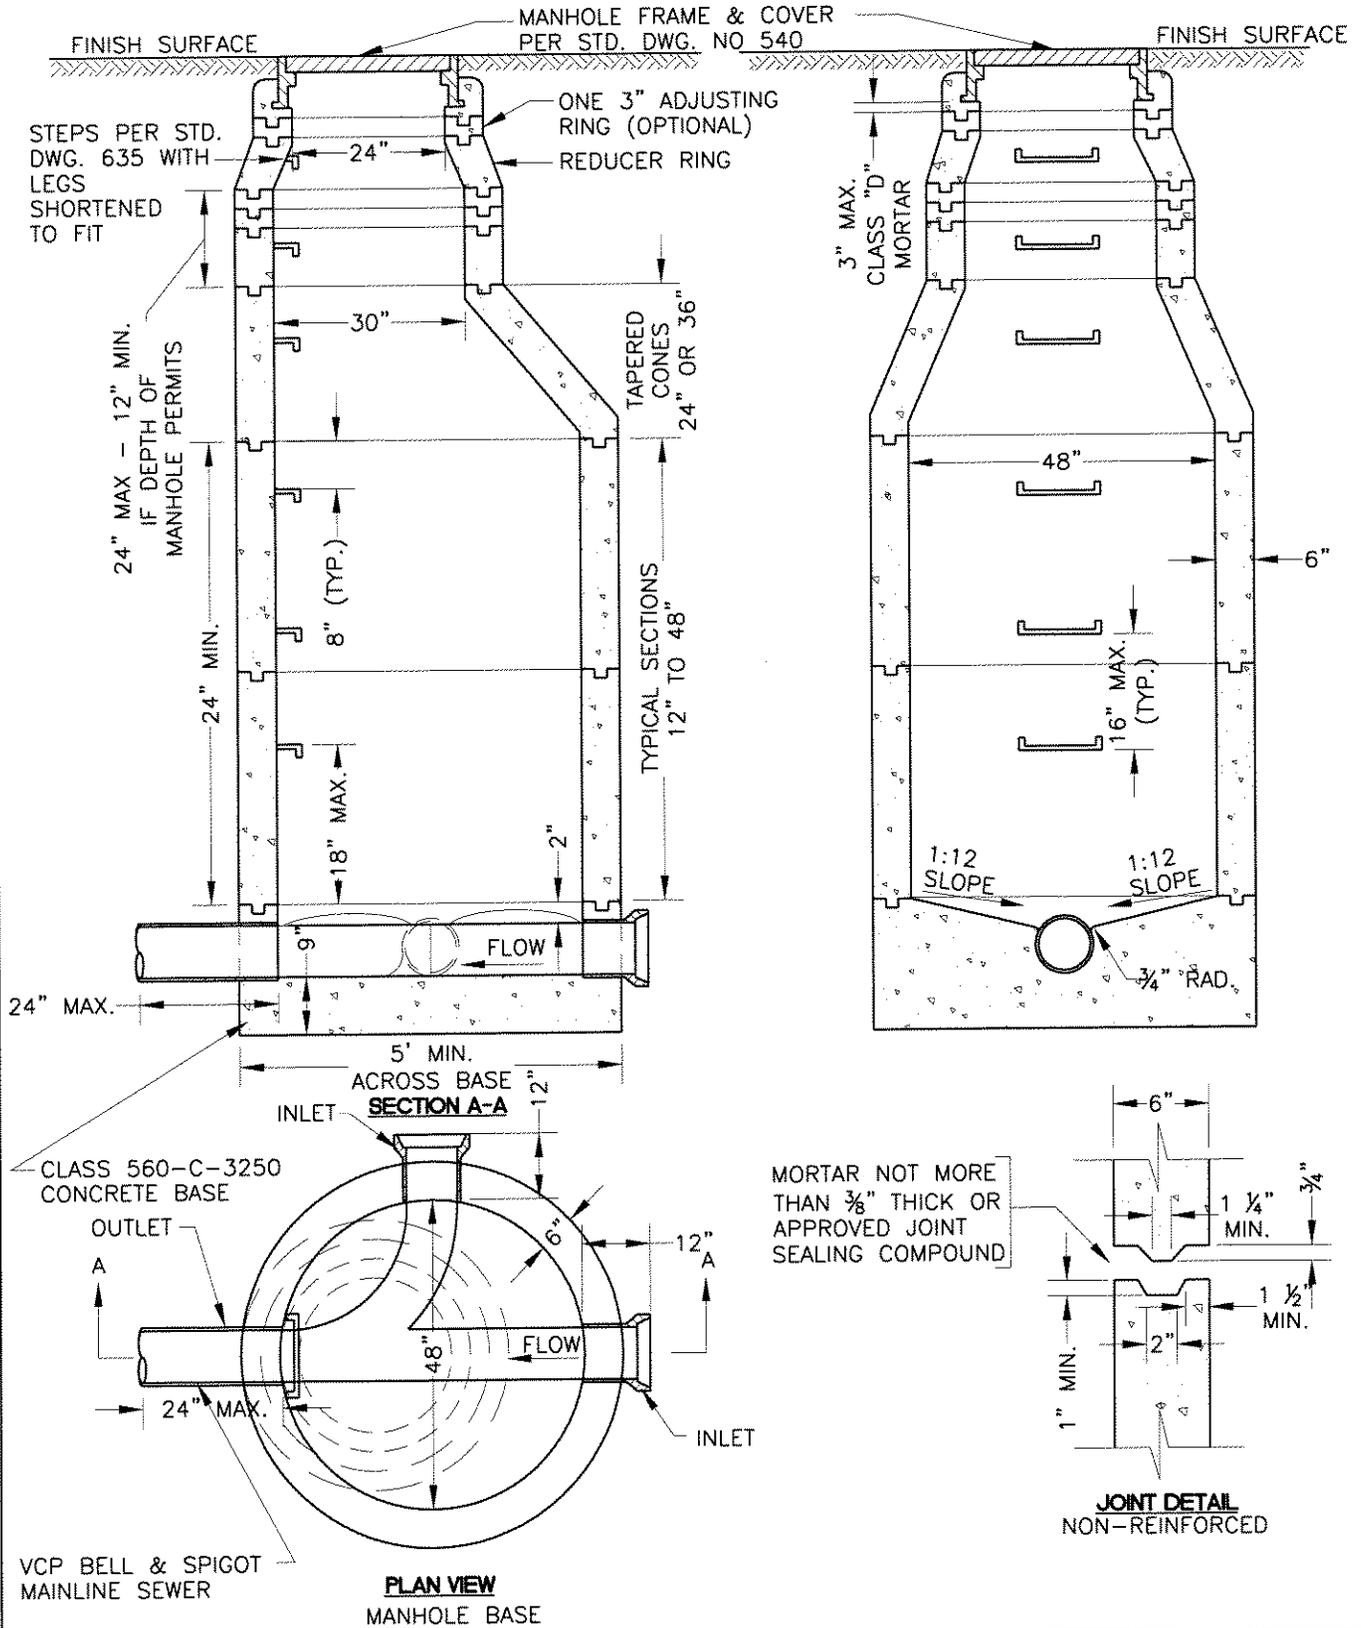

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:	1/25/05  APPROVED: <i>Joseph S. Schenk</i> 24039 CITY ENGINEER RCE
Drawn By: LJA			Date: 01/19/05				

## PRECAST CONCRETE MANHOLE

Std. Dwg. No.  
**515**  
Sheet 1 of 2

# CITY of NORCO STANDARD DRAWING

**NOTES:**


1. CONCRETE BASE, SHELF & CHANNEL SHALL BE POURED IN ONE OPERATION TO A POINT 2" ABOVE THE INLET AND OUTLET PIPES.
2. NO PORTION OF THE PIPE SHALL EXTEND INTO THE INSIDE OF THE MANHOLE.
3. INSIDE JOINTS SHALL BE NEATLY STRUCK & POINTED & SHALL NOT EXCEED  $\frac{3}{8}$ " THICKNESS.
4. NON-REINFORCED PRECAST MANHOLES SHALL NOT BE USED UNLESS PRIOR APPROVAL IS GRANTED BY THE CITY ENGINEER.
5. THE BASE FOR MANHOLES UNDER 15' IN DEPTH SHALL BE 9" THICKNESS; OVER 15' SHALL BE 12" THICKNESS; CLASS 560-C-3250 PORTLAND CEMENT CONCRETE.
6. THE TOP STEP SHALL BE PLACED A MINIMUM 12" ABOVE THE TOP OF CONE SECTION.
7. STEPS SHALL BE PER STD. DWG. NO. 635. THE MANHOLE STEPS SHALL BE UNIFORMLY SPACED AT A MAXIMUM OF 16". THE LOWEST STEP SHALL BE PLACED NOT LESS THAN 8" NOR MORE THAN 18" ABOVE THE SHELF.
8. RISER SECTIONS MAY BE REINFORCED OR UNREINFORCED. REINFORCED SECTIONS SHALL BE REINFORCED IN ACCORDANCE WITH ASTM C 478.
9. THE 24" x 48" ECCENTRIC CONES MAY BE REINFORCED OR UNREINFORCED. THE WALL THICKNESS SHALL NOT BE LESS THAN 6".
10. JOINTS SHALL BE TONGUE AND GROOVE. JOINTS FOR REINFORCED STRUCTURES SHALL CONFORM WITH ASTM C 478 SECTION 14.
11. PRECAST UNITS SHALL BE ASSEMBLED USING CLASS "B" MORTAR.
12. IF 30" DIAMETER MANHOLE FRAME AND COVER IS REQUIRED, IT SHALL BE INSTALLED WHERE THE REDUCER RING IS SHOWN IN THE SECTION.
13. FOR REINFORCED PRECAST STRUCTURES, ALL REINFORCEMENT SHALL HAVE A MINIMUM OF 2" OF COVER OVER THE STEEL ON THE INSIDE FACE.
14. THE TOP OPENING OF THE MANHOLE AND THE STEPS SHALL BE PLACED DIRECTLY OVER THE OUTLET OF THE STRUCTURE EXCEPT AS OTHERWISE NOTED ON PLANS.

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:	1/25/05  APPROVED: <i>Joseph S. Schenk</i> 24039 CITY ENGINEER RCE
Drawn By: LJA			Date: 01/19/05				

## PRECAST CONCRETE MANHOLE

Std. Dwg. No.  
**515**  
Sheet 2 of 2


# CITY of NORCO STANDARD DRAWING

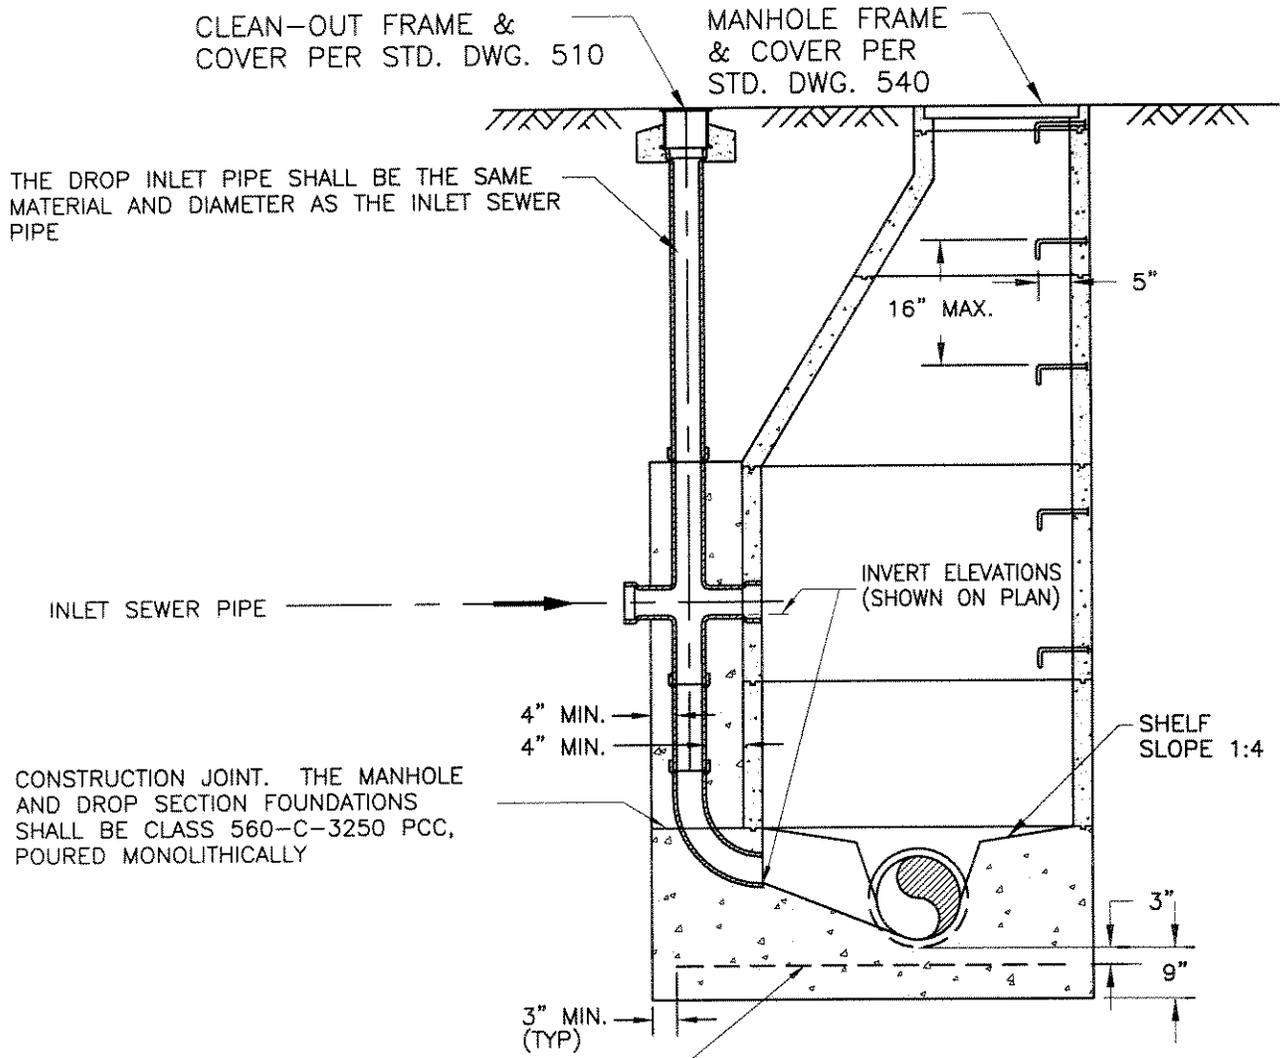

**NOTE:**

1. FOR PRECAST CONCRETE MANHOLE, SEE STD. DWG. 515.
2. FOR MANHOLE COVER ADJUSTMENT SEE STD. DWG. 535.
3. MANHOLE STEPS SHALL CONFORM WITH STD. DWG. 635. THE MANHOLE STEPS SHALL BE UNIFORMLY SPACED AT A MAXIMUM OF 16". THE LOWEST STEP SHALL BE PLACE NOT LESS THAN 8" NOR MORE THAN 18" ABOVE THE SHELF. THE STEPS SHALL PROJECT 5" INSIDE THE MANHOLE.

2-NO.4 BARS

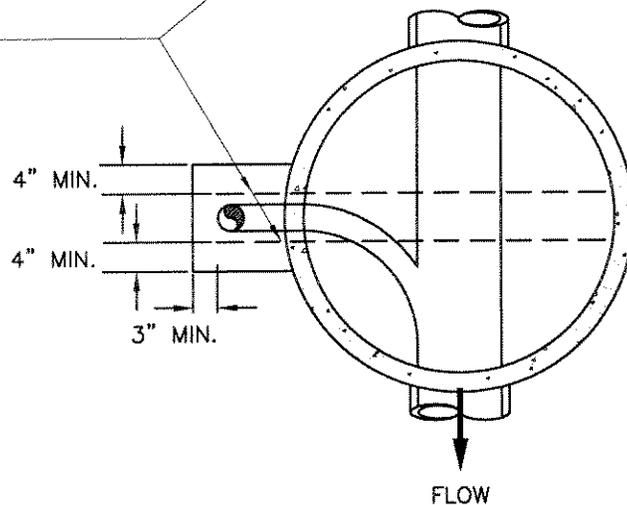


REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:
						12/22/04
APPROVED: <i>Joseph S. Schenk</i> 24039						
Drawn By: LJA			Date: 3/19/04		CITY ENGINEER RCE	

## SEWER MANHOLE DROP INLET

Std. Dwg. No.  
**520**  
Sheet 1 of 1

# CITY of NORCO STANDARD DRAWING

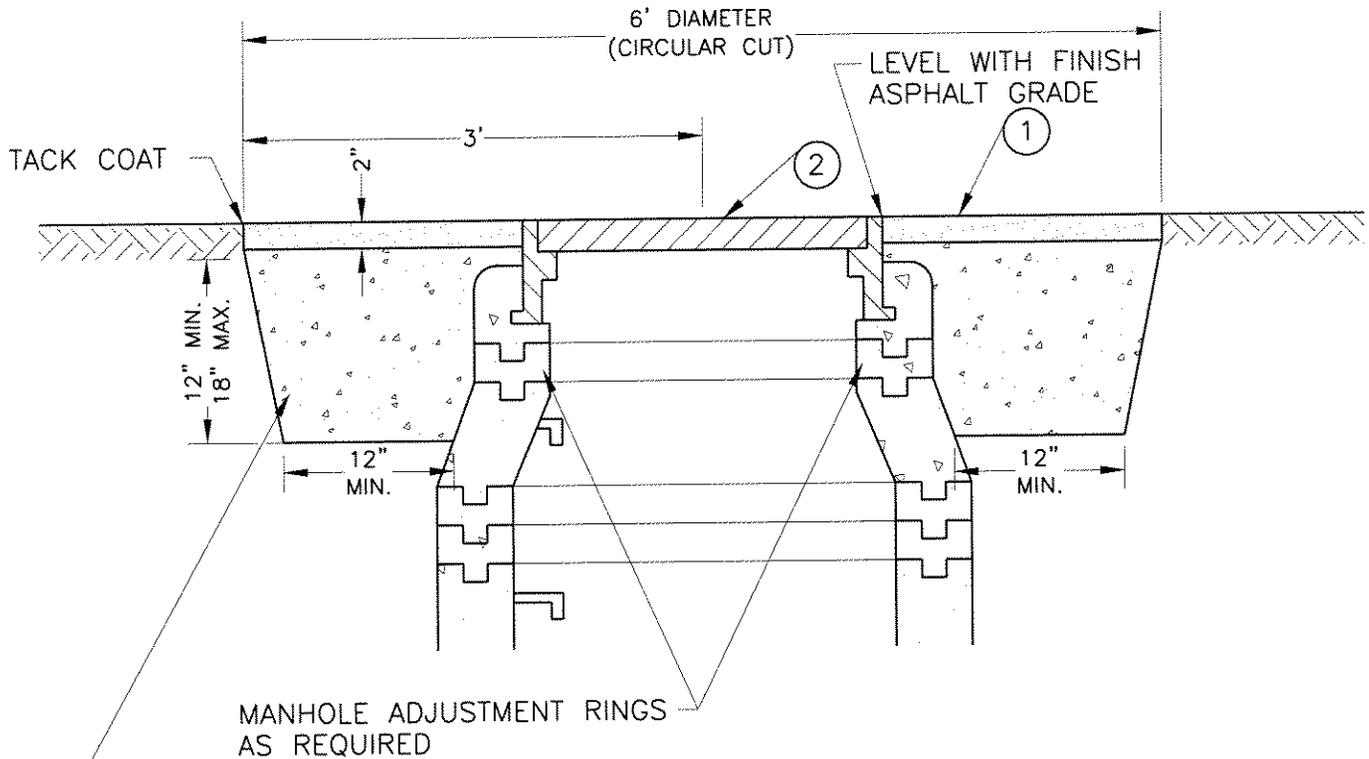

P.C.C. PAVING RING, CLASS 560-C-3250, TO BE PLACED SAME DAY AS EXCAVATION.

① CLASS D2-AR-4000 ASPHALTIC CONCRETE PLACED NO LATER THAN 72 HOURS AFTER COVER HAS BEEN RAISED TO GRADE.

② STANDARD MANHOLE FRAME AND COVER PER STD. DWG. NO. 540.

## NOTES:

1. DURING ROUGH GRADING OF STREET, SEWER MANHOLE FRAME AND COVER TO BE SET 6" BELOW SUBGRADE BEFORE FINAL PAVING.
2. SEWER MANHOLE FRAME AND COVER TO BE ADJUSTED AFTER PLACEMENT OF FINAL A.C. PAVEMENT. PAVEMENT REPAIRS TO BE MADE PER THIS DETAIL AFTER RAISING TO GRADE.
3. RESET TOP STEP IN MANHOLE AT THE TIME FRAME AND COVER ARE RAISED TO GRADE. ADD ADDITIONAL STEPS WHEN NECESSARY TO MAINTAIN PROPER SPACING BETWEEN STEPS.
4. IN UNPAVED AREAS MANHOLE FRAME AND COVER SHALL BE PLACED 6" ABOVE GROUND WITH 12" WIDE CONCRETE COLLAR.

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:

Drawn By: LJA

Date: 01/26/05


1/26/05

APPROVED: *Joseph L. Schenk* 24039  
CITY ENGINEER RCE


## MANHOLE COVER ADJUSTMENT

Std. Dwg. No.  
**535**  
Sheet 1 of 1


# CITY of NORCO STANDARD DRAWING

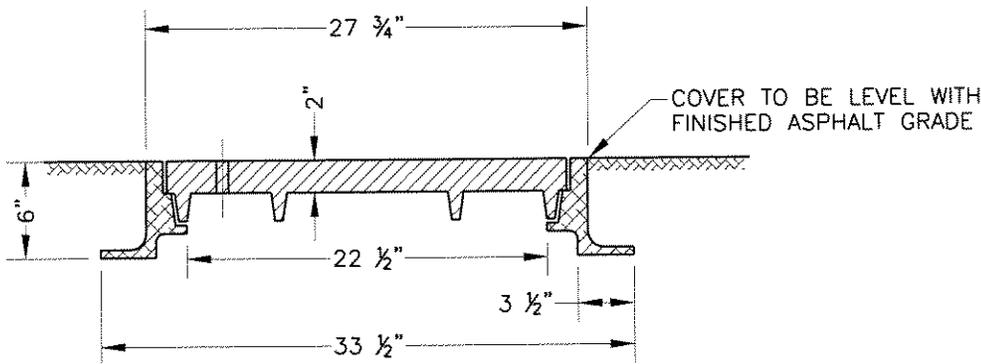

SECTION VIEW OF RING AND COVER

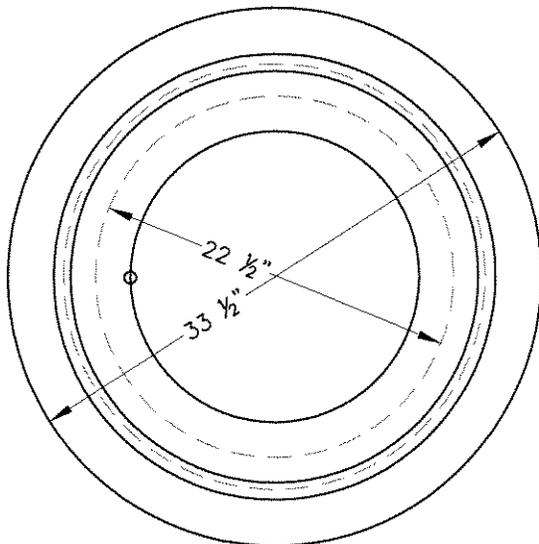

PLAN OF RING

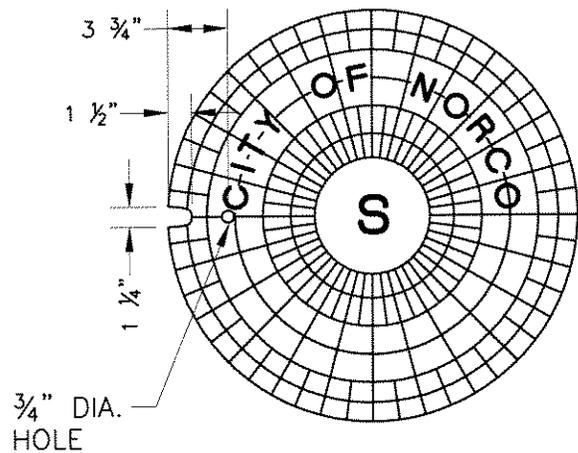

PLAN OF COVER

**NOTES:**

1. MANHOLE FRAME AND COVER SHALL BE ALHAMBRA FOUNDRY CO. NO. A-1170 OR EQUAL.
2. MANHOLE FRAME AND COVER CASTING SHALL CONFORM TO CLASS 30 SERIAL NO. A-48 OF A.S.T.M.
3. MANHOLE COVER MARKINGS SHALL SAY CITY OF NORCO.

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:
						1/20/05
						APPROVED: <i>Joseph S. Schenk</i> 24039 CITY ENGINEER RCE
Drawn By: LJA			Date: 01/12/05			


## SEWER MANHOLE FRAME and COVER

Std. Dwg. No.  
**540**  
Sheet 1 of 1

**600**  
**MISCELLANEOUS**  
**STANDARDS**




# CITY of NORCO STANDARD DRAWING

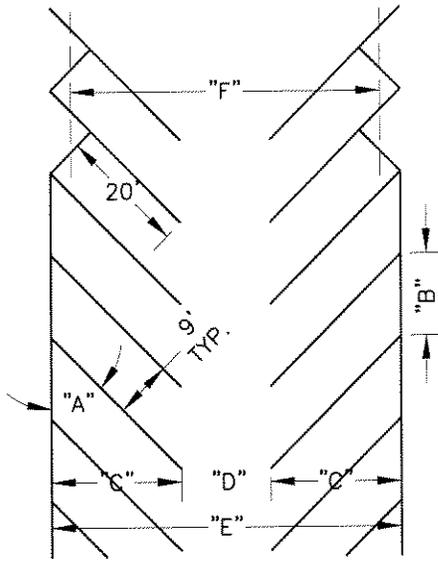

**TABLE OF MINIMUM DIMENSIONS:**

ANGLE "A"	CURB LENGTH "B"	STALL LENGTH "C"	AISLE "D"	BAY WIDTH "E"	INTERLOCK BAY WIDTH "F"
30°	18'	17'-10"	12'	47'-8"	39'
40°	14'	19'-9"	13'	52'-6"	45'-7"
45°	12'-9"	20'-6"	14'	55'	48'-8"
50°	11'-9"	21'-1"	15'	57'-2"	51'-5"
60°	10'-5"	21'-10"	18'	61'-8"	57'-2"
90°	9'	20'	25'	65'	65'

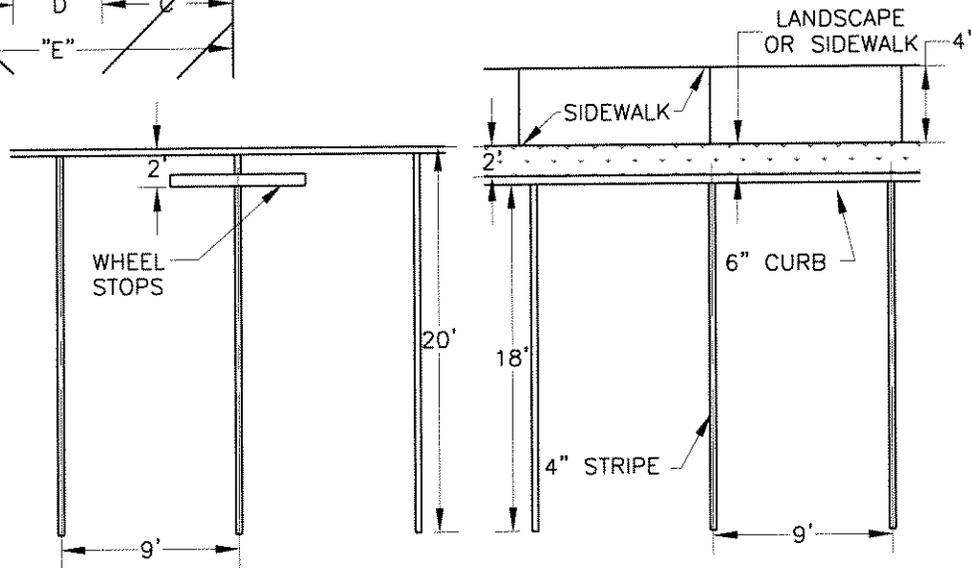

TYPICAL PARKING STALL DIMENSIONS (DEVELOPER OPTION)

**GENERAL NOTES:**

1. BUMPER BLOCKS ARE REQUIRED TO BE PROVIDED ON ALL PARKING SPACES ABUTTING A PROPERTY LINE UNLESS OPTION IS CHOSEN. IN NO CASE SHALL VEHICLES EXTEND OVER THE PUBLIC SIDEWALK OR PROPERTY LINES.
2. NO PARKING SPACE SHALL BE LOCATED WHERE IT WOULD BE NECESSARY FOR THE DRIVER TO BACK UP ACROSS A PUBLIC SIDEWALK.
3. IF DEVELOPER OPTION IS SELECTED, CAR OVERHANG MAY NOT BE COUNTED AS REQUIRED LANDSCAPING AREA OR SIDEWALK.
4. DIMENSIONS OF SPECIAL TYPES OF PARKING SPACES (OR REFER TO NORCO MUNICIPAL CODE SECTION 18.38):
  - PARALLEL PARKING SPACE - 10-FT x 26-FT;
  - LOADING SPACE - 12-FT x 25-FT WITH 15-FT VERTICAL CLEARANCE;
  - HANDICAPPED SPACE - MINIMUM REQUIREMENTS SET IN CALIFORNIA BUILDING CODE, CURRENT EDITION;
  - SPACES ADJACENT TO WALL OR RAISED PLANTER OVER 18-INCH IN HEIGHT - 12-FT x 20-FT.


REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:	1/6/05  APPROVED: <i>Joseph S. Schenk</i> 24039 CITY ENGINEER RCE
Drawn By: LJA			Date: 01/03/05				

## PARKING LOT DESIGN


Std. Dwg. No.  
**620**  
Sheet 1 of 1

# CITY of NORCO STANDARD DRAWING

## ENCLOSURE FOR DOUBLE BINS

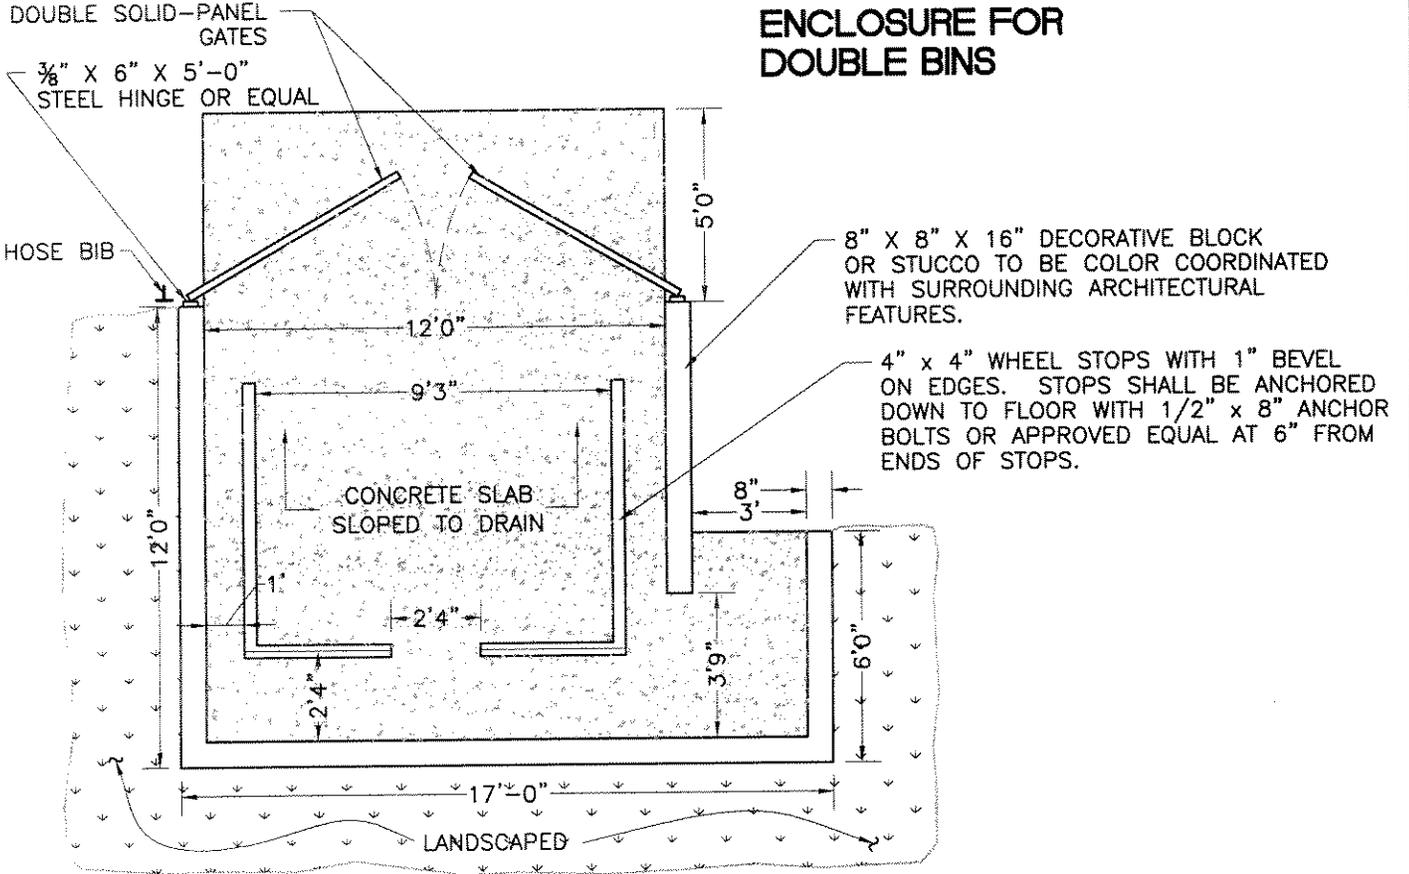

## ENCLOSURE FOR SINGLE BINS

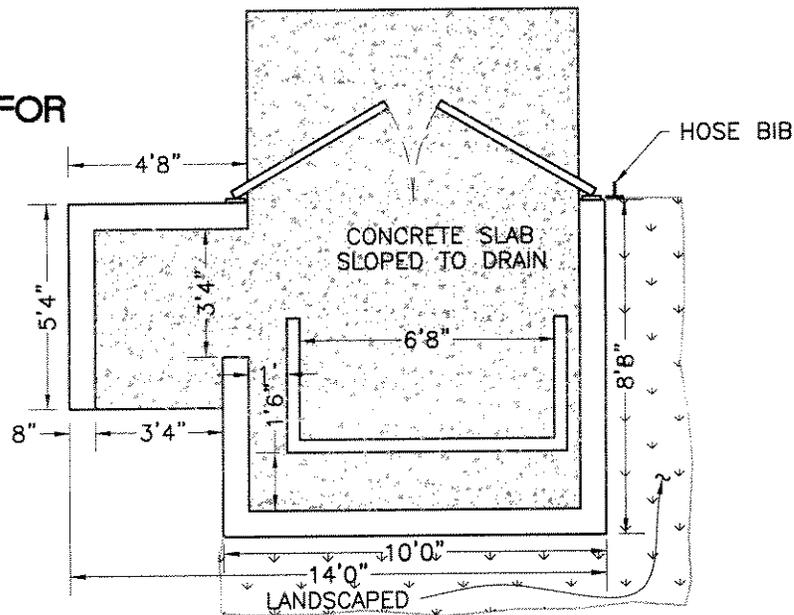

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:


Drawn By: LJA      Date: 3/19/04      v/22/04

APPROVED: *Joseph S. Schenk* 24039  
 CITY ENGINEER      RCE


**TRASH ENCLOSURE**

Std. Dwg. No.  
**630**  
 Sheet 1 of 2

# CITY of NORCO STANDARD DRAWING

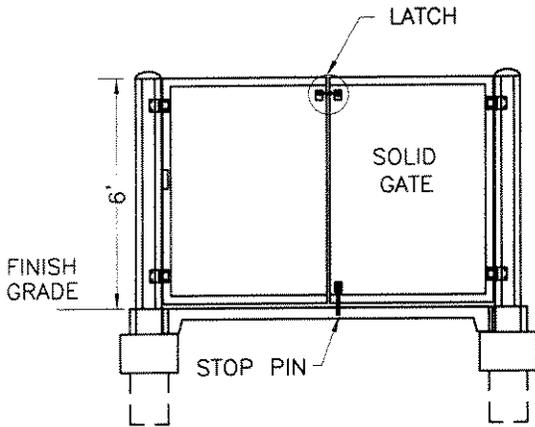


**FRONT ELEVATION**

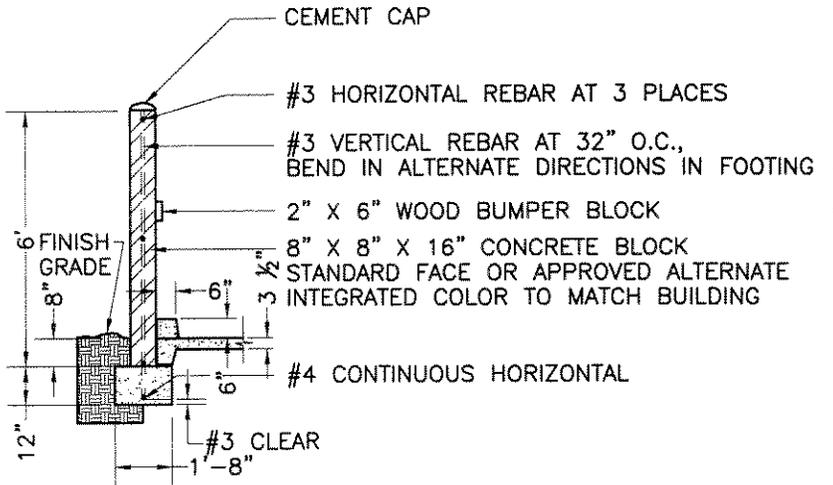

**SCREEN WALL  
SECTION A-A**

NOTE: FILL ALL CELLS CONTAINING REINFORCEMENT WITH GROUT.

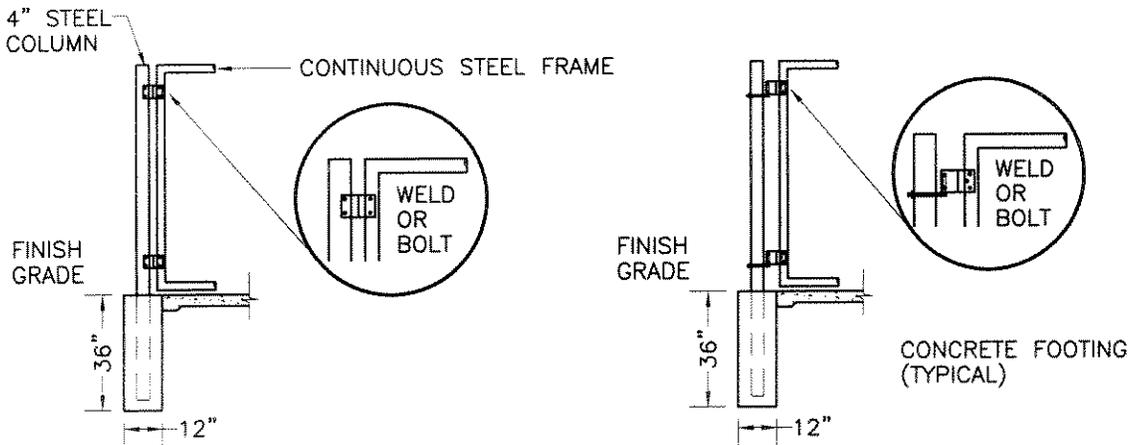


**GATE CONSTRUCTION ALTERNATIVES**

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:	12/22/04  APPROVED: <i>Joseph S. Schenk</i> 24039 CITY ENGINEER RCE
Drawn By: LJA			Date: 3/19/04				

## TRASH ENCLOSURE (Details)

Std. Dwg. No.  
**630**  
Sheet 2 of 2

# CITY of NORCO STANDARD DRAWING

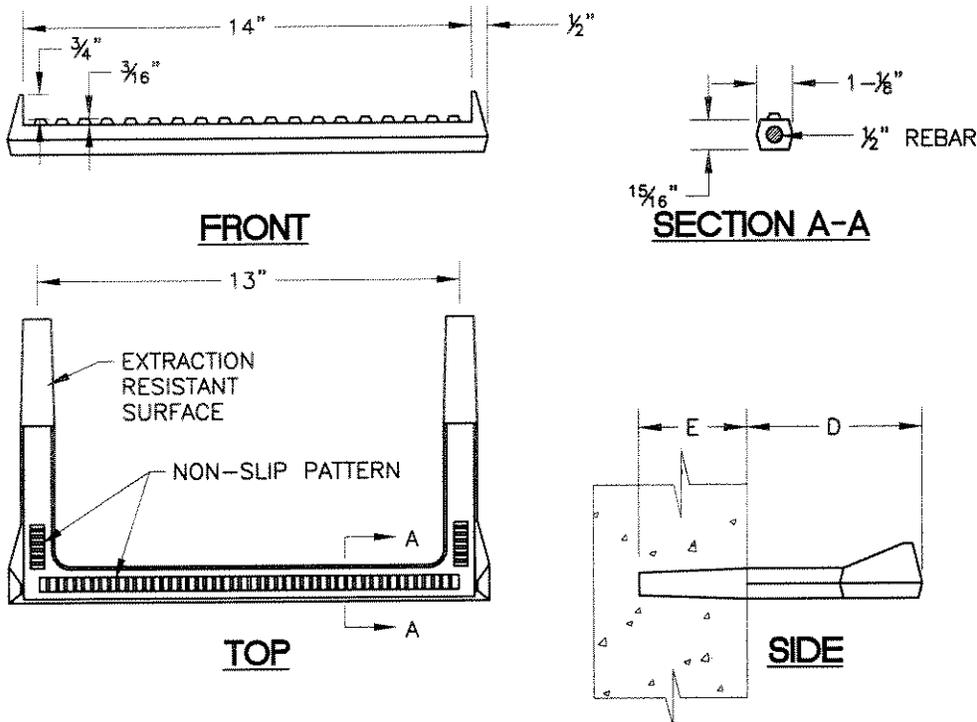

**NOTES:**

1. STEPS SHALL BE STEEL-REINFORCED COPOLYMER POLYPROPYLENE PLASTIC CONFORMING TO:
  - (A) ASTM D478 AND C497, EXCEPT THAT THE MINIMUM HORIZONTAL PULLOUT LOAD SHALL BE 1500 LBS.
  - (B) ASTM A615 GRADE 60 DEFORMED REINFORCING STEEL BAR.
  - (C) CALIFORNIA CODE OF REGULATIONS TITLE 8, GENERAL INDUSTRY SAFETY ORDERS.
2. STEPS SHALL BE CAPABLE OF WITHSTANDING AN IMPACT LOAD OF 70 FT-LBS AT 20°F WITHOUT CRACKING OR FRACTURING.
3. THE MINIMUM TOTAL CROSS-SECTIONAL AREA OF THE EXPOSED PORTION OF THE STEP, INCLUDING THE DEFORMED STEEL BAR AND EXCLUDING THE NON-SLIP TREAD SURFACE, SHALL BE 1.0 SQ. IN.
4. THE ENTIRE POLYPROPYLENE PLASTIC MATERIAL SURROUNDING THE REINFORCING STEEL BAR SHALL BE CAST MONOLITHICALLY. MINIMUM COVER SHALL BE  $\frac{3}{16}$ ".
5. A CERTIFICATION OF COMPLIANCE WITH THE REQUIREMENTS OF NOTES 1 THROUGH 4 PREPARED BY AN INDEPENDENT CERTIFIED LABORATORY SHALL BE SUBMITTED TO THE ENGINEER CONCURRENTLY WITH A REQUEST FOR APPROVAL.
6.  $E=3-\frac{3}{8}$ ". FOR VAULTS AND MANHOLES,  $D=5-\frac{1}{2}$ ". FOR OTHER INSTALLATIONS,  $D=7-\frac{1}{2}$ ". THESE DIMENSIONS MAY BE PLUS OR MINUS  $\frac{1}{4}$ ".
7. STEPS SHALL BE EVENLY SPACED. MAXIMUM VERTICAL SPACING OF STEPS SHALL BE 16", WITH THE BOTTOM STEP A MAXIMUM OF 2' ABOVE FLOOR OR SHELF.
8. IF TAPERED STEPS ARE INSTALLED INTO STRAIGHT DRILLED OR FORMED HOLES, APPROVED NON-SHRINK GROUT SHALL BE INJECTED INTO THE HOLE PRIOR TO INSTALLATION. HOLES SHALL BE STRAIGHT AND PARALLEL. EXCEPT AS OTHERWISE NOTED, STEPS SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDED PROCEDURES.
9. A DROP STEP WITH A MINIMUM DROP OF  $\frac{3}{4}$ " MAY BE USED. THE DROP STEP SHALL MEET ALL OTHER CRITERIA OF THIS PLAN.

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:	12/22/04  APPROVED: <i>Joseph A. Schenk 24039</i> CITY ENGINEER RCE
Drawn By: LJA			Date: 03/29/02				

## MANHOLE STEPS for SEWER MANHOLES





Std. Dwg. No.  
**635**  
Sheet 2 of 2

# CITY of NORCO STANDARD DRAWING

UNLESS OTHERWISE NOTED:

- D = 7"
- E = 6" OR T-1", WHICHEVER IS LESS; MINIMUM E IS 3"
- S = 12" MAX., EVENLY SPACE
- W = 16" MIN.

- FOR MANHOLES AND UNDERGROUND VAULTS:
- S = 16" MAX., EVENLY SPACED
  - W = 14" MIN.

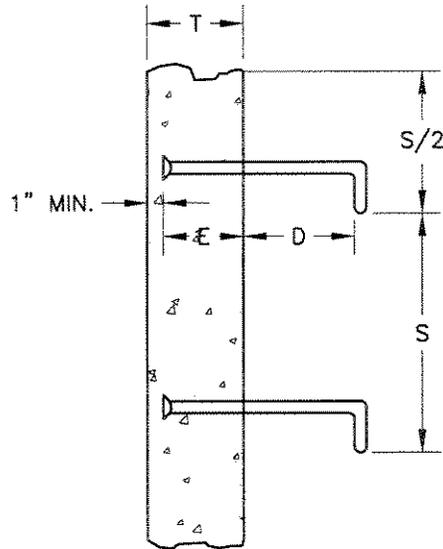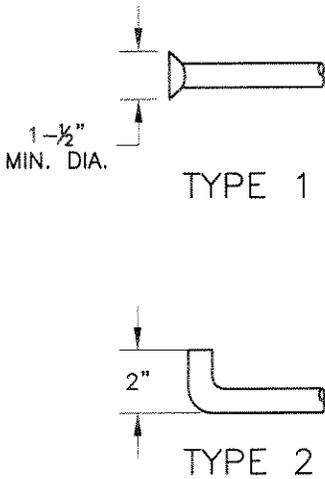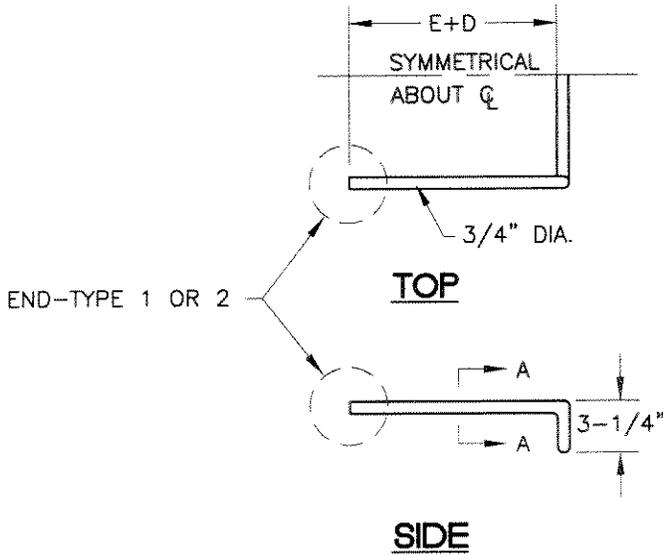

**END DETAILS - SIDE VIEW**

**INSTALLATION DETAIL**

**NOTES:**

1. STEPS SHALL BE STEEL CONFORMING TO ASTM A307 AND SHALL BE GALVANIZED AFTER FABRICATION.
2. IF STAINLESS STEEL STEPS ARE REQUIRED, THE MATERIAL SHALL CONFORM TO ASTM A276, 300 SERIES.
3. STEP ENDS MAY BE TYPE 1 OR 2, AS SHOWN.
4. BOTTOM STEP SHALL BE A MAXIMUM OF 2' ABOVE FLOOR OR SHELF.
5. STEPS WITH TYPE 1 END MAY BE CAST IN PLACE, OR PLACED IN THE CENTER OF 1-1/2" MIN. DIA DRILLED OR FORMED HOLES AND SET WITH HIGH STRENGTH NON-SHRINK GROUT, 6000 PSI MIN. STEPS WITH TYPE 2 ENDS SHALL BE CAST IN PLACE.

<b>REVISION</b>	NO:	BY:	DATE:	NO:	BY:	DATE:	12/22/04 APPROVED: <i>Joseph S. Schenk</i> 24039 CITY ENGINEER RCE
Drawn By: LJA			Date: 3/19/04				


## MANHOLE STEPS for STORM DRAIN MANHOLES

Std. Dwg. No.  
**635**  
Sheet 1 of 2

# **700 TRAIL STANDARDS**



# CITY of NORCO STANDARD DRAWING

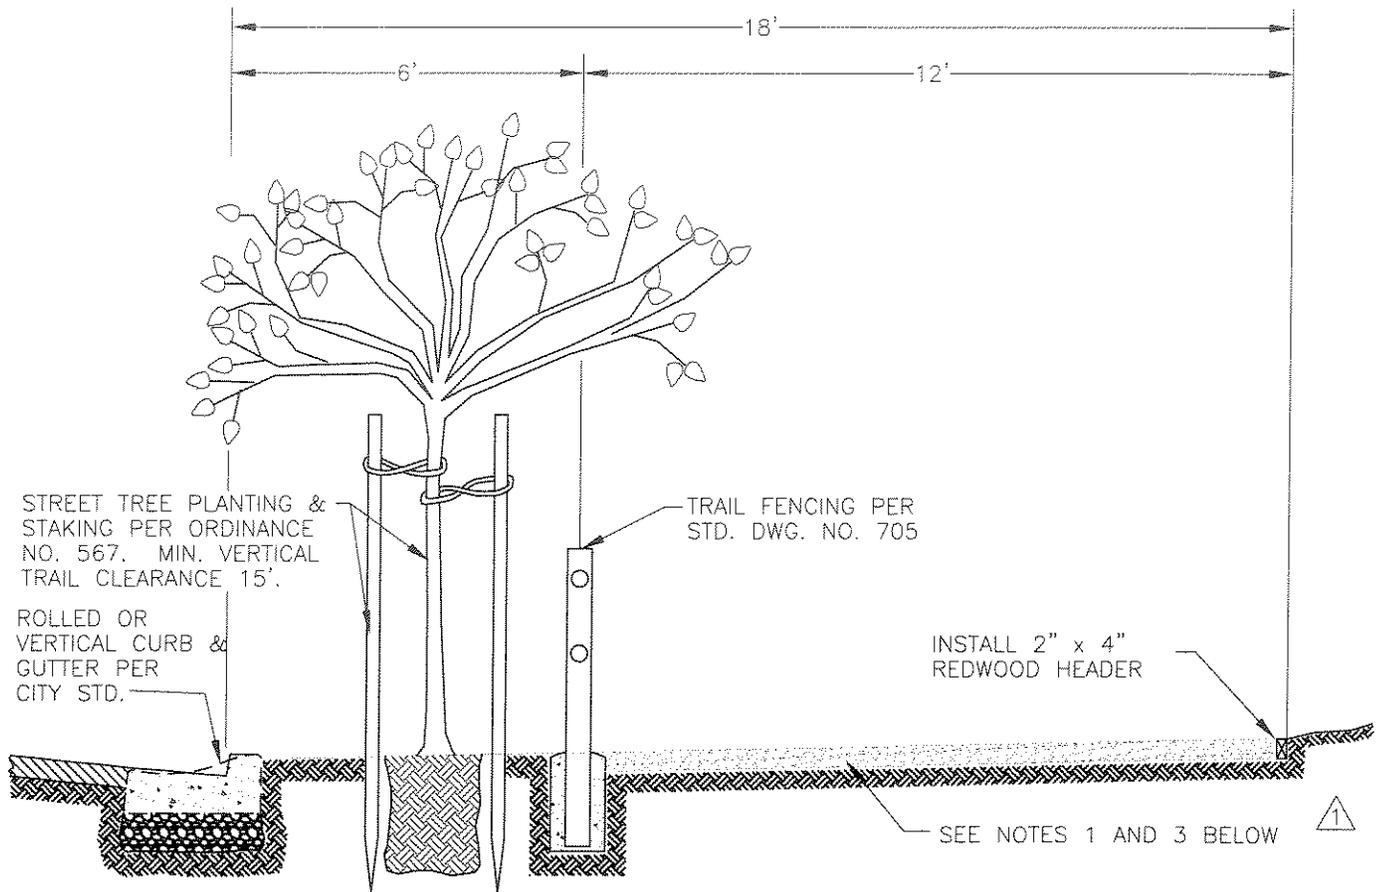

## NOTES:

1. TRAIL MATERIAL (4" THICK) SHALL BE COMPACTED IN PLACE TO 95% WITH THE UPPER ONE FOOT OF SUBGRADE COMPACTED TO 95%, AND SHALL CONSIST OF DECOMPOSED GRANITE, SLAG OR STEEL SLAG WITH A MORE OR LESS EQUAL GRADATION MIXTURE BETWEEN 1/2" SIZE MAXIMUM AND NO. 200 SIEVE SIZE MINIMUM.
1. REDWOOD HEADER STAKES SHALL BE 1" x 2" x 18" AT 4'-0" O.C. FLUSH WITH TOP OF HEADER.
1. THE ONLY APPROVED ALTERNATIVE TRAIL MATERIALS ARE THE FOLLOWING:
  2. A. 2% SOIL CEMENT/DG. SEE SHEET 2 FOR SPECIFICAITONS.
  2. B. POLYMER COATED CRUSHED STONE PATHWAY MIX. SEE SHEET 3 FOR SPECIFICATIONS.
  2. C. INTERLOCKING BRICK PAVERS IN DRIVEWAY AREAS ONLY AND CANNOT BE USED IN OTHER PARTS OF THE TRAIL. SEE SHEETS 4 & 5 FOR SPECIFICATION.

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:	APPROVED: <i>Dominic Peters</i> 027172 CITY ENGINEER RCE
	1	LJA	09/01/05	3	JCW	10/23/07	
	2	SLR	03/28/07	4	SRL	02/22/08	

Drawn By: LJA Date: 01/03/05

# CITY of NORCO STANDARD DRAWING



## A. SOIL CEMENT

1. GRADE TRAIL, FILLING ALL RUTS AND ADJUSTING GRADE FOR PROPER WATER FLOW WITH A MINIMUM CROSS SLOPE OF 1% AND A MAXIMUM CROSS SLOPE OF 4%.
2. SPREAD 270 LBS. OF PORTLAND PLASTIC CEMENT OVER 240 SQ. FT. OF TRAIL.
3. ROTO-TIL IN THE CEMENT AND EXISTING DG TRAIL MATERIAL TO A DEPTH OF 4 INCHES OVER THE ENTIRE 240 SQ. FT.
4. RE-GRADE THE AREA ROTO-TILLED AND MIXED. ADD WATER LIGHTLY DURING THIS PROCESS.
5. WHEN THE ENTIRE AREA IS LEVELED, ROLL THE AREA WITH A 3,500 LB. ROLLER ADDING WATER LIGHTLY. THE AREA WILL NEED TO BE ROLLED SEVERAL TIMES FOR PROPER COMPACTION.
6. THE AREA IS TO BE LIGHTLY WATERED SEVERAL TIMES BY HAND OVER THE NEXT SEVERAL HOURS. AVOID OVER-WATERING THAT WOULD CAUSE THE TRAIL TO RUT OR WASH OUT. WATER MUST PENETRATE FOR THE FULL 4 INCHES OF SOIL CEMENT DURING THIS PROCES.
7. THE ENTIRE TRAIL MUST BE SECURED WITH SIGNS AND BARRICADES DURING THE INSTALLATION OF THE SOIL CEMENT AND FOR THE NEXT 24-HOURS AFTER COMPLETION TO ALLOW FOR THE CEMENT TO HARDEN.
8. ALL VEHICLES SHALL BE KEPT OFF THE SOIL CEMENT INCLUDING DRIVEWAYS FOR A FULL 24-HOURS AFTER THE INSTALLATION IS COMPLETE.

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:	APPROVED: CITY ENGINEER <span style="float: right;">RCE</span>
	1	LJA	09/01/05	3	JCW	10/23/07	
	2	SLR	03/28/07	4	SRL	02/22/08	
Drawn By: LJA			Date: 01/03/05			C27172 APPROVED: CITY ENGINEER <span style="float: right;">RCE</span>	
<b>EQUESTRIAN TRAIL STANDARD</b>							Std. Dwg. No. <b>700</b> Sheet 2 of 6

# CITY of NORCO STANDARD DRAWING



## B. POLYMER COATED CRUSHED STONE PATHWAY MIX

1. SUB-GRADE PREPARATION
  - A. ALL AREAS SHALL BE COMPACTED TO A MINIMUM OF 90% RELETIVE COMPACTION AND SHALL BE GRADED WITH A MINIMUM CROSS SLOPE OF 1%. ALL AREAS MUST BE GRADED IN A MANNER SO THAT NO STANDING WATER IS PRESENT AFTER FLOODING. ALL DELETERIOUS MATERIAL SUCH AS SOD, TOPSOIL, STICKS, ETS., SHALL BE REMOVED PRIOR TO PAVING. STATE APPROVED PREEMERGENCE HERBICIDE SHALL BE APPLIED OVER THE ENTIRE SUB-GRADE.
  - B. PRIOR TO PAVING SUB-GRADE SHALL BE APPROVED BY AN ARCHITECT OR OTHER QUALIFIED INDIVIDUAL.
2. DECOMPOSED GRANITE OR CRUSHED AGGREGATE WITH STALOK BINDER
  - A. AGGREGATE MIX SHALL BE DECOMPOSED GRANITE OR CRUSHED AGGREGATE. ALL AVAILABLE MATERIALS HAVE BEEN TESTED AND APPROVED BY PRODUCT MANUFACTURE.
  - B. THE AGGREGATE MIXTURE IS TO BE BLENDED AS PER MANUFACTURER'S SPECIFICATIONS BY APPROVED MANUFACTURE'S BLENDING METHODS.
  - C. CONTRACTOR SHALL GUARANTEE THAT MATERIALS USED AND INSTALLATION OF AGGREGATE MATERIALS ARE IN ACCORDANCE WITH MANUFACTURE'S RECOMMENDATIONS.
3. AGGREGATE PAVING
  - A. THE MIXTURE SHALL BE PLACED BY A SPREADER OR OTHER APPROVED MEANS AT A 2-INCH COMPACTED DEPTH OVER A COMPACTED SUB-GRADE.
  - B. SPREAD BY GRADING ONTO THE PREPARED BASE UNTIL THE ENTIRE AREA IS COVERED.
  - C. THE SURFACE COVER SHALL BE COMPACTED USING A 5-TON DOUBLE-DRUM ROLLER OR SIMILAR TO GIVE A FINAL DEPTH OF 2-INCHES.
4. "STALOK" IS AN APPROVED BRAND OF POLYMER COATED CRUSHED STONE PATHWAY MIX. OTHER MANUFACTURES OF POLYMER COATED CRUSH STONE WHICH MEET THE MINIMUM SPECIFICATION OF THE "STALOK" PRODUCT WILL BE CONSIDERED AN APPROVED EQUAL.

STALOK IS A PRODUCT TRADE MARK BY STABILIZER SOLUTIONS, INC., ARIZONA  
 STABILIZER SOLUTIONS: (602) 255-5900  
 LOCAL SUPPLIER: GAIL MATERIAL: (951) 279-1095

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:	APPROVED: CITY ENGINEER <span style="float: right;">RCE</span>
	1	LJA	09/01/05	3	JCW	10/23/07	
	2	SLR	03/28/07	4	SRL	02/22/08	
Drawn By: LJA		Date: 01/03/05		APPROVED: CITY ENGINEER <span style="float: right;">RCE</span>			
EQUESTRIAN TRAIL STANDARD							Std. Dwg. No. <span style="font-size: 1.5em; font-weight: bold;">700</span> Sheet 3 of 6


# CITY of NORCO STANDARD DRAWING

①  
②


## C. INTERLOCKING BRICK PAVERS

**NOTES:**

1. EDGE TREATMENT SHALL BE AS STRAIGHT AS POSSIBLE TO COMPLIMENT THE ALIGNMENT OF PAVING STONES.
2. INTERLOCKING PAVING STONES (I.P.S.) SHALL CONFORM TO ASTM C936 AND BE INSTALLED TO MANUFACTURER'S SPECIFICATIONS.  
BLOCK STYLE = CAPRI  
PATTERN = RUNNER  
COLOR = SANTA BARBARA SANDSTONE  
(OR APPROVED EQUAL BY THE CITY ENGINEER.)
3. ALL SURFACING UTILITIES SHALL BE ENCASED IN CONCRETE, CREATING STRAIGHT LINES TO CUT AGAINST.
4. PCC CLASS  
DRIVEWAY - 520-A-2500

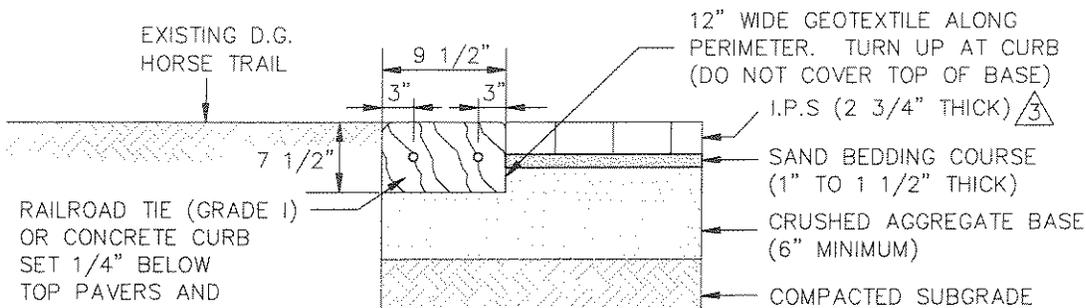

**SECTIONAL VIEW  
(RESIDENTIAL CONDITION)**

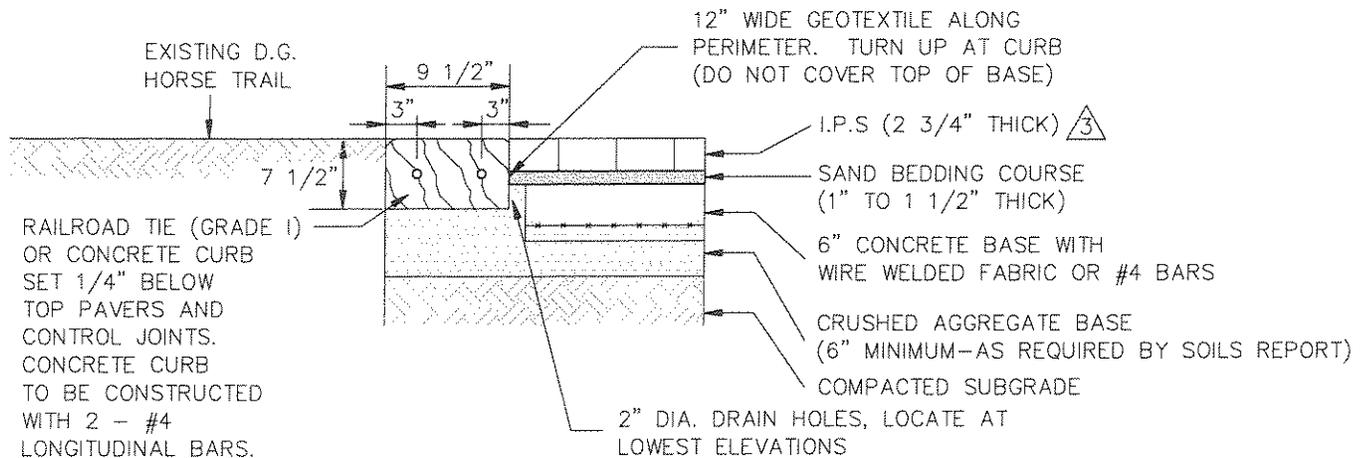

**SECTIONAL VIEW  
(COMMERCIAL CONDITION)**

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:	APPROVED: CITY ENGINEER <span style="float: right;">RCE</span>
	1	LJA	09/01/05	3	JCW	10/23/07	
	2	SRL	03/28/07	4	SRL	02/22/08	


Drawn By: LJA

Date: 01/03/05


# EQUESTRIAN TRAIL STANDARD 700

Std. Dwg. No.  
**700**  
Sheet 4 of 6


# CITY of NORCO STANDARD DRAWING

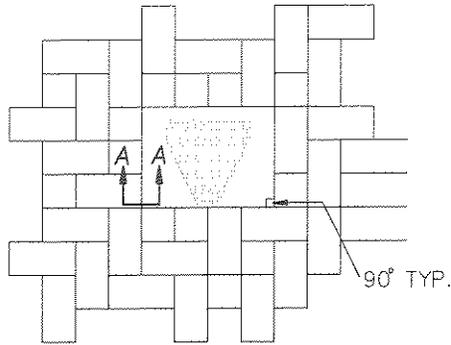


TYPICAL UTILITY ENCASEMENT

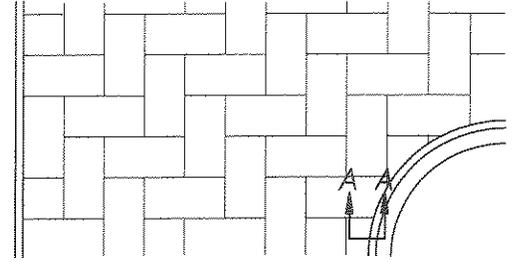

CUT TO FIT ALL EDGES



90° DIRECTIONAL CHANGE

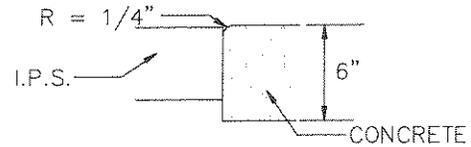

**SECTION A-A**

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:	APPROVED: CITY ENGINEER <span style="float: right;">RCE</span>
	1	LJA	09/01/05	3	JCW	10/23/07	
	2	SRL	03/28/07	4	SRL	02/22/08	

Drawn By: LJA




Date: 01/03/05

C27172

## EQUESTRIAN TRAIL STANDARD

Std. Dwg. No. **700**  
Sheet 5 of 6

# CITY of NORCO STANDARD DRAWING

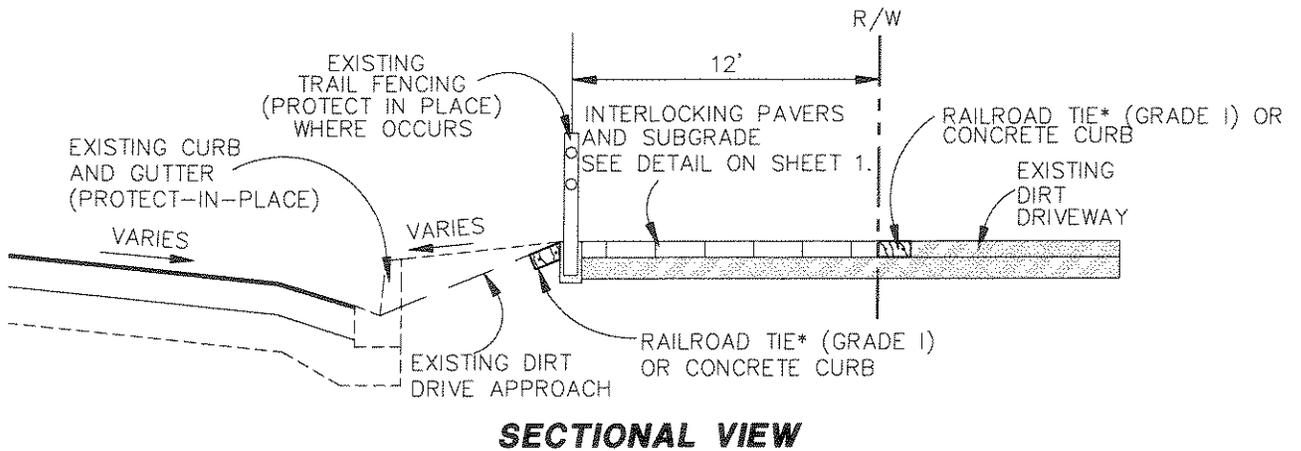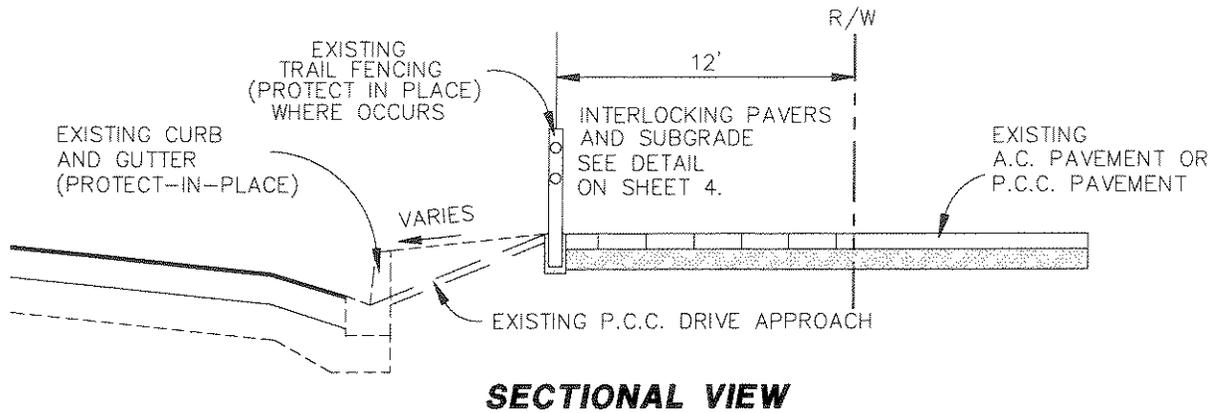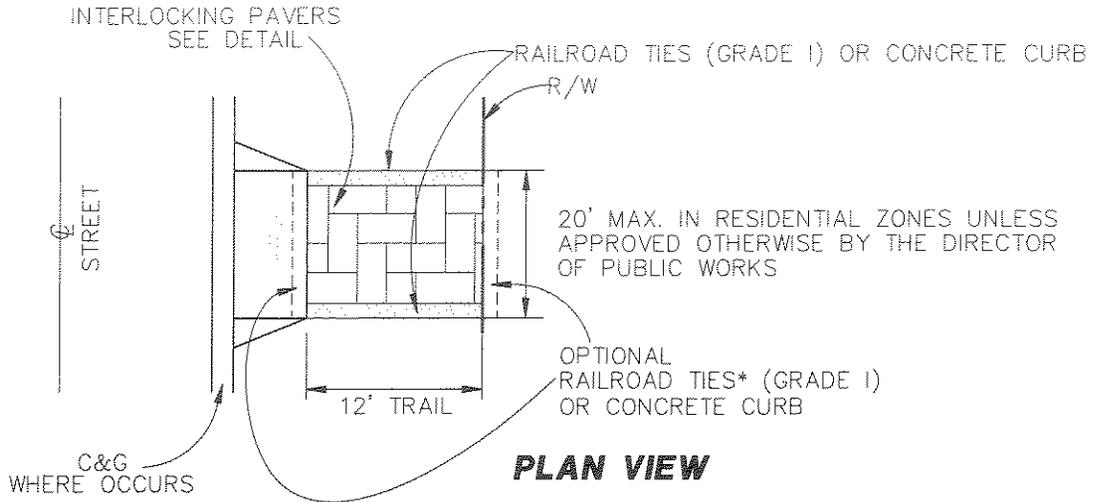


\*NOTE:  
TO BE USED ONLY IF DWY OR DWY  
APPROACH IS OTHER THAN A.C OR P.C.C.

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:
	1	LJA	09/01/05	3	JCW	10/23/07
	2	SRL	03/28/07	4	SRL	02/22/08

Drawn By: LJA
Date: 01/03/05

APPROVED:   
 CITY ENGINEER RCE

# CITY of NORCO STANDARD DRAWING

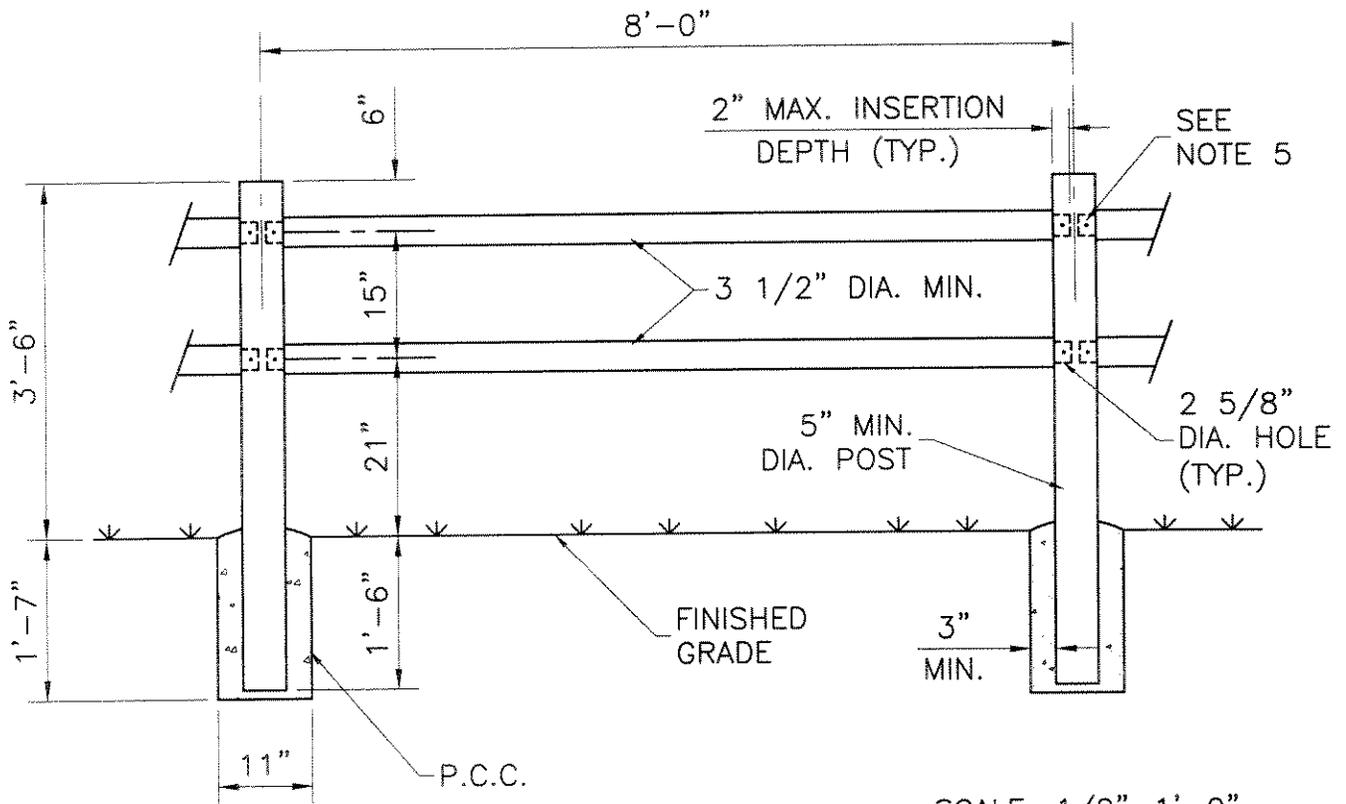


**NOTE:**


1. THE TOP OF THE POST SHALL NOT EXCEED 6" ABOVE THE TOP RAIL.
2. THE HEIGHT ABOVE THE GROUND OF THE C<sub>Q</sub> OF THE TOP RAIL SHALL BE 36".
3. THE CENTER TO CENTER DISTANCE BETWEEN THE TOP AND BOTTOM RAILS SHALL BE 15".
4. ALL POSTS AND RAILS SHALL BE FULLY PRESSURE TREATED WITH PENTACHLOROPHENOL, AMMONIACAL COPPER ARSENATE OR CHROMATED ARSENATE. POSTS AND RAILS SHALL EXHIBIT A MINIMUM PENETRATION OF 1/8" ON ALL TREATED SURFACES.
5. INSERTION DEPTH OF THE RAIL INTO THE POST SHALL BE 2". NAILS SHALL BE 16d COMMON, GALVANIZED-RING OR 3" STEEL DRYWALL SCREWS. ONE NAIL OR SCREW PER EACH RAIL ON ONE SIDE OF POST.
6. CONCRETE SHALL BE 500-C-2500.
7. POLE FENCING MATERIAL SHALL BE EITHER CEDAR OR LODGE POLE PINE.

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:	
							12/22/04
							APPROVED: <i>Joseph S. Schenk</i> 24039 CITY ENGINEER RCE
Drawn By: MLR			Date: 12/21/04				
<b>TRAIL FENCING DETAIL</b>							Std. Dwg. No. <b>705</b> Sheet 1 of 1

# CITY of NORCO STANDARD DRAWING

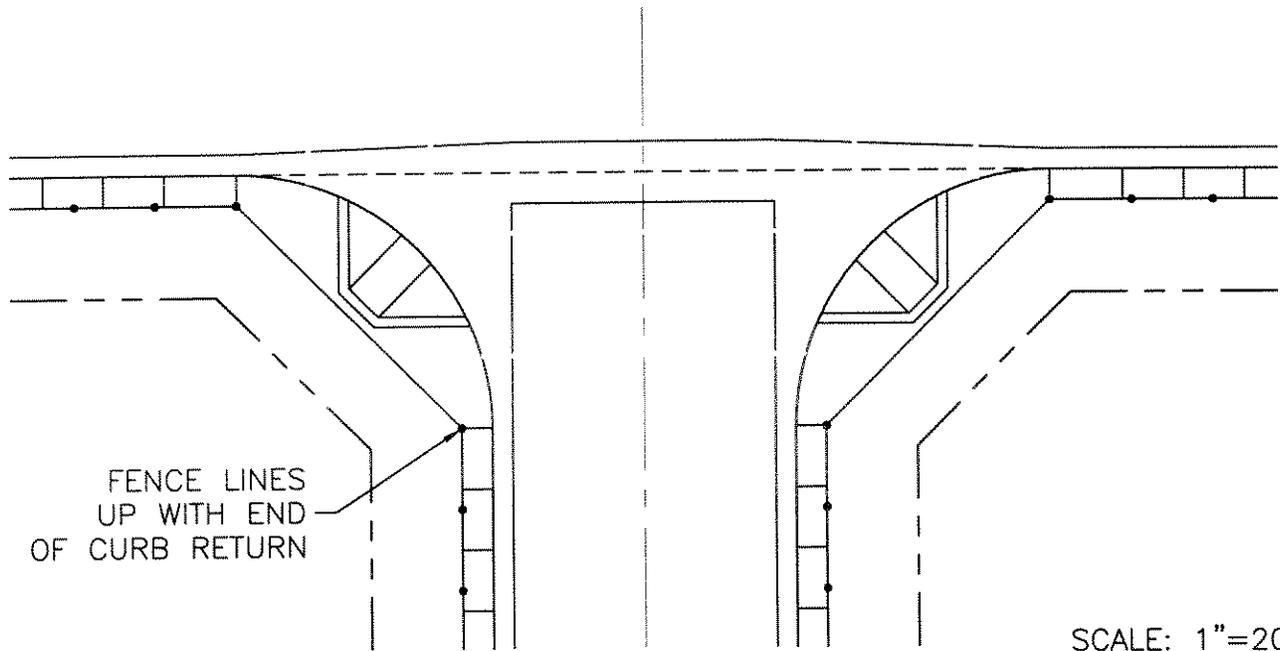


## HORSETRAIL at IMPROVED INTERSECTION

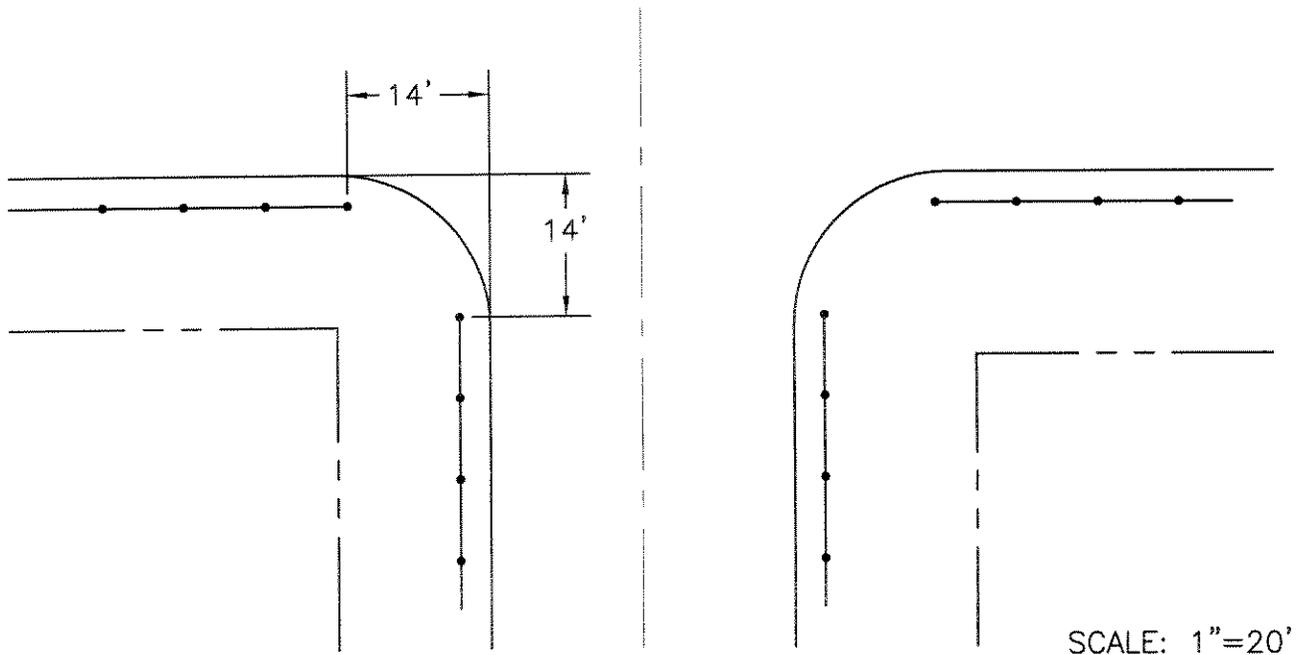

## HORSETRAIL at UNIMPROVED INTERSECTION

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:		
							12/22/04	
							APPROVED: <i>Joseph S. Schenk</i> 24039 CITY ENGINEER RCE	
Drawn By: LJA			Date: 12/21/04					
<b>EQUESTRIAN TRAIL at CORNER</b>							Std. Dwg. No. <b>710</b> Sheet 1 of 1	

# CITY of NORCO STANDARD DRAWING

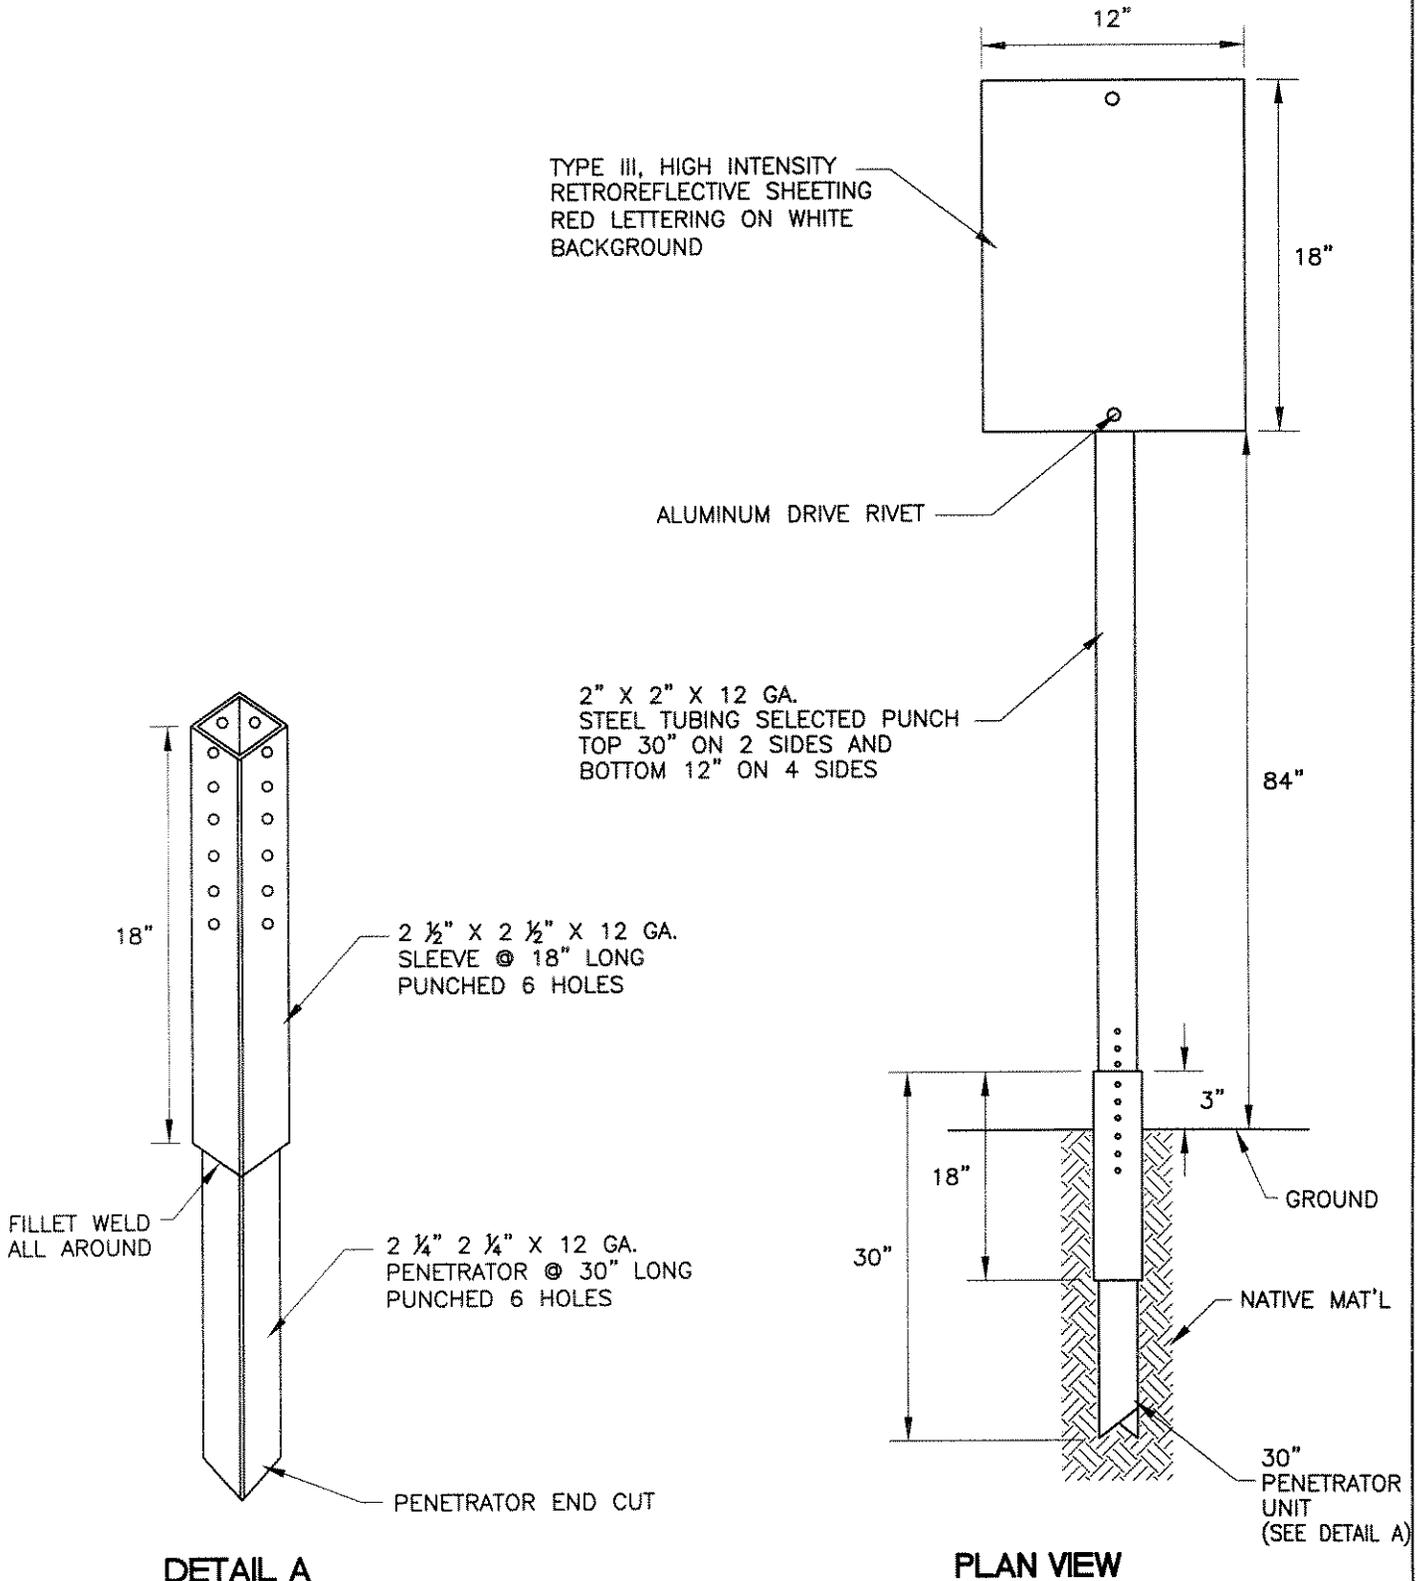

**DETAIL A**

**PLAN VIEW**

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:	
							12/16/04
Drawn By: LJA <span style="float: right;">Date: 3/19/04</span>							APPROVED: <i>Joseph S. Schenk</i> 24039 CITY ENGINEER RCE


## HORSE TRAIL SIGN

Std. Dwg. No.  
**720**  
Sheet 1 of 1

**800**  
**SIGN AND MARKING**  
**STANDARDS**



# CITY of NORCO STANDARD DRAWING

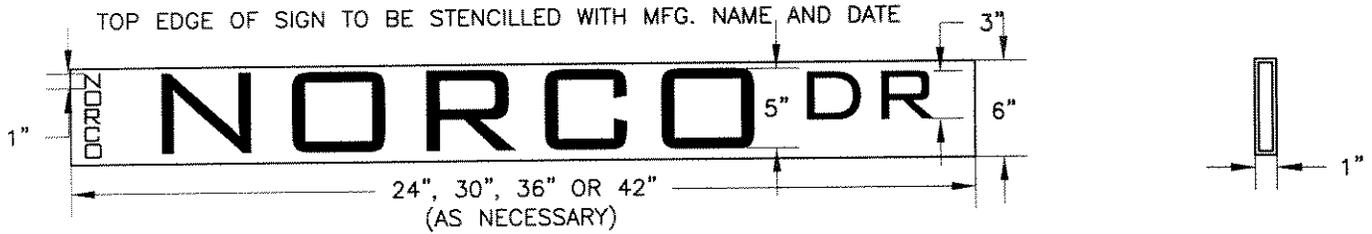


LETTERS TO BE ROUNDED STYLE  
CONFORMING WITH STANDARD ALPHABET

### SIGN MATERIALS:

1. SIGN SHALL BE EXTRUDED AT6 STYLE ALUMINUM OF THE CROSS SECTION SHOWN. 6063T5 ALLOY.
2. BACKGROUND - GREEN 3M HIGH INTENSITY GRADE SHEETING.
3. LEGEND SHALL BE 3M HIGH INTENSITY GRADE SHEETING FOR ALL WHITE DIE CUT LETTERS AND NUMBERS.

### POST MATERIALS:

1. 2" SQUARE TELES PAR OR APPROVED EQUAL.
2. GALVANIZED STEEL.

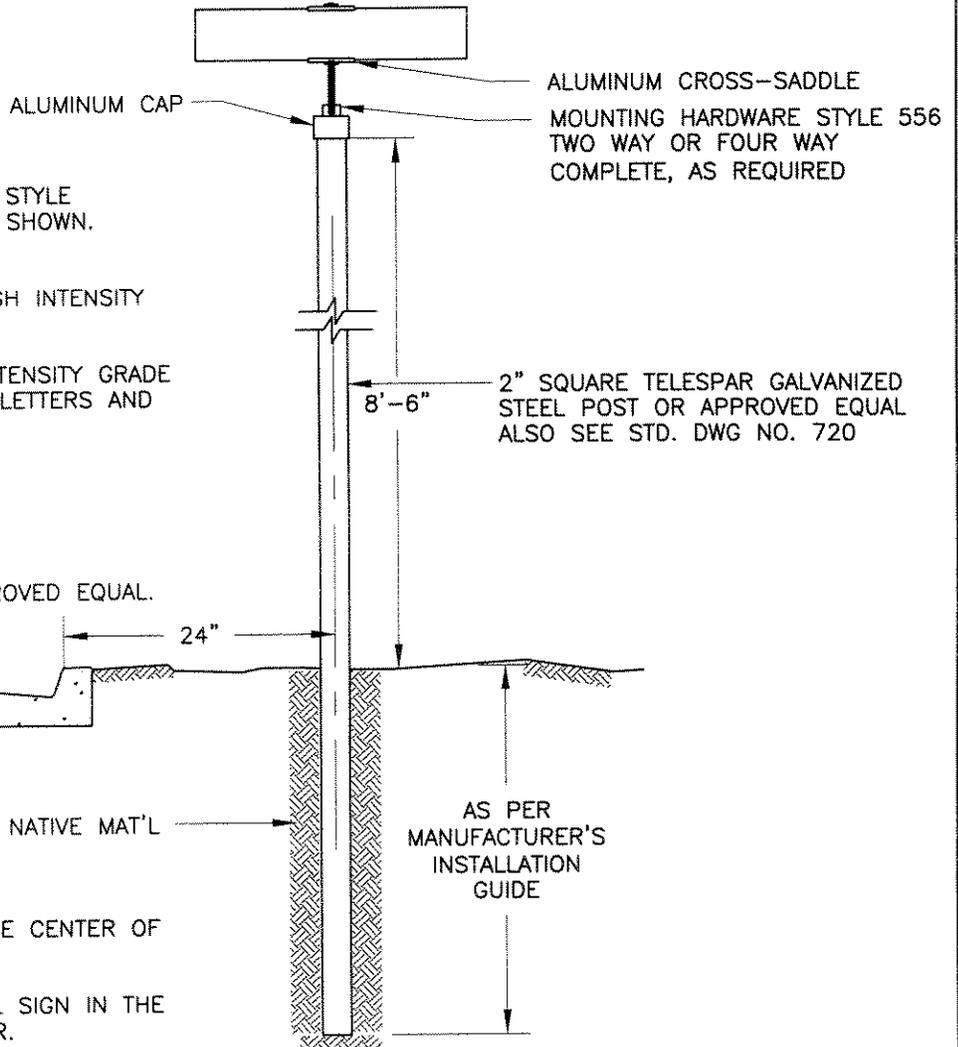


### SIGN PLACEMENT:

THE SIGN SHALL BE PLACED AT THE CENTER OF THE CURB RETURN AS FOLLOWS:

1. AT TEE INTERSECTIONS, INSTALL SIGN IN THE NORTHEAST OR SOUTHWEST CORNER.
2. AT FOUR WAY INTERSECTIONS, INSTALL SIGNS ON BOTH NORTHEAST AND SOUTHWEST CORNERS.
3. AT KNUCKLES INSTALL SIGNS AT CENTER OF CURB RETURN.



REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:	
							12/16/04
							APPROVED: <i>Joseph S. Schenk</i> 24039 CITY ENGINEER RCE
Drawn By: LJA			Date: 7/29/04				
<b>STREET NAME SIGN</b>							Std. Dwg. No. <b>800A</b> Sheet 1 of 1

# CITY of NORCO STANDARD DRAWING

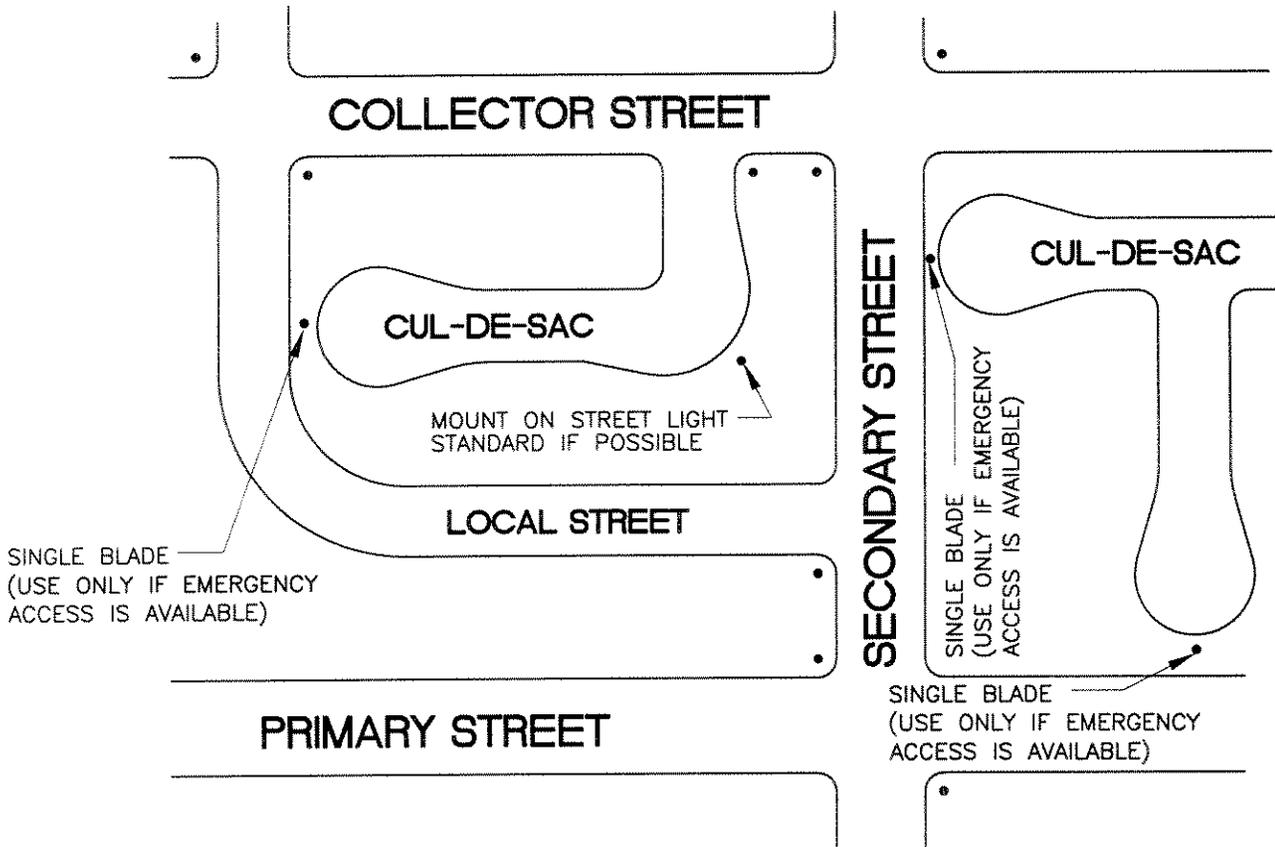

- TYPICAL STREET SIGN LOCATIONS: SIGNS SHOULD BE MOUNTED ON TOP OF STOP SIGN POSTS OR STREET LIGHT STANDARDS WHERE POSSIBLE. ALL SIGNS ARE TO BE DOUBLE SIGN INSTALLATIONS UNLESS OTHERWISE NOTATED ON THE PLANS.

CURB & SIDEWALK	SIDEWALK WIDTH	SETBACK
CONTIGUOUS	5' OR LESS	6" BEHIND SIDEWALK
CONTIGUOUS	MORE THAN 5'	2' BEHIND CURBFACE
SEPARATE	-----	2' BEHIND CURBFACE

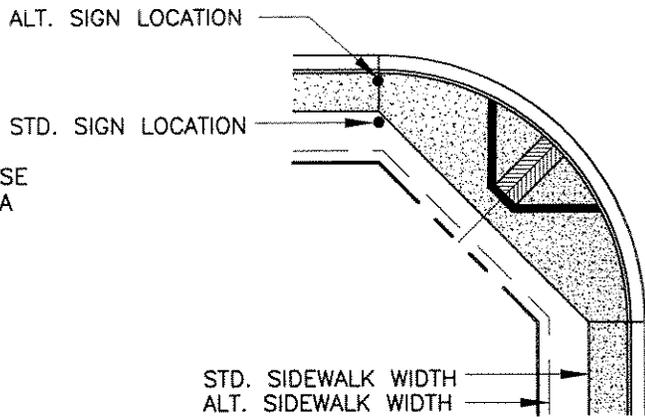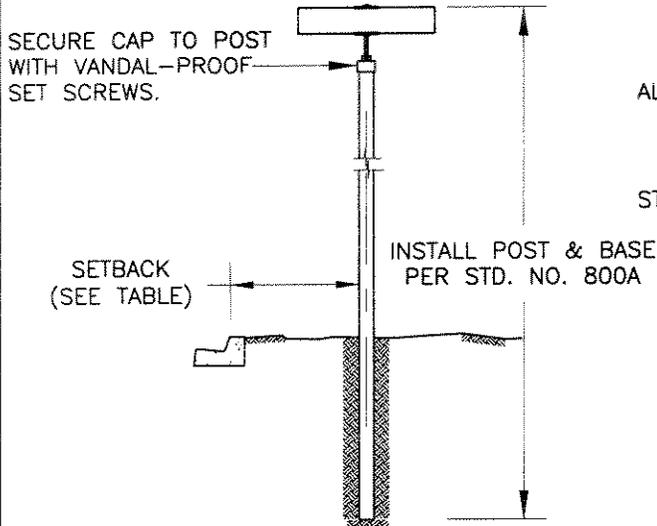

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:


12/28/04  
 APPROVED: *Joseph S. Schenk* 24039  
 CITY ENGINEER RCE

Drawn By: LJA Date: 12/29/04

## TYPICAL STREET NAME SIGN LOCATIONS


Std. Dwg. No.  
**800B**  
 Sheet 1 of 1

# CITY of NORCO STANDARD DRAWING

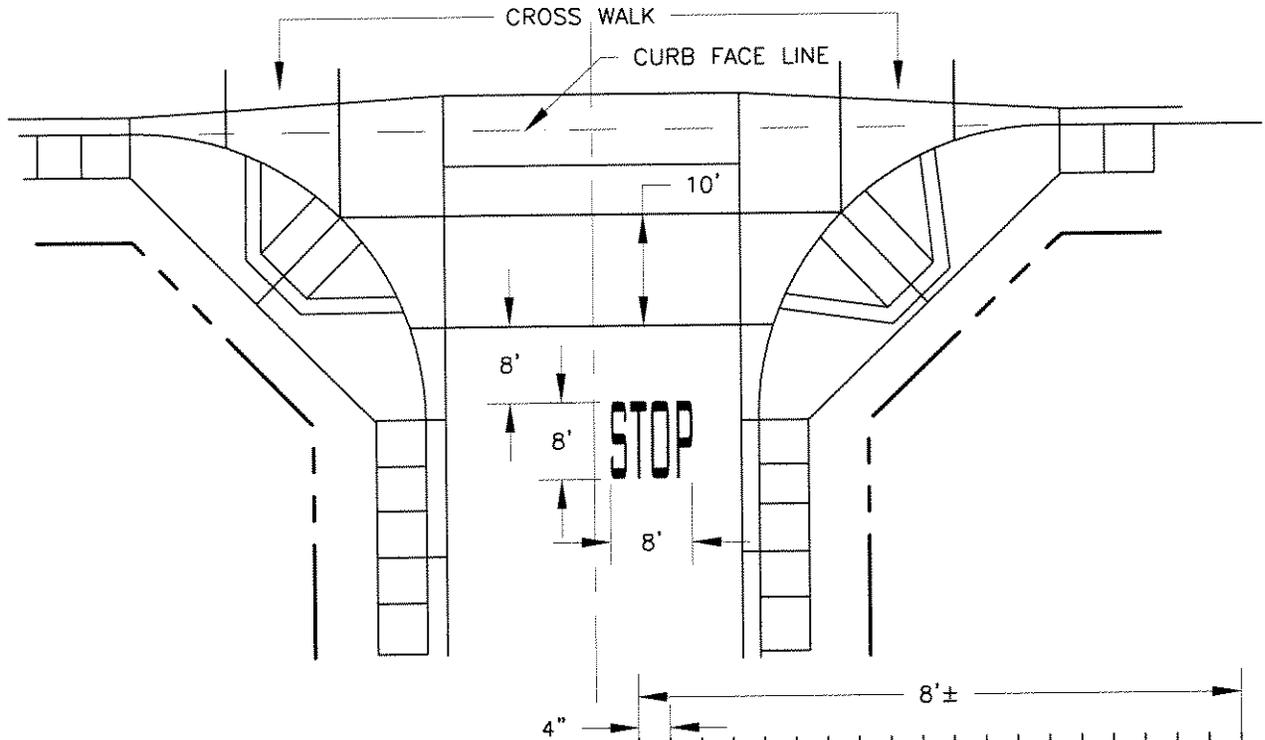

**NOTES:**

1. ALL LETTERS WILL BE IN CONFORMANCE WITH THE STANDARD ALPHABETS FOR HIGHWAY SIGNS AND PAVEMENT MARKINGS APPROVED BY CALTRANS HIGHWAY TRAFFIC MANUAL (LATEST EDITION). LETTERS WILL BE 8 FEET IN HEIGHT.
2. PAINT WILL BE J.E. BAUER # 628 A-9 WHITE PREMIX OR APPROVED EQUAL.
3. PAINTED AREA = 22 SQUARE FEET.
4. ONE STOP LEGEND SHALL BE INSTALLED IN EACH TRAVEL LANE.
5. THIS STANDARD IS IN CONFORMANCE WITH THE HIGHWAY SIGNS AND MARKINGS DESCRIBED IN THE CALTRANS HIGHWAY TRAFFIC MANUAL (LATEST EDITION).

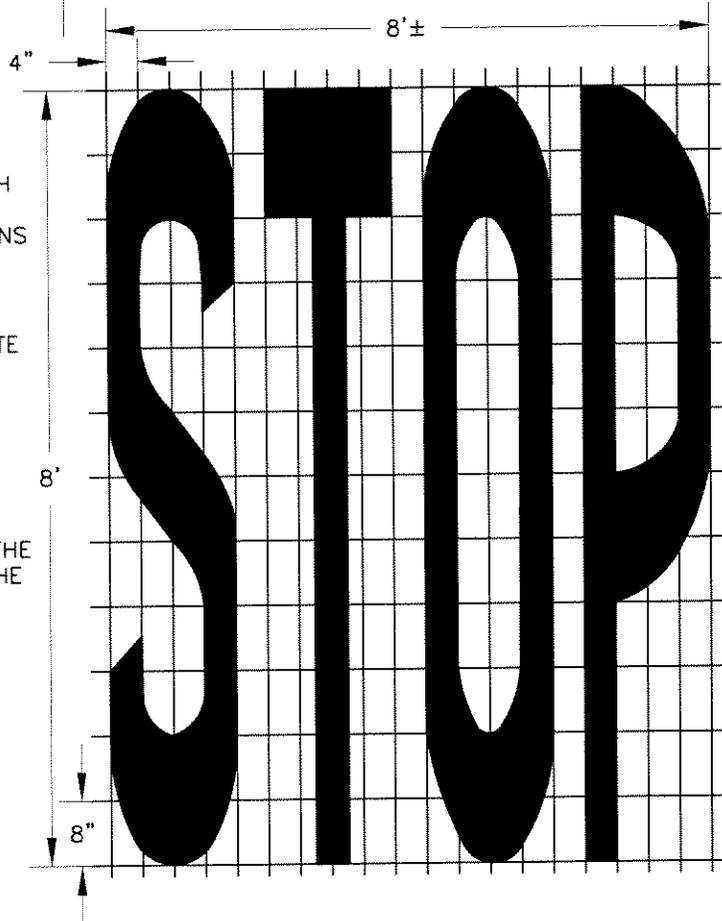


REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:	
							12/28/04
							APPROVED: <i>Joseph S. Schenk</i> 24039 CITY ENGINEER RCE
Drawn By: LJA			Date: 3/19/04				

## STOP BAR and LEGEND PLACEMENT

Std. Dwg. No.  
**815**  
Sheet 1 of 1

# CITY of NORCO STANDARD DRAWING

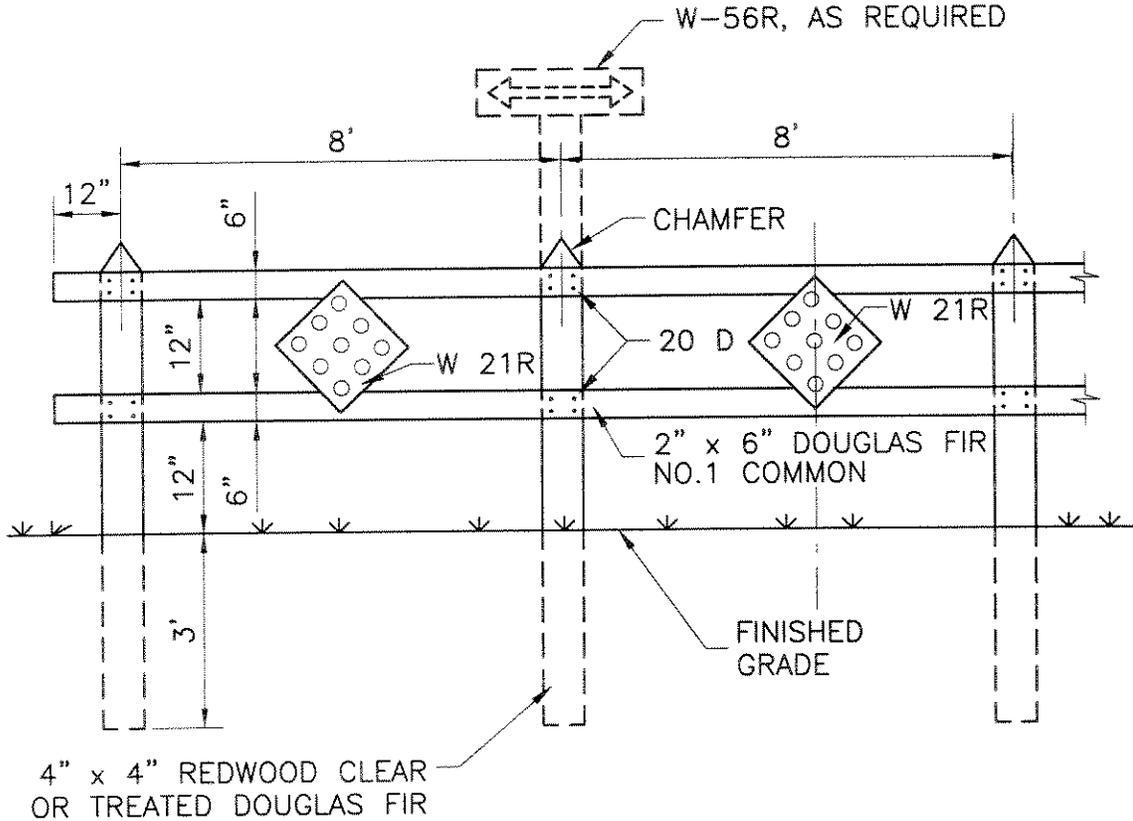

**TYPICAL SIDE PANEL**

**TYPICAL CENTER PANEL**

ROADWAY WIDTH	NO. OF PANELS	TOTAL LENGTH
10'	1	10'
18'-20'	2	18'
32'	3	26'
36'-40'	4	34'
64'	7	58'
72'	8	66'

**NOTE:**

- ASSEMBLY IS TO BE PAINTED WITH TWO COATS OF WHITE EXTERIOR PRIME PAINT.
- W 21 R REFLECTOR SIGN IS TO BE BOLTED TO CENTER OF BARRICADE.
- BOLTS, NUTS AND NAILS SHALL BE GALVANIZED STEEL.

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:	12/28/04 APPROVED: <i>Joseph S. Schenk</i> 24039 CITY ENGINEER RCE

Drawn By: LJA

Date: 12/29/04

## BARRICADE


Std. Dwg. No.  
**820**  
Sheet 1 of 1

# CITY of NORCO STANDARD DRAWING


## TRAFFIC INDEX STANDARDS

MAJOR ARTERIALS	10.0
SECONDARY ARTERIALS	8.5
COLLECTOR (INDUSTRIAL)	7.5
LOCAL (INDUSTRIAL)	7.0
*COLLECTOR (RESIDENTIAL)	6.0
*LOCAL (RESIDENTIAL)	5.0

\*MINIMUM STREET SECTION REQUIRED SHALL BE 4" A.C. OVER 6" C.A.B. OR AS APPROVED BY THE CITY ENGINEER.

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:
	1	LJA	01/27/04			
APPROVED:  24039 CITY ENGINEER <span style="float: right;">RCE</span>						
Drawn By: LJA			Date: 01/27/04			
<b>TRAFFIC INDEXES FOR DESIGN USE</b>						Std. Dwg. No. <b>830</b> Sheet 1 of 1

# CITY of NORCO STANDARD DRAWING

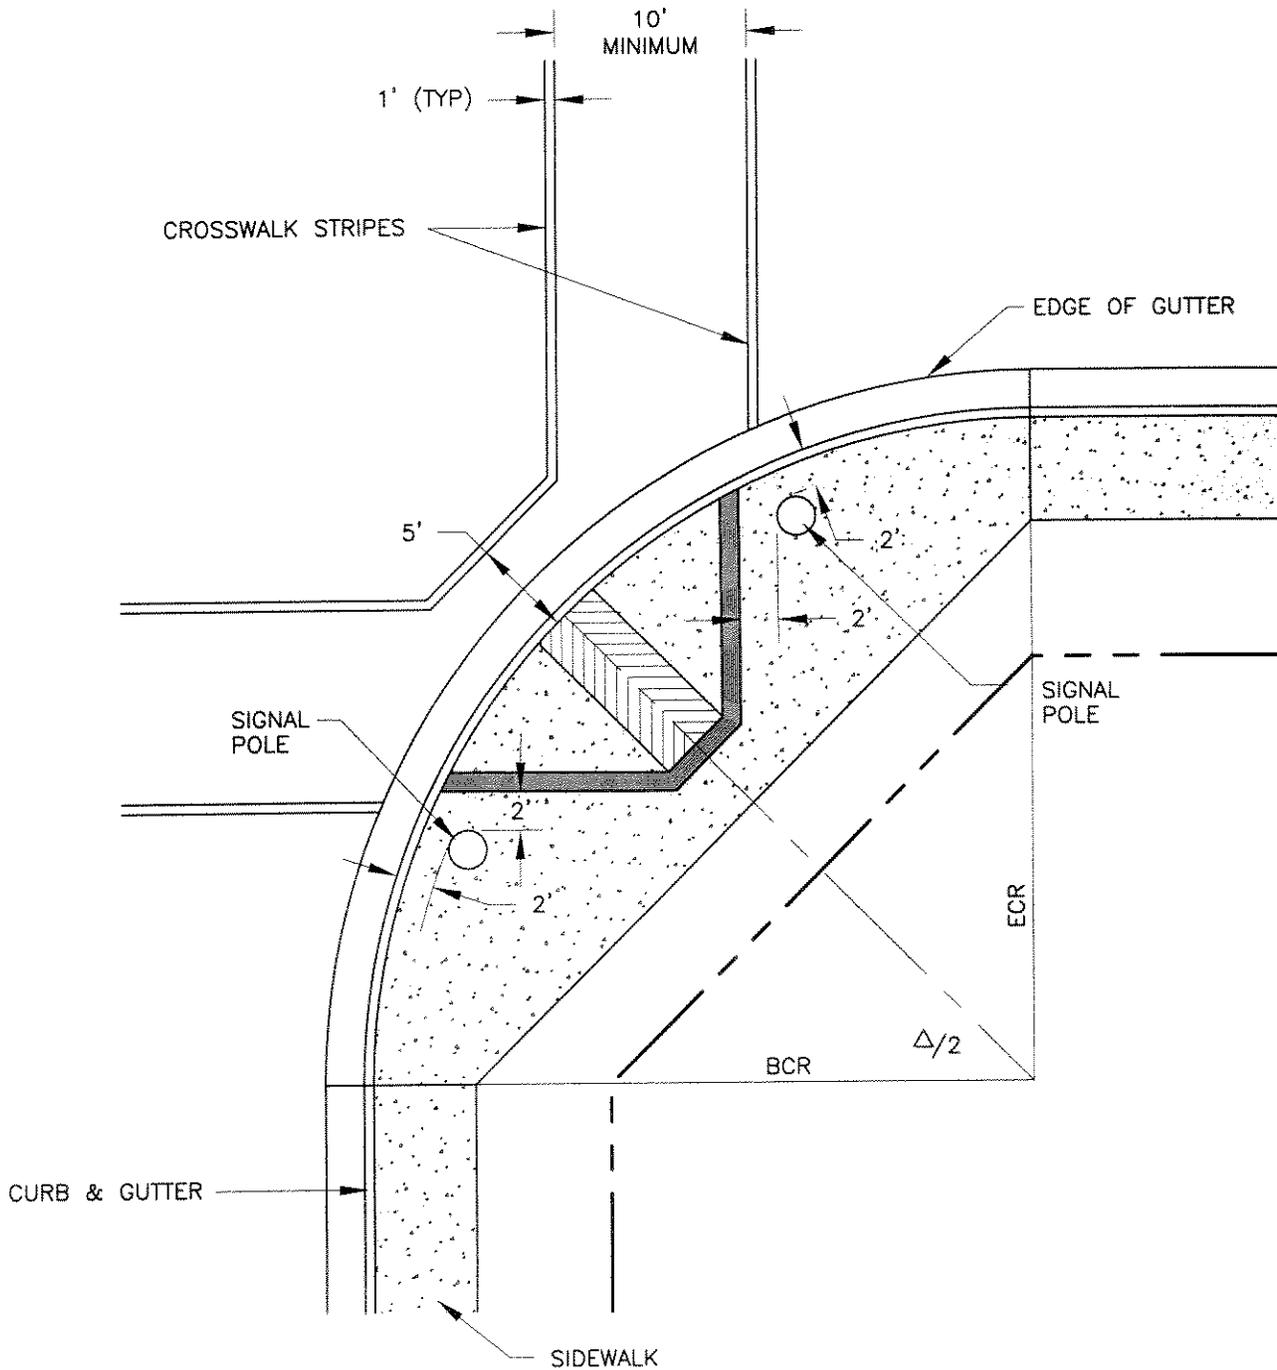

CROSSWALK WIDTH AND COLOR SHALL BE AS DETERMINED BY THE CITY ENGINEER.

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:
						12/22/04

Drawn By: LJA

Date: 3/19/04

APPROVED: *Joseph S. Schenk* 24039  
CITY ENGINEER RCE

## CROSSWALK PLACEMENT AND SIGNAL POLE LOCATION

Std. Dwg. No.  
**840**  
Sheet 1 of 1

**900**  
**SURVEY**  
**STANDARDS**



# CITY of NORCO STANDARD DRAWING

**NOTES:**


- ① TIES SHALL BE DRAWN ON 8 ½" x 11" BOND OR EQUAL, (ORIGINAL TIE SHEETS MUST BE SUBMITTED TO THE CITY).
- ② EACH SHEET SHALL SHOW THE FIRM NAME, L.S. OR R.C.E. NUMBER AND SEAL, TRACT NUMBER, DATE AND SHEET NUMBER.
- ③ THE FIRST SHEET SHALL BE AN INDEX MAP, SHOWING ALL STREETS WITH REFERENCE TO PAGE NUMBERS.
- ④ NORTH ARROW UP OR TO THE RIGHT (NEVER DOWN).
- ⑤ ALL TIE POINTS, (MINIMUM OF 4) SHALL BE LEAD AND TACK OR QUICK SET NAILS WITH WASHERS IN CURB, WHERE POSSIBLE.
- ⑥ ALL MEASUREMENTS FOR TIES SHALL BE TAKEN HORIZONTALLY.
- ⑦ WHERE CURVED STREETS ARE SHOWN ON TIE SHEETS, THE B.C.R., P.R.C., AND E.C.R. SHALL BE TIED OUT, AND THE CURVE DATA SHOWN ON THE SHEET, TOGETHER WITH THE DISTANCE TO THE NEAREST STREET TIE BEYOND EACH END OF SUBJECT CURVES.
- ⑧ ONLY ONE INTERSECTION OR CONTROL POINT SHALL BE SHOWN ON A SINGLE PAGE.
- ⑨ TIES WHICH HAVE BEEN SUBMITTED WILL BE REVIEWED BY ENGINEERING STAFF BEFORE A TRACT OR PROJECT MAY RECEIVE A FINAL RELEASE.

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:	12/22/04  APPROVED: <i>Joseph D. Schenk</i> 24039 CITY ENGINEER RCE
Drawn By: LJA			Date: 3/19/04				
<b>CENTERLINE TIE REQUIREMENTS</b>							Std. Dwg. No. <b>900</b> Sheet 1 of 1

# CITY of NORCO STANDARD DRAWING

## NOTES:

- ① ON CURVES WHERE THE P.I. FALLS OUTSIDE OF THE PAVED SECTION, MONUMENTS MAY BE SET AND TIED OUT ON SEMI-TANGENTS IN LIEU OF BC, EC AND MIDPOINT BEING SET AND TIED OUT. THESE MONUMENTS WILL BE SET WITHIN THE TRAVELED WAY.
- ② ○ INDICATES 1" I.P. SET AT LOT CORNER AND USED AS TIE POINT FOR STREET CENTERLINE.
- ③ N INDICATES NUMBER OF TIE POINT.
- ④ MASONRY NAIL MAY BE SUBSTITUTED FOR LEAD & TACKS.
- ⑤ MIDPOINT IS NOT REQUIRED IF THE BC AND EC ARE SET AND THE CHORD LINE IS IN THE TRAVELED WAY.

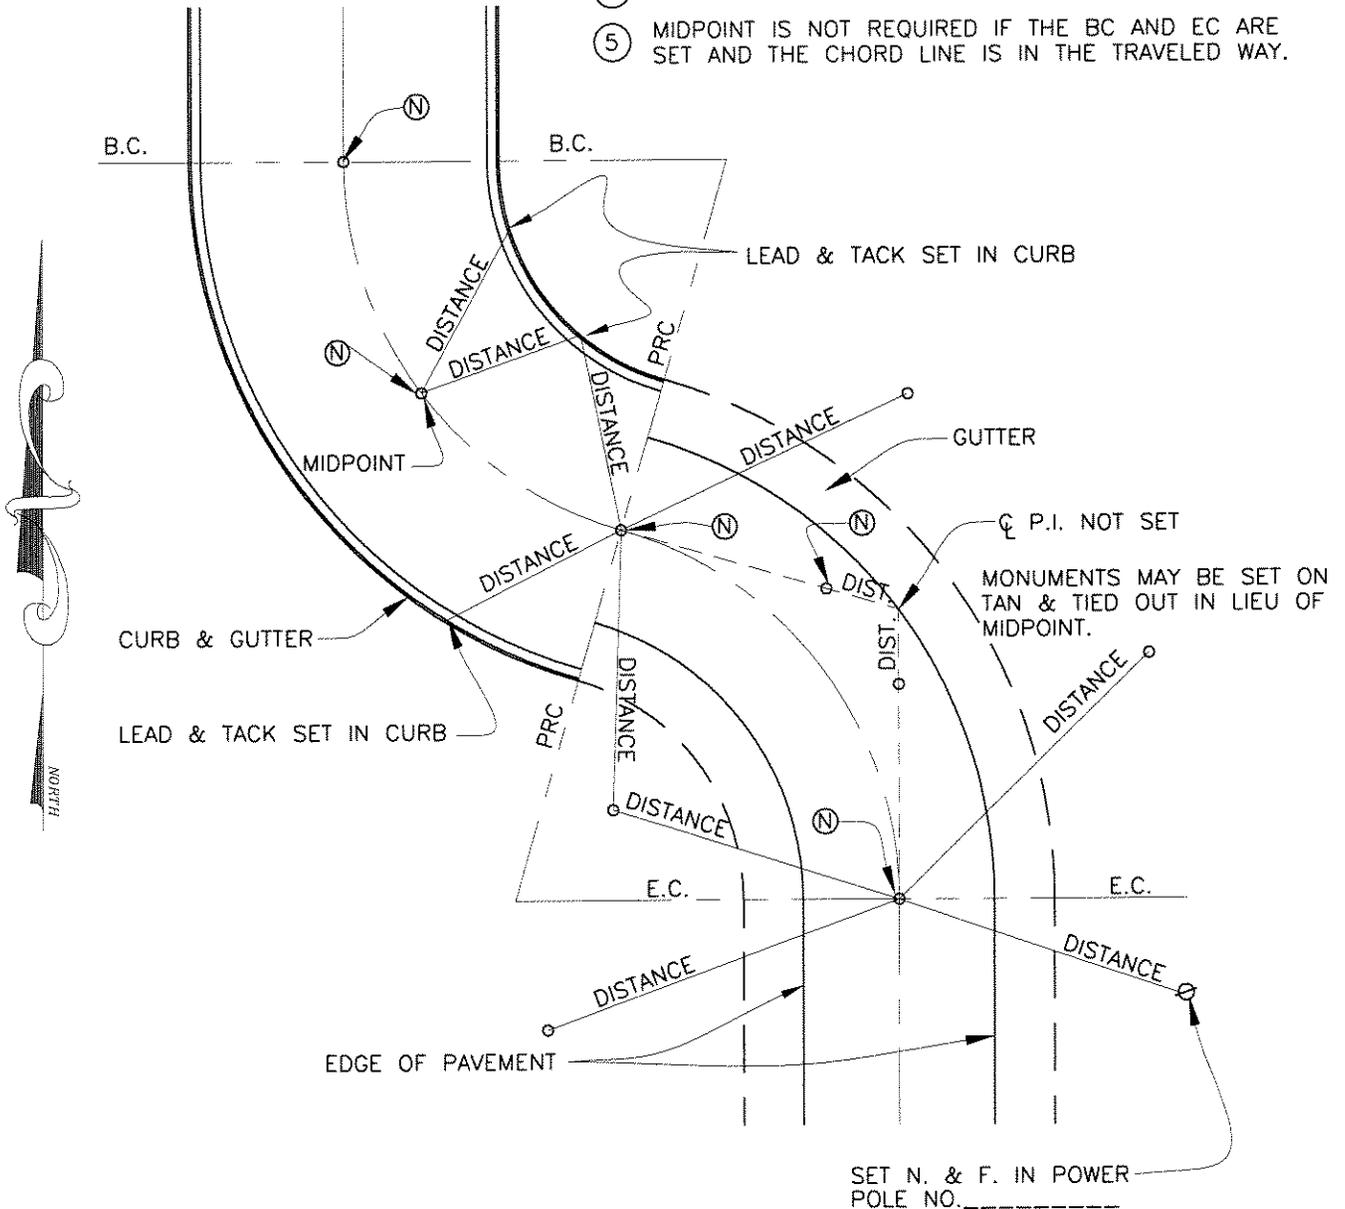

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:

12/28/04  
 APPROVED: *Joseph S. Schenk* 24039  
 CITY ENGINEER RCE


Drawn By: LJA

Date: 07/14/04

## STREET TIE LOCATIONS

Std. Dwg. No.  
**905A**  
 Sheet 1 of 1

# CITY of NORCO STANDARD DRAWING

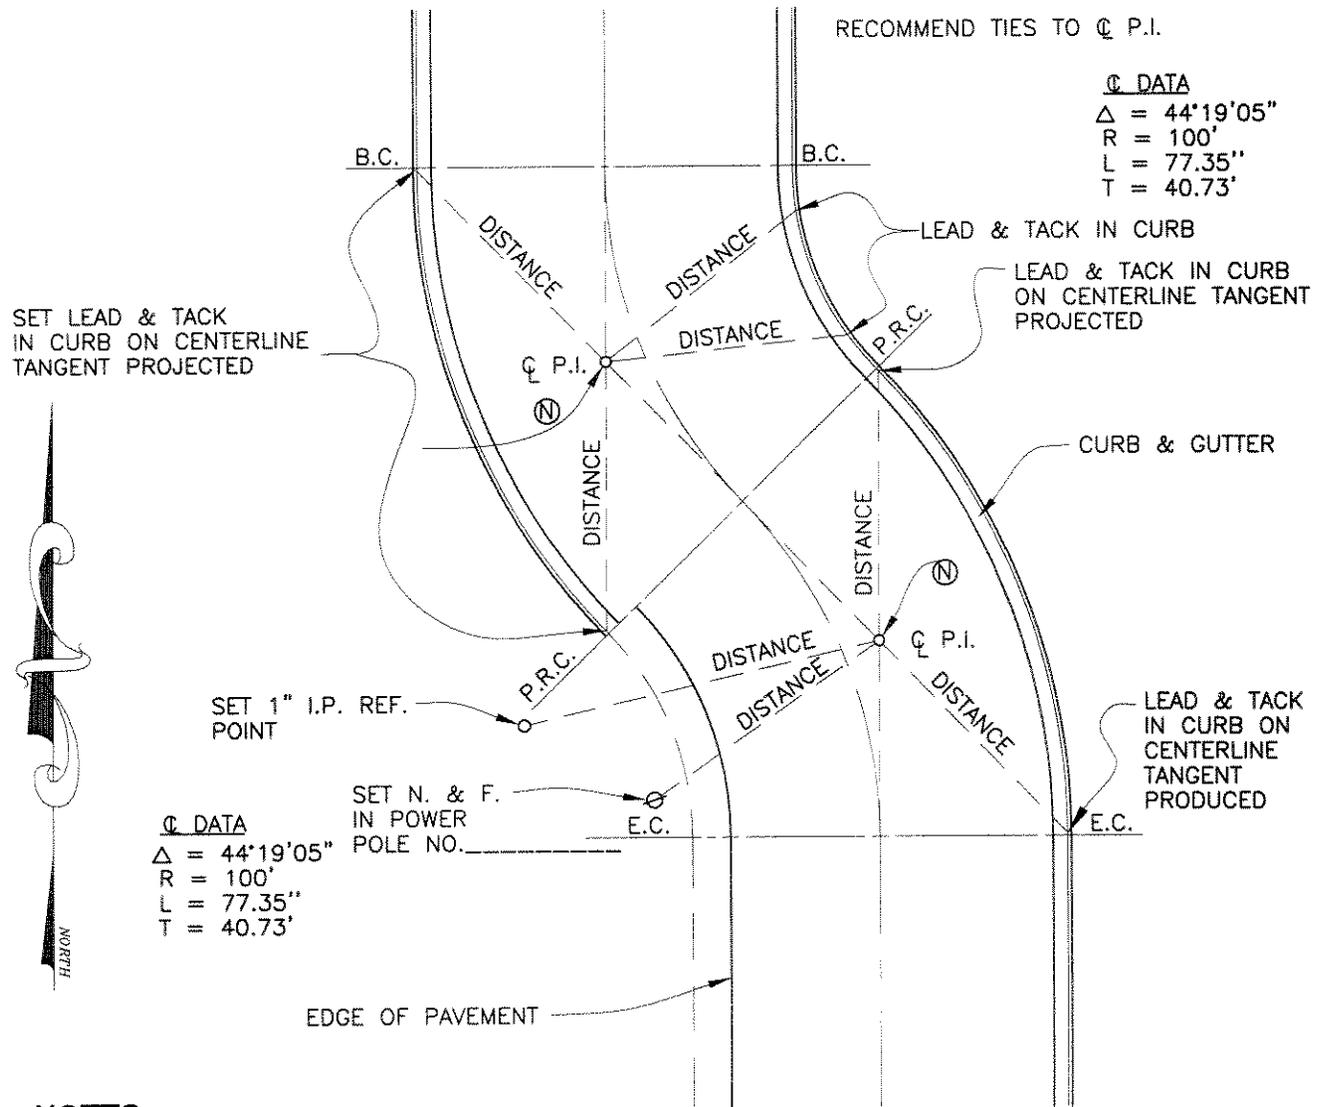

**NOTES:**

- ① MASONRY NAIL MAY BE SUBSTITUTED FOR LEAD AND TACK.
- ② N INDICATES NUMBER OF TIE POINT.

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:	12/22/04 APPROVED: <i>Joseph S. Schenk</i> 24039 CITY ENGINEER RCE


Drawn By: LJA

Date: 07/14/04

## STREET TIE LOCATIONS

Std. Dwg. No.  
**905B**  
Sheet 1 of 1

# CITY of NORCO STANDARD DRAWING

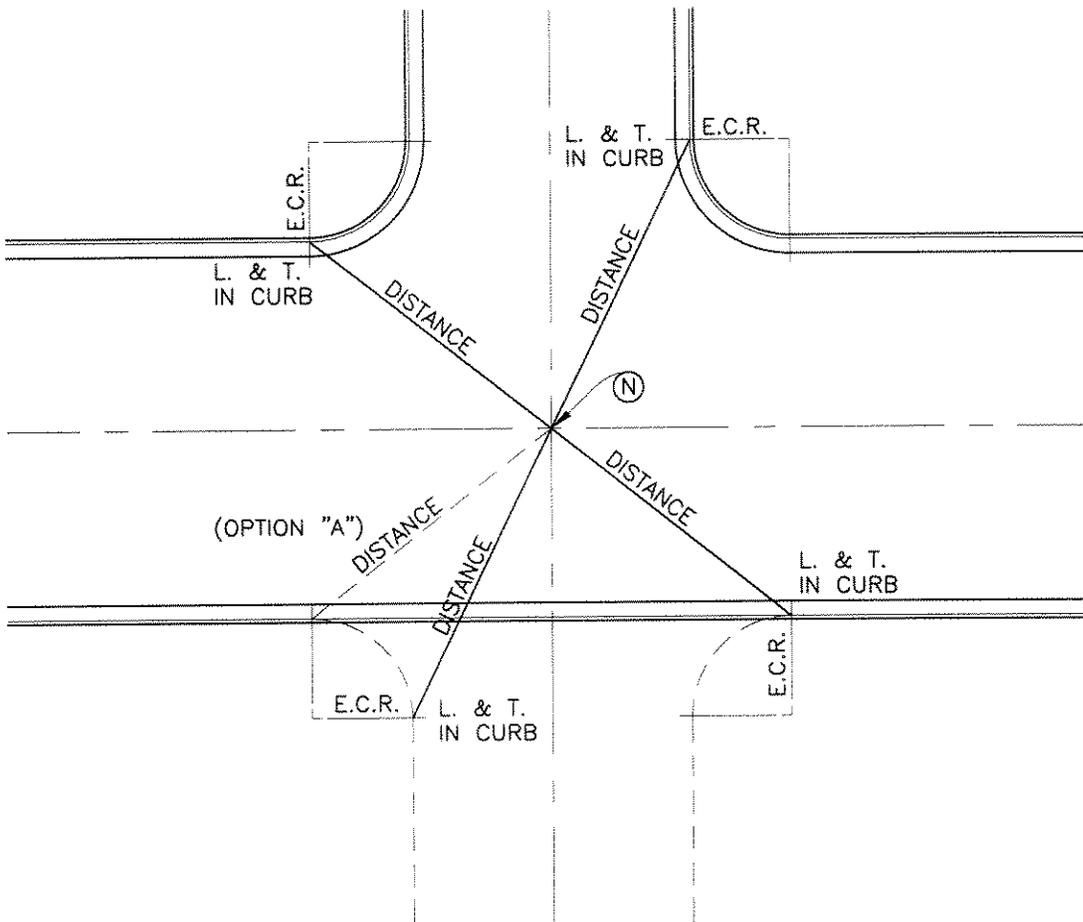


**NOTES:**

- ① ALL TIE POINTS SHALL BE TIED OUT TO THE E.C.R.'S, EXCEPT IN THE CASE OF A TEE INTERSECTION, THEN OPTION "A" SHALL BE USED AS SHOWN ABOVE.
- ② MASONRY NAIL MAY BE SUBSTITUTED FOR LEAD AND TACK.
- ③ 1" IRON PIPE (MINIMUM) WITH NAIL AND L.S. OR R.C.E. TAG SHALL BE USED FOR ALL STREET CENTERLINE INTERSECTION MONUMENTS.
- ④ (N) INDICATES NUMBER OF TIE POINT AS SHOWN ON SCHEDULE OF TIES.

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:	12/22/04
							APPROVED: <i>Joseph S. Schenk</i> 24039 CITY ENGINEER RCE
Drawn By: LJA			Date: 07/14/04				
STREET TIE LOCATIONS							Std. Dwg. No. <b>905C</b> Sheet 1 of 1

# CITY of NORCO STANDARD DRAWING

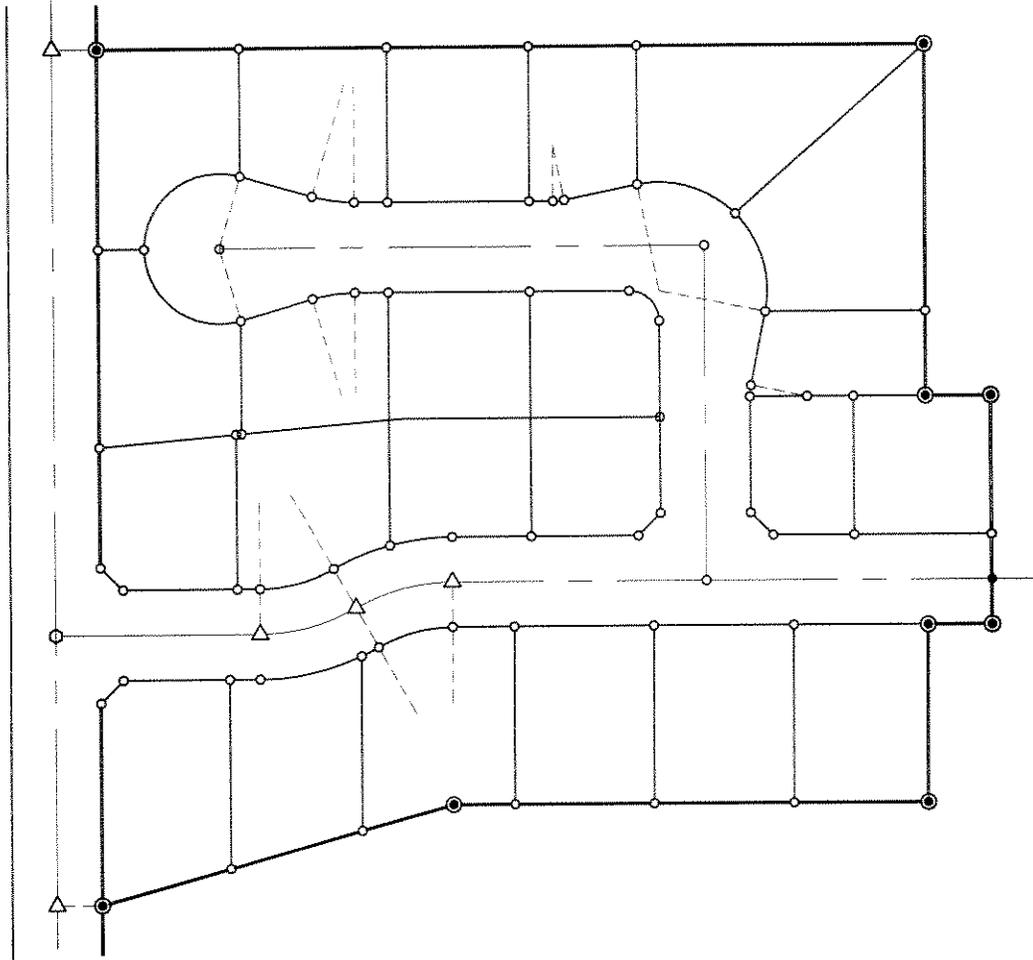

**NOTES:**

- (1) INDICATES MONUMENT FOUND AS NOTED.
- (2) INDICATES SET 2" IRON PIPE WITH NAIL AND L.S. OR R.C.E. TAG.
- (3) INDICATES SET 1" IRON PIPE WITH NAIL AND L.S. OR R.C.E. TAG, UNLESS OTHERWISE NOTED. NAIL AND TAG MAY BE SET IN THE TOP OF CURB ON FRONT PROJECTION OF ALL SIDE LOT LINES IN LIEU OF 1" IRON PIPES.
- △ (4) INDICATES SET SPIKE AND WASHER STAMPED WITH L.S. OR R.C.E. NUMBER. 1" IRON PIPES WITH NAIL AND L.S. OR R.C.E. TAG MAY BE SET IN LIEU OF SPIKE AND WASHERS.

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:	12/22/04 APPROVED: <i>Joseph S. Schenk</i> 24039 CITY ENGINEER RCE
Drawn By: LJA			Date: 3/19/04				

## STANDARD SUBDIVISION MONUMENTATION

Std. Dwg. No.  
**915A**  
Sheet 1 of 1

# CITY of NORCO STANDARD DRAWING

**NOTES:**

- ① SEE STANDARD DRAWING NO. 900 FOR STREET TIE REQUIREMENTS.
- ② THE SURVEYOR SHALL SET REQUIRED TRACT MAP AND PARCEL MAP MONUMENTS PRIOR TO THE FINAL MAP BEING RECORDED, UNLESS SECURITY FOR THE SETTING OF MONUMENTS AT A LATER DATE HAS BEEN ACCEPTED BY THE CITY.
- ③ ALL MONUMENTS SHALL BE SET PRIOR TO ACCEPTANCE OF IMPROVEMENTS BY THE CITY.
- ④ NAIL AND TAG MAY BE SET IN THE TOP OF CURB ON FRONT PROJECTION OF ALL SIDE LOT LINES IN LIEU OF 1" IRON PIPES.
- ⑤ ON RESIDENTIAL SUBDIVISIONS, 1" IRON PIPES SHALL BE SET AT LOT CORNERS.

REVISION	NO:	BY:	DATE:	NO:	BY:	DATE:	12/22/04  APPROVED: <i>Joseph S. Schenk</i> 24039 CITY ENGINEER RCE
Drawn By: LJA			Date: 4/19/04				
<b>SUBDIVISION MONUMENTATION NOTES</b>							Std. Dwg. No. <b>915B</b> Sheet 1 of 1